


1. REMOVE (E)DUST COLLECTOR AND RETURN TO OWNER. REMOVE ALL EXHAUST DUCTWORK BEYOND. CONTRACTOR TO VERIFY (E)ROUTING.
2. REMOVE (E)DUCTWORK.
3. REMOVE (E)HW COIL IN THE DUCT AND CAP OFF PIPE.



DRAWN/ CHECKED: TB

QUESTIONS / REVISIONS:

MD2.2

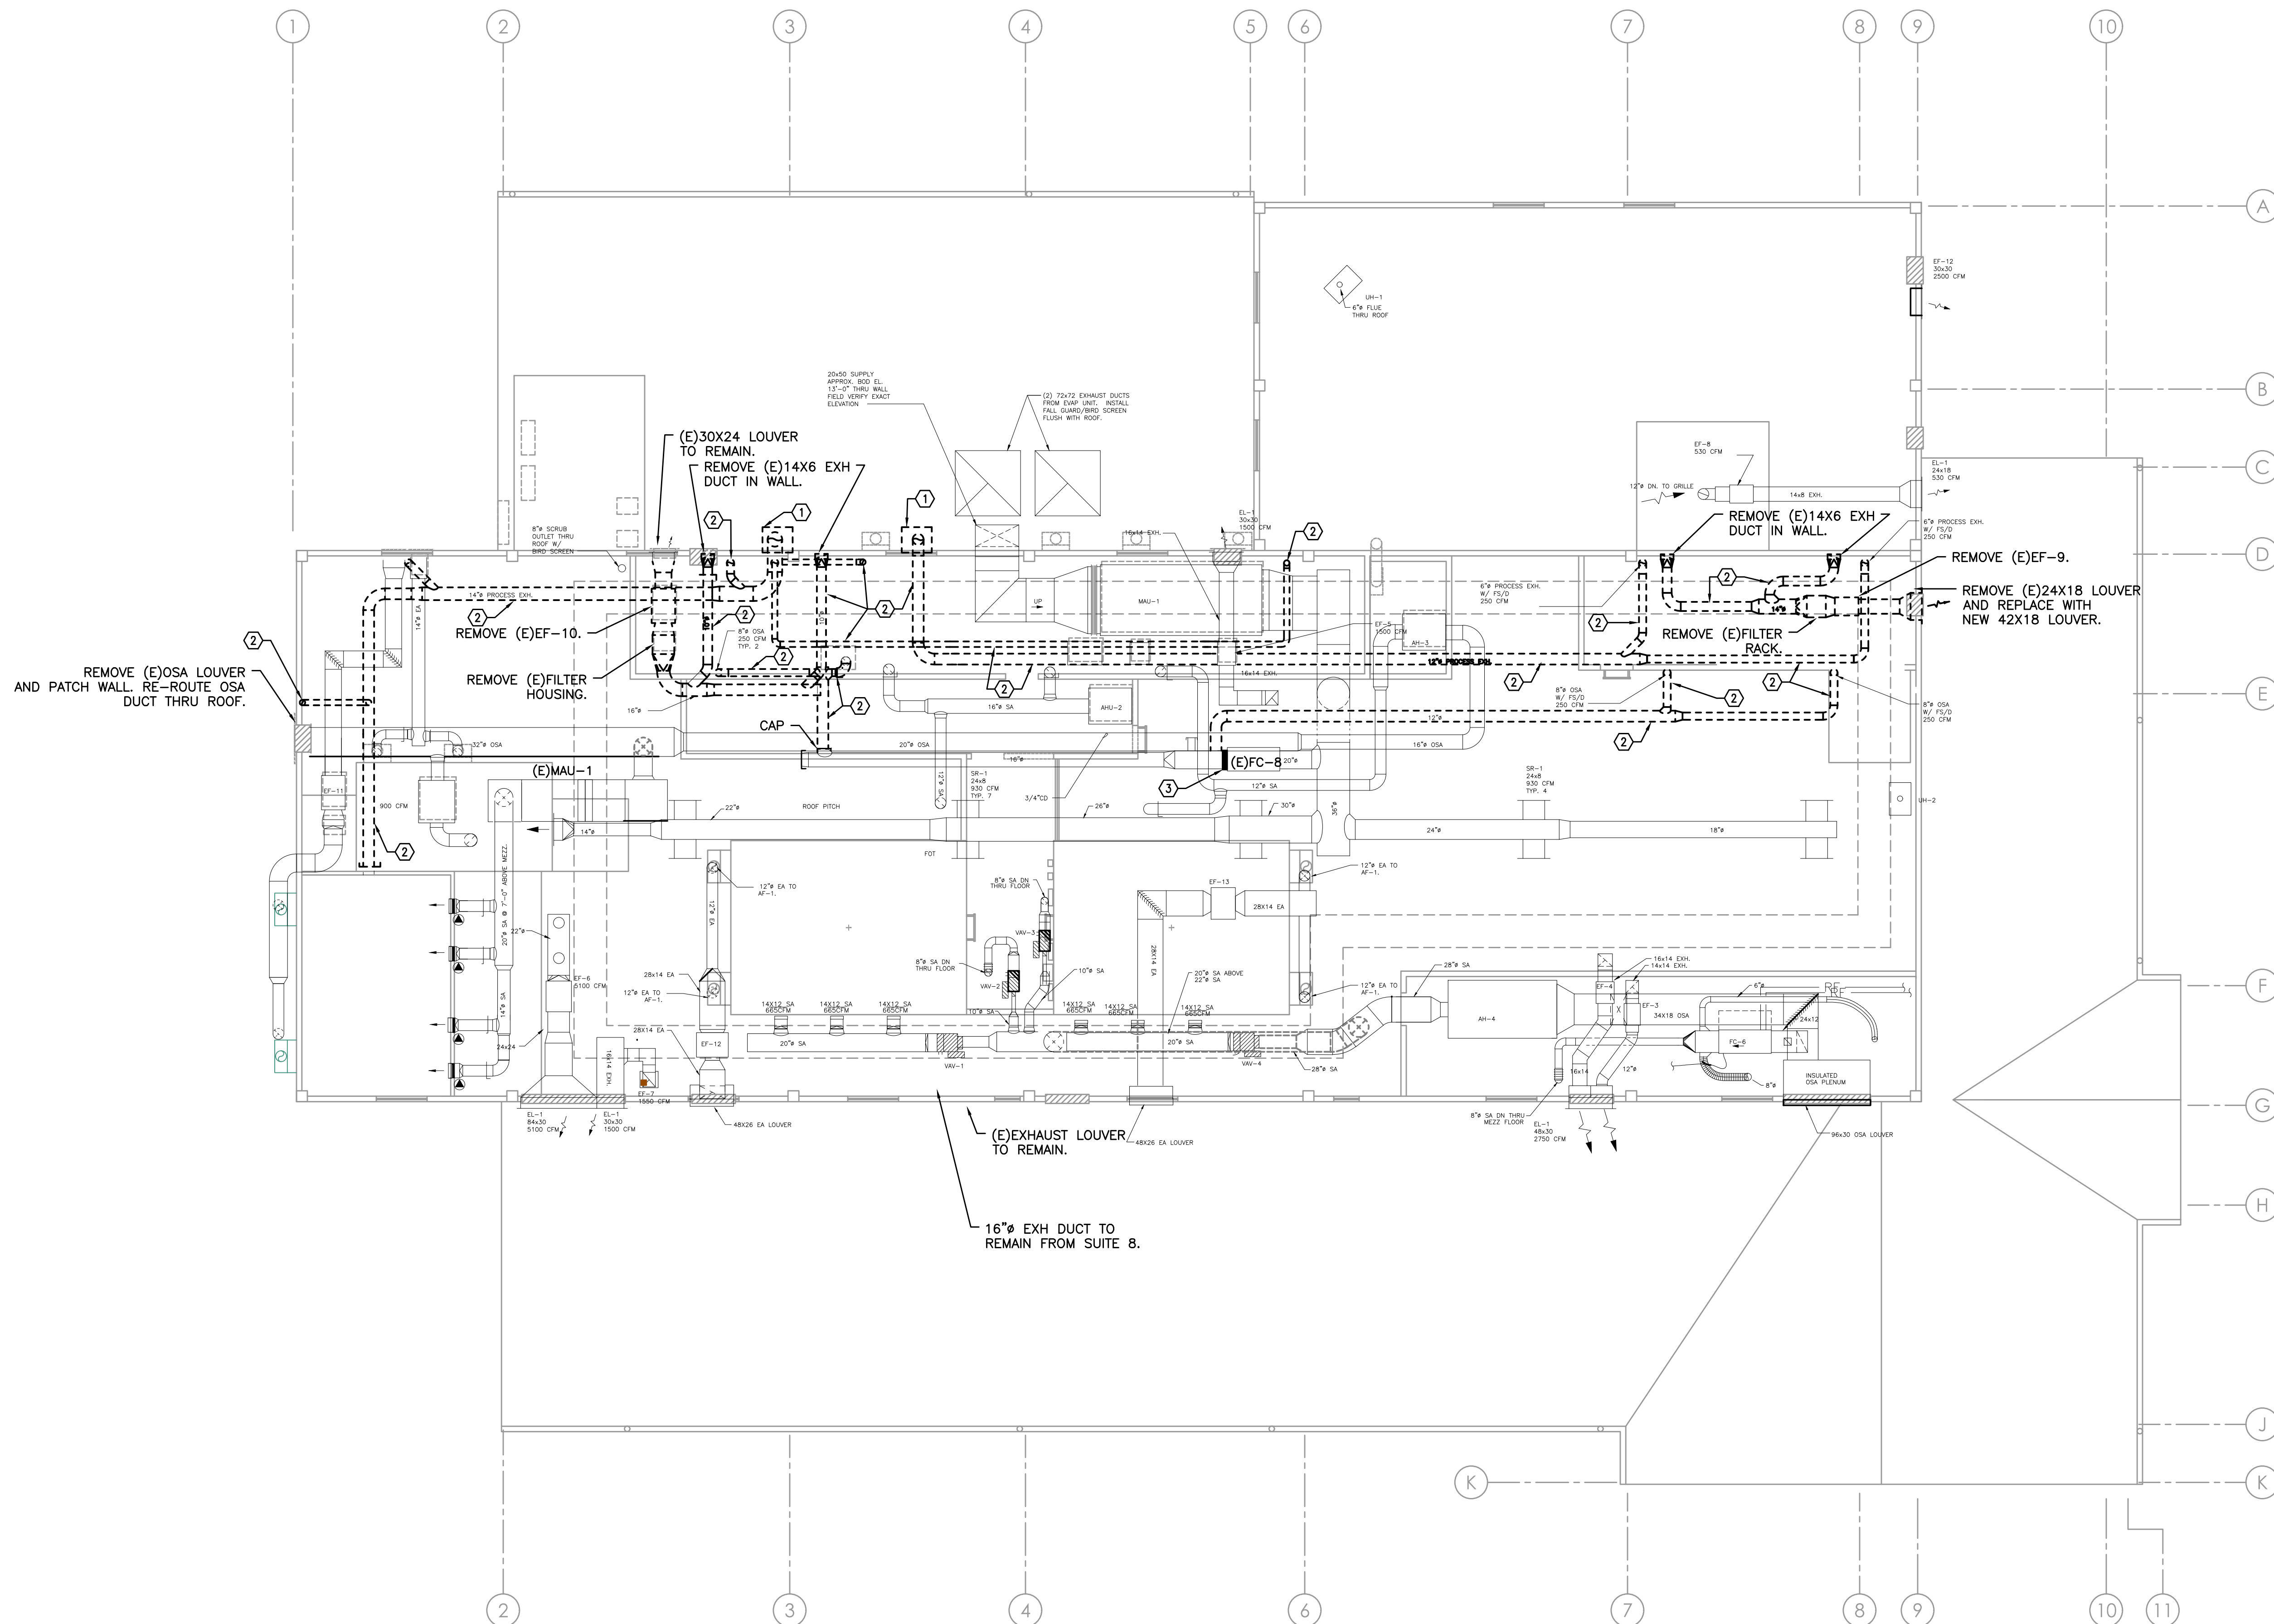

 1 MECHANICAL DEMO PLAN – SECOND FLOOR
MD2.2 1/8"=1'-0"