


PLAN REVIEW APPROVAL STAMP

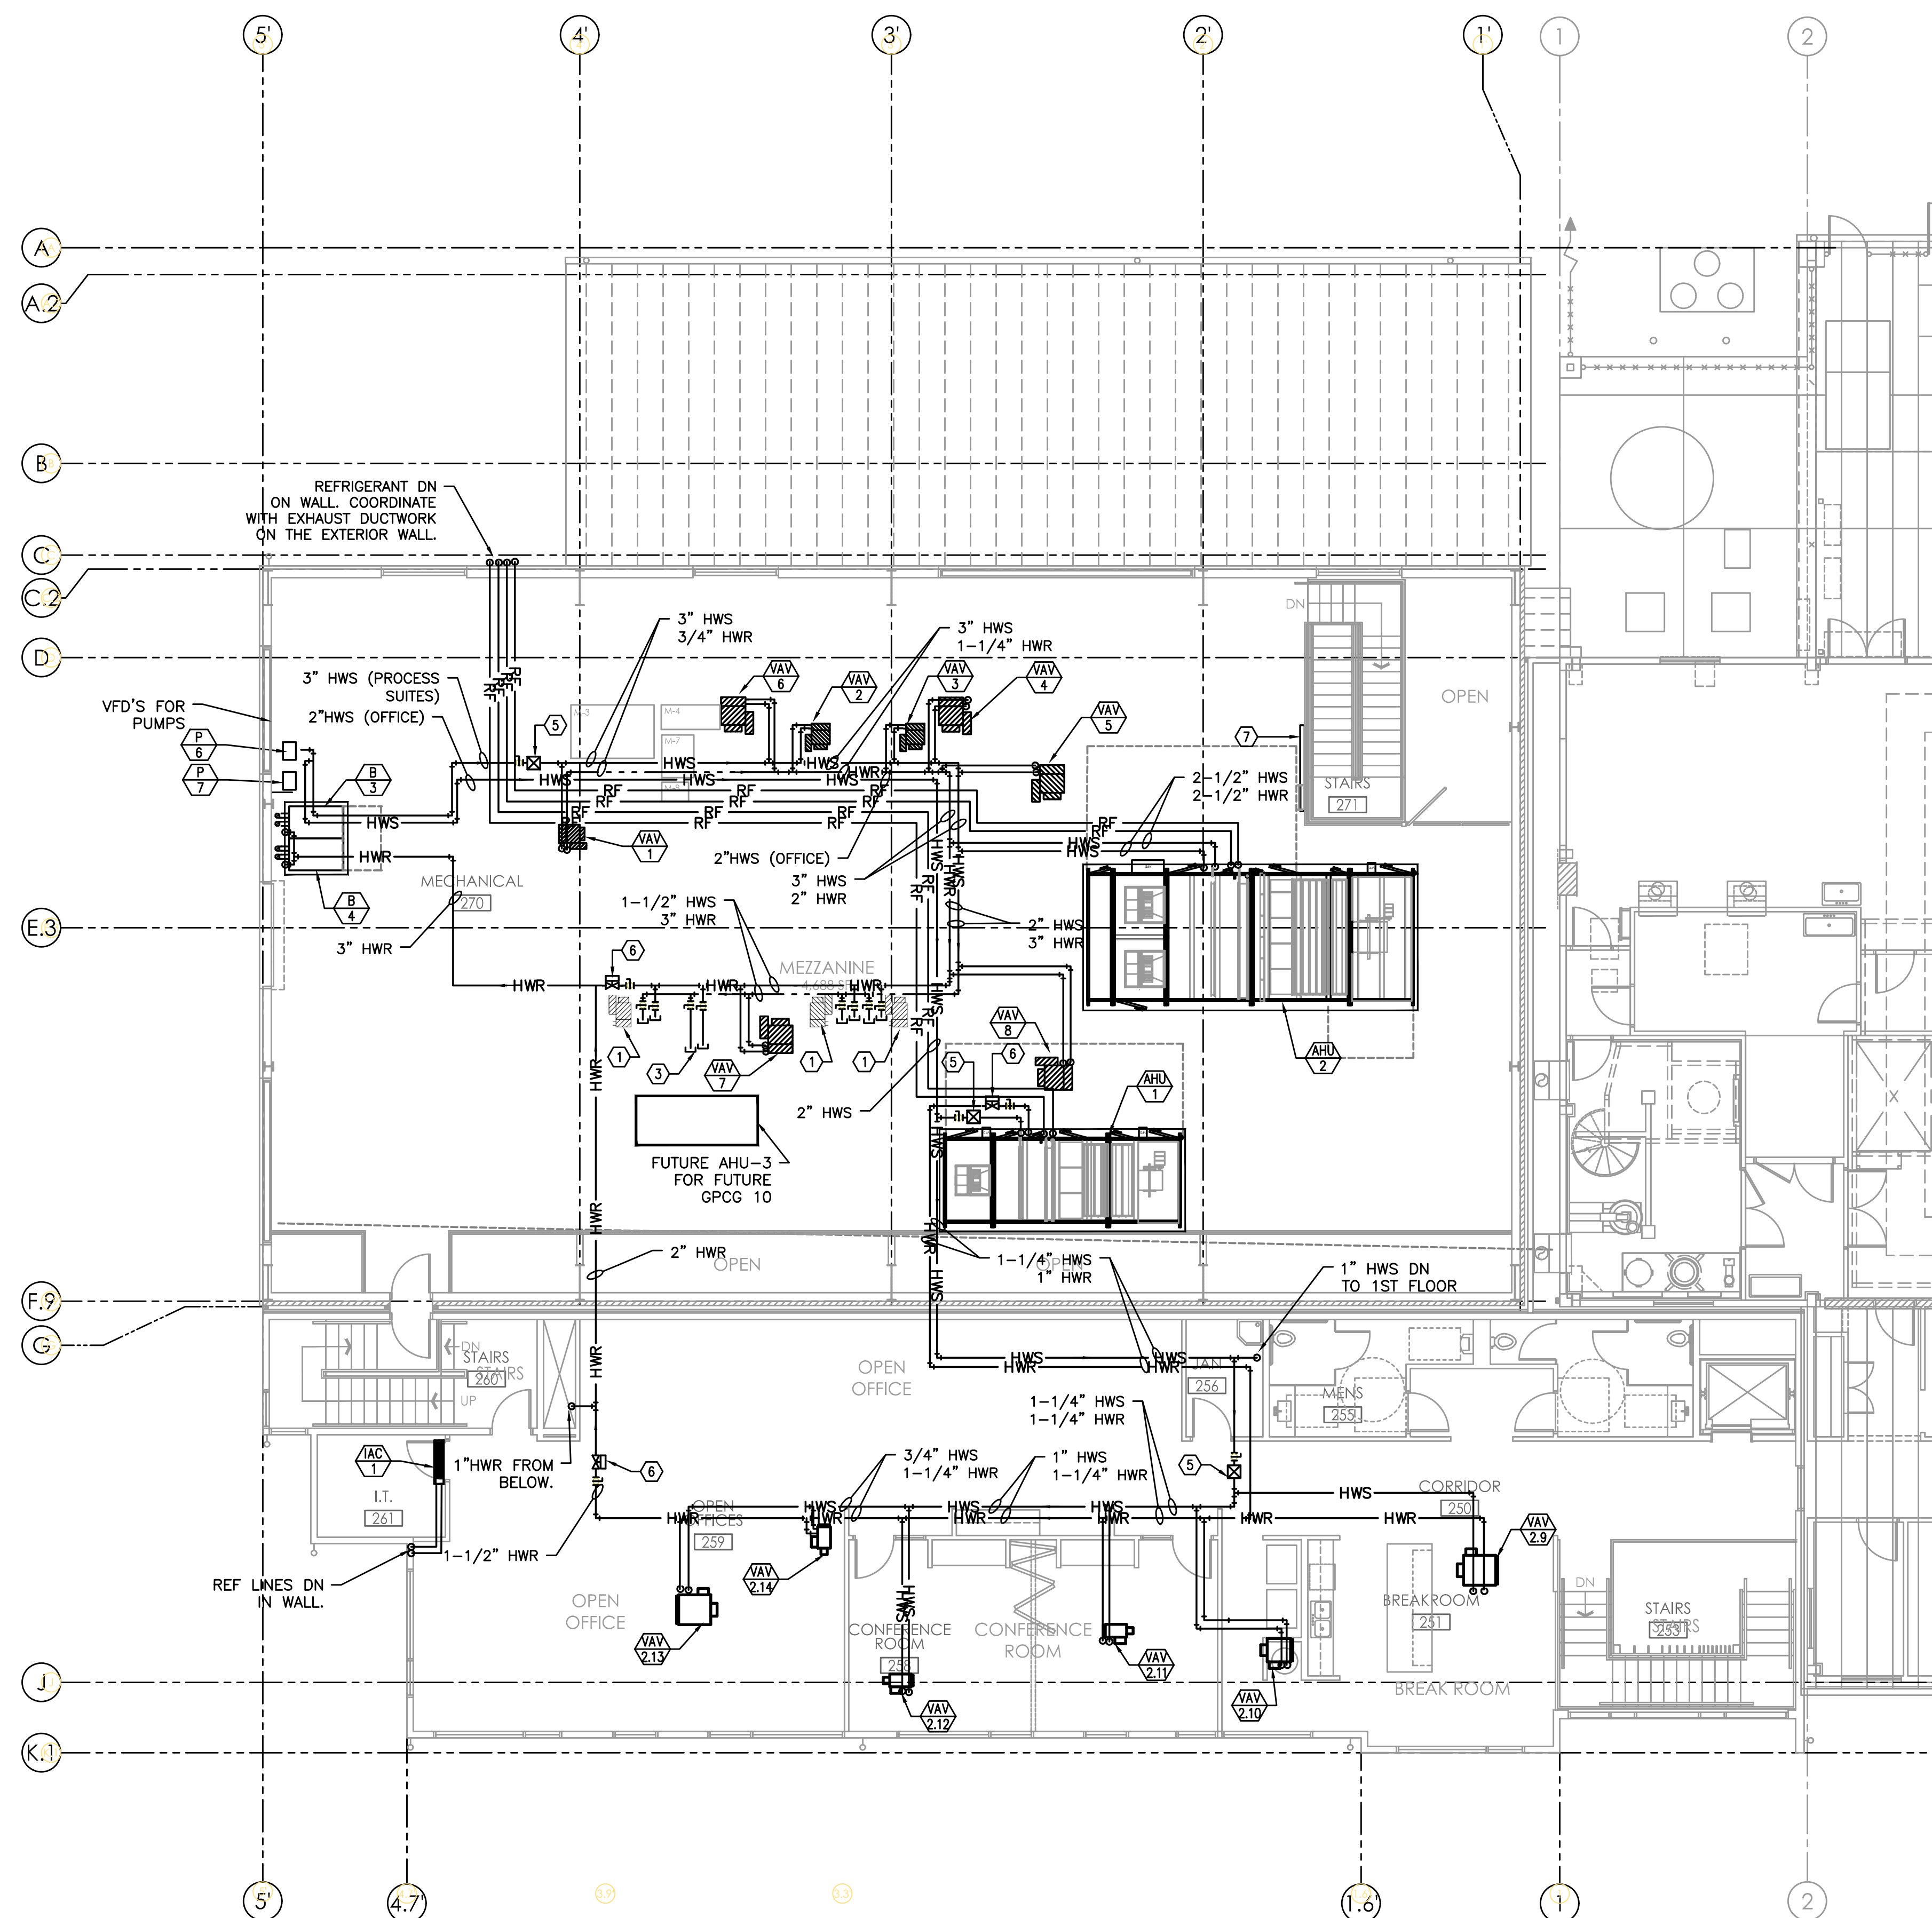

- GENERAL NOTES:
- CONTRACTOR TO COORDINATE PIPE ROUTING WITH OTHER DISCIPLINES.
- KEYED NOTES:
- FUTURE VAV BOX.
 - 3/4" HWS/HWR CAPPED WITH SHUT-OFF VALVE FOR FUTURE.
 - 1-1/4" HWS/HWR CAPPED WITH SHUT-OFF VALVE FOR FUTURE.
 - CONNECT (N)3/4" HWS/HWR TO (E) MAINS.
 - T/A SERIES BALANCE VALVE. SEE PIPING SCHEMATIC ON SHEET MP3.0 FOR GPM SETTING.
 - T/A SERIES 794 DIFFERENTIAL PRESSURE CONTROLLER.

1 MECHANICAL PIPING SECOND FLOOR — ADDITION
MP2.2A 1/8"=1'-0"

BEND RESEARCH, INC
CORPORATE PLACE FACILITY - BUILDING EXPANSION NORTH

BCA
BLAISE CACCIOLA
ARCHITECT
1465 SW Knoll Avenue, Suite 250
Bend, OR 97702
Phone: 541.728.0375
www.BCA-Architect.com

DRAWN/ CHECKED: TB

ISSUES / REVISIONS:

MECH PIPING SECOND FLOOR-
EXISTING BUILDING

MP2.2A