




BLAISE CACCIOLA
ARCHITECT

1465 SW Knoll Avenue, Suite 250
Bend, OR 97702
Phone: 541.728.0375
www.BCA-Architect.com

ISSUES / REVISIONS

MP2.2B

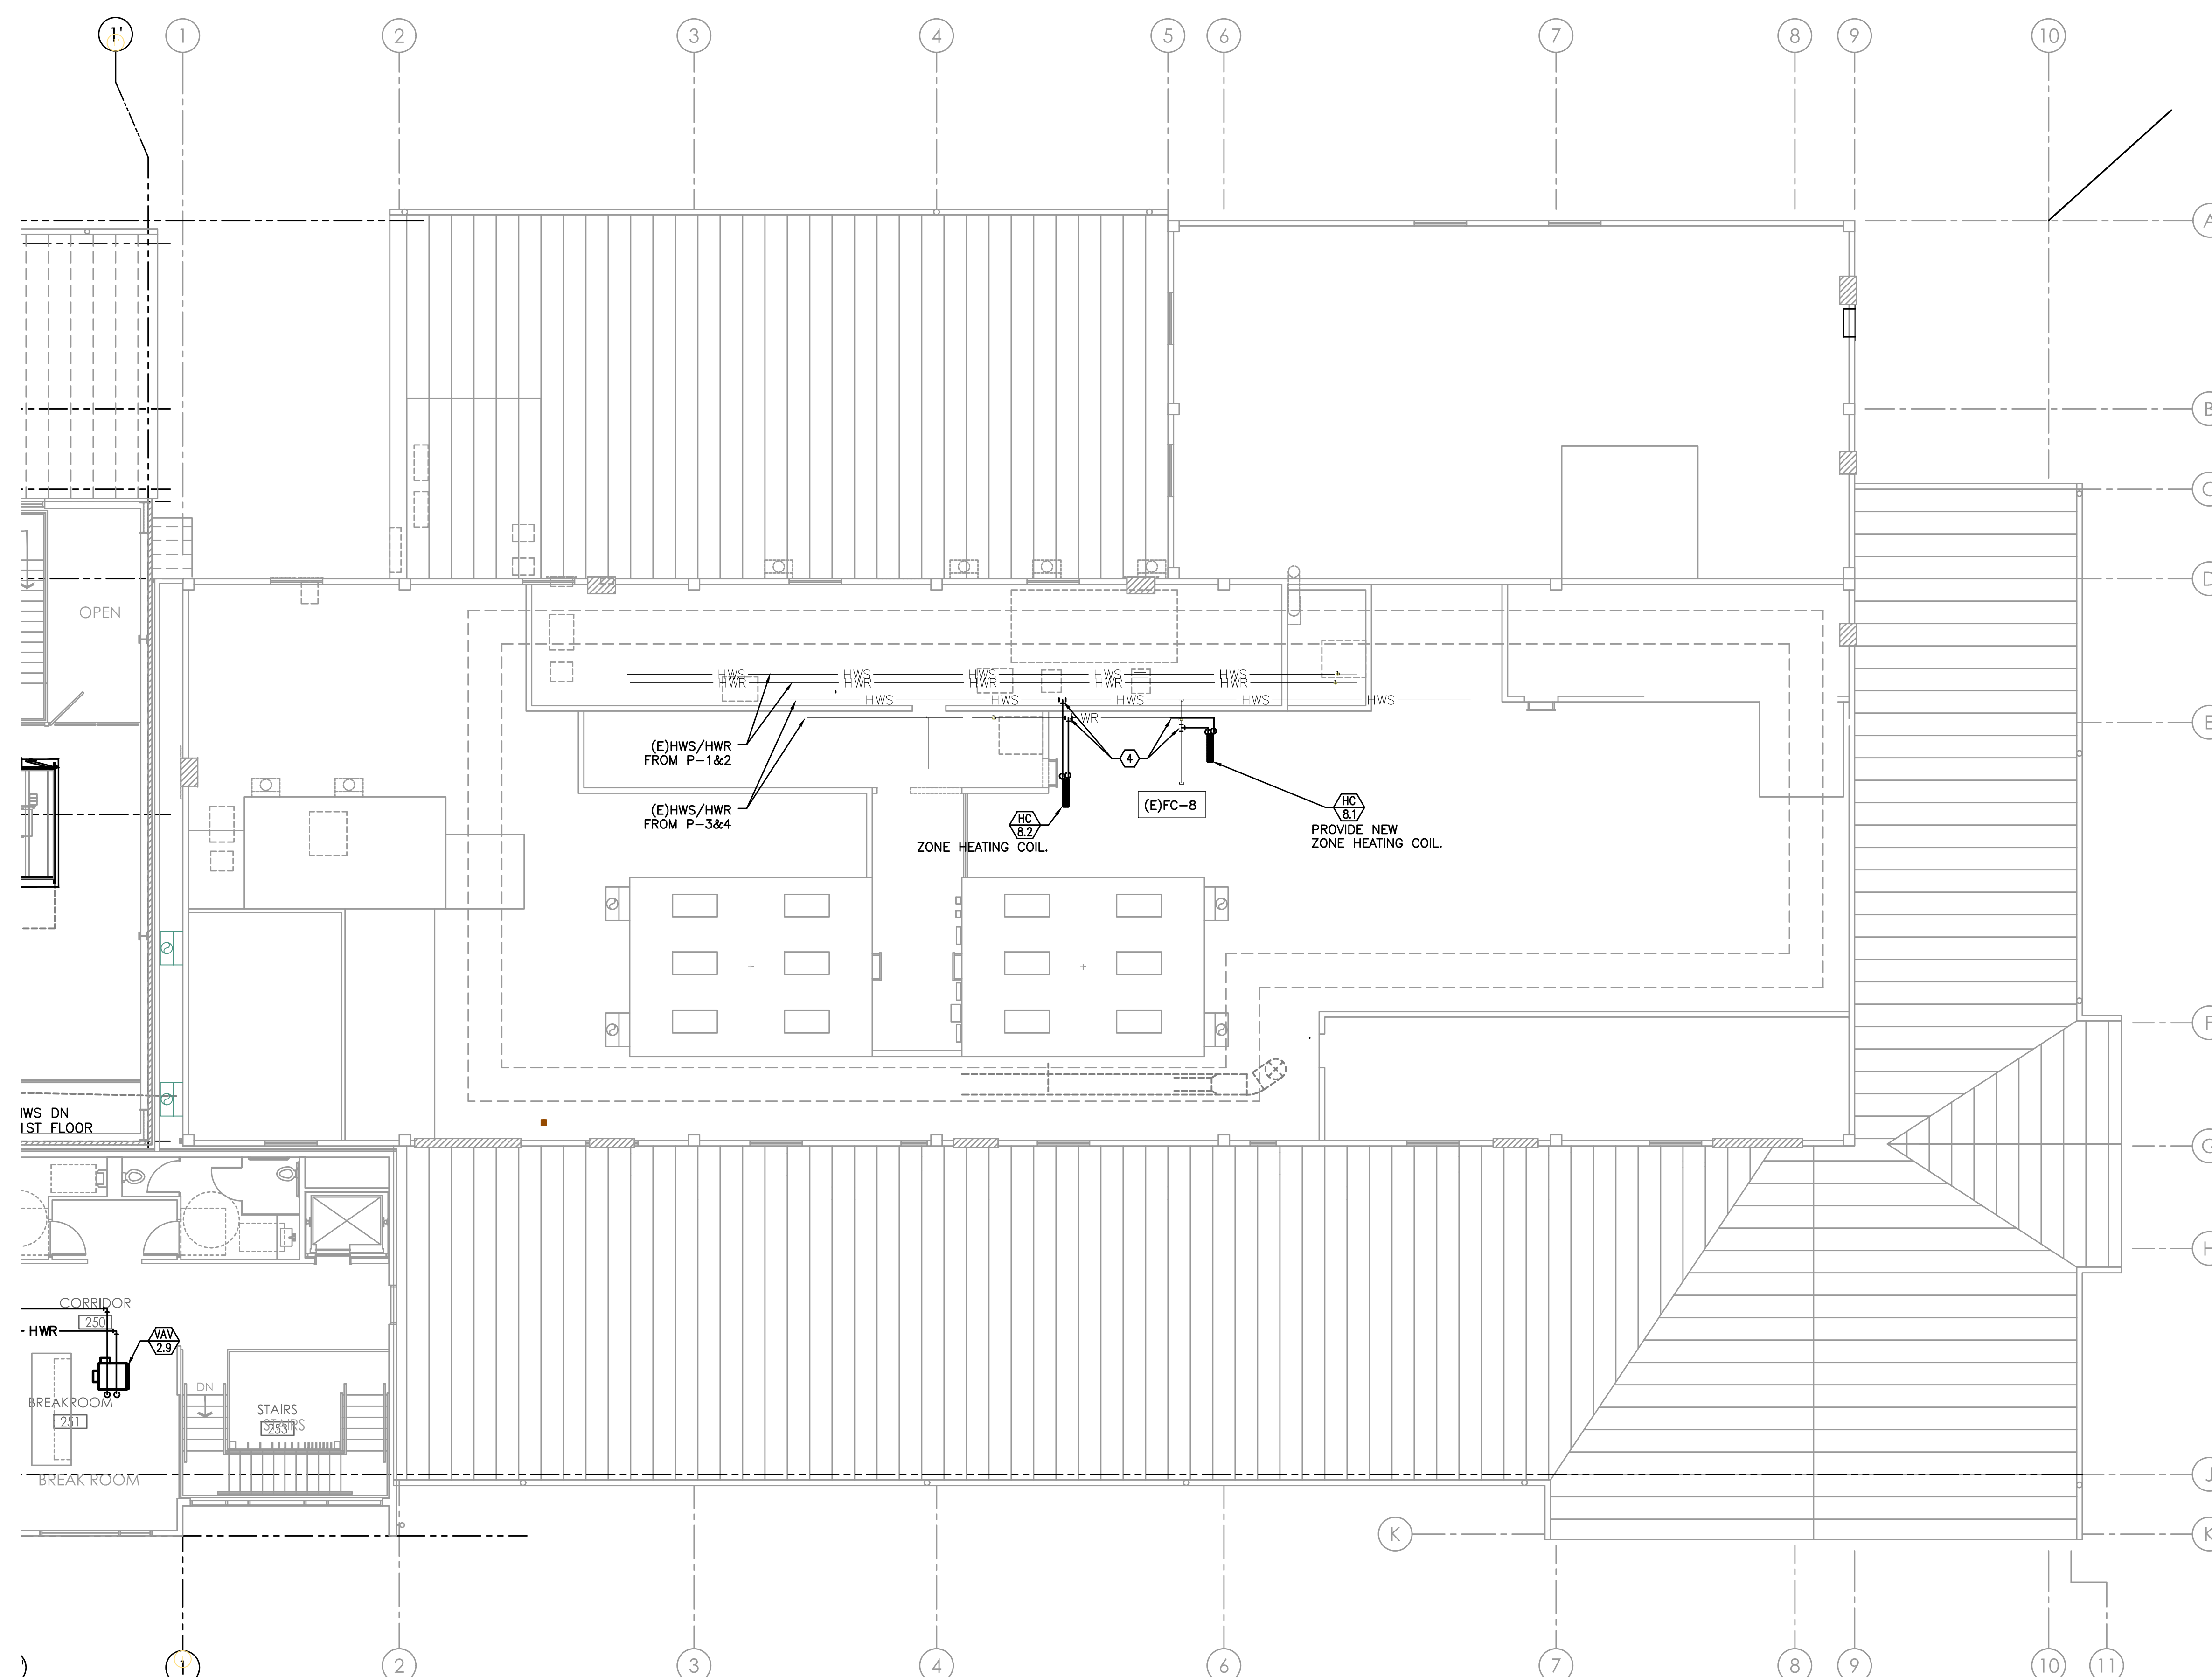

KEYED NOTES:

1. FUTURE VAV BOX.
2. 3/4" HWS/HWR CAPPED WITH SHUT-OFF VALVE FOR FUTURE.
3. 1-1/4" HWS/HWR CAPPED WITH SHUT-OFF VALVE FOR FUTURE.
4. CONNECT (N) 3/4" HWS/HWR TO (E) MAINS.
5. T/A SERIES BALANCE VALVE. SEE PIPING SCHEMATIC ON SHEET MP3.0 FOR GPM SETTING.
6. T/A SERIES 794 DIFFERENTIAL PRESSURE CONTROLLER.

MECHANICAL PIPING SECOND FLOOR PLAN — EXISTING BUILDING