MPA INC.
Consulting Engineers
2007 S.E. Ash St.
Portland, OR 97214
PHN: (503) 234-0548
FAX: (503) 234-0677
WWW.MPA-ENG.COM
CONTACT: TAKAKO BAKER

PLAN REVIEW APPROVAL STAMP

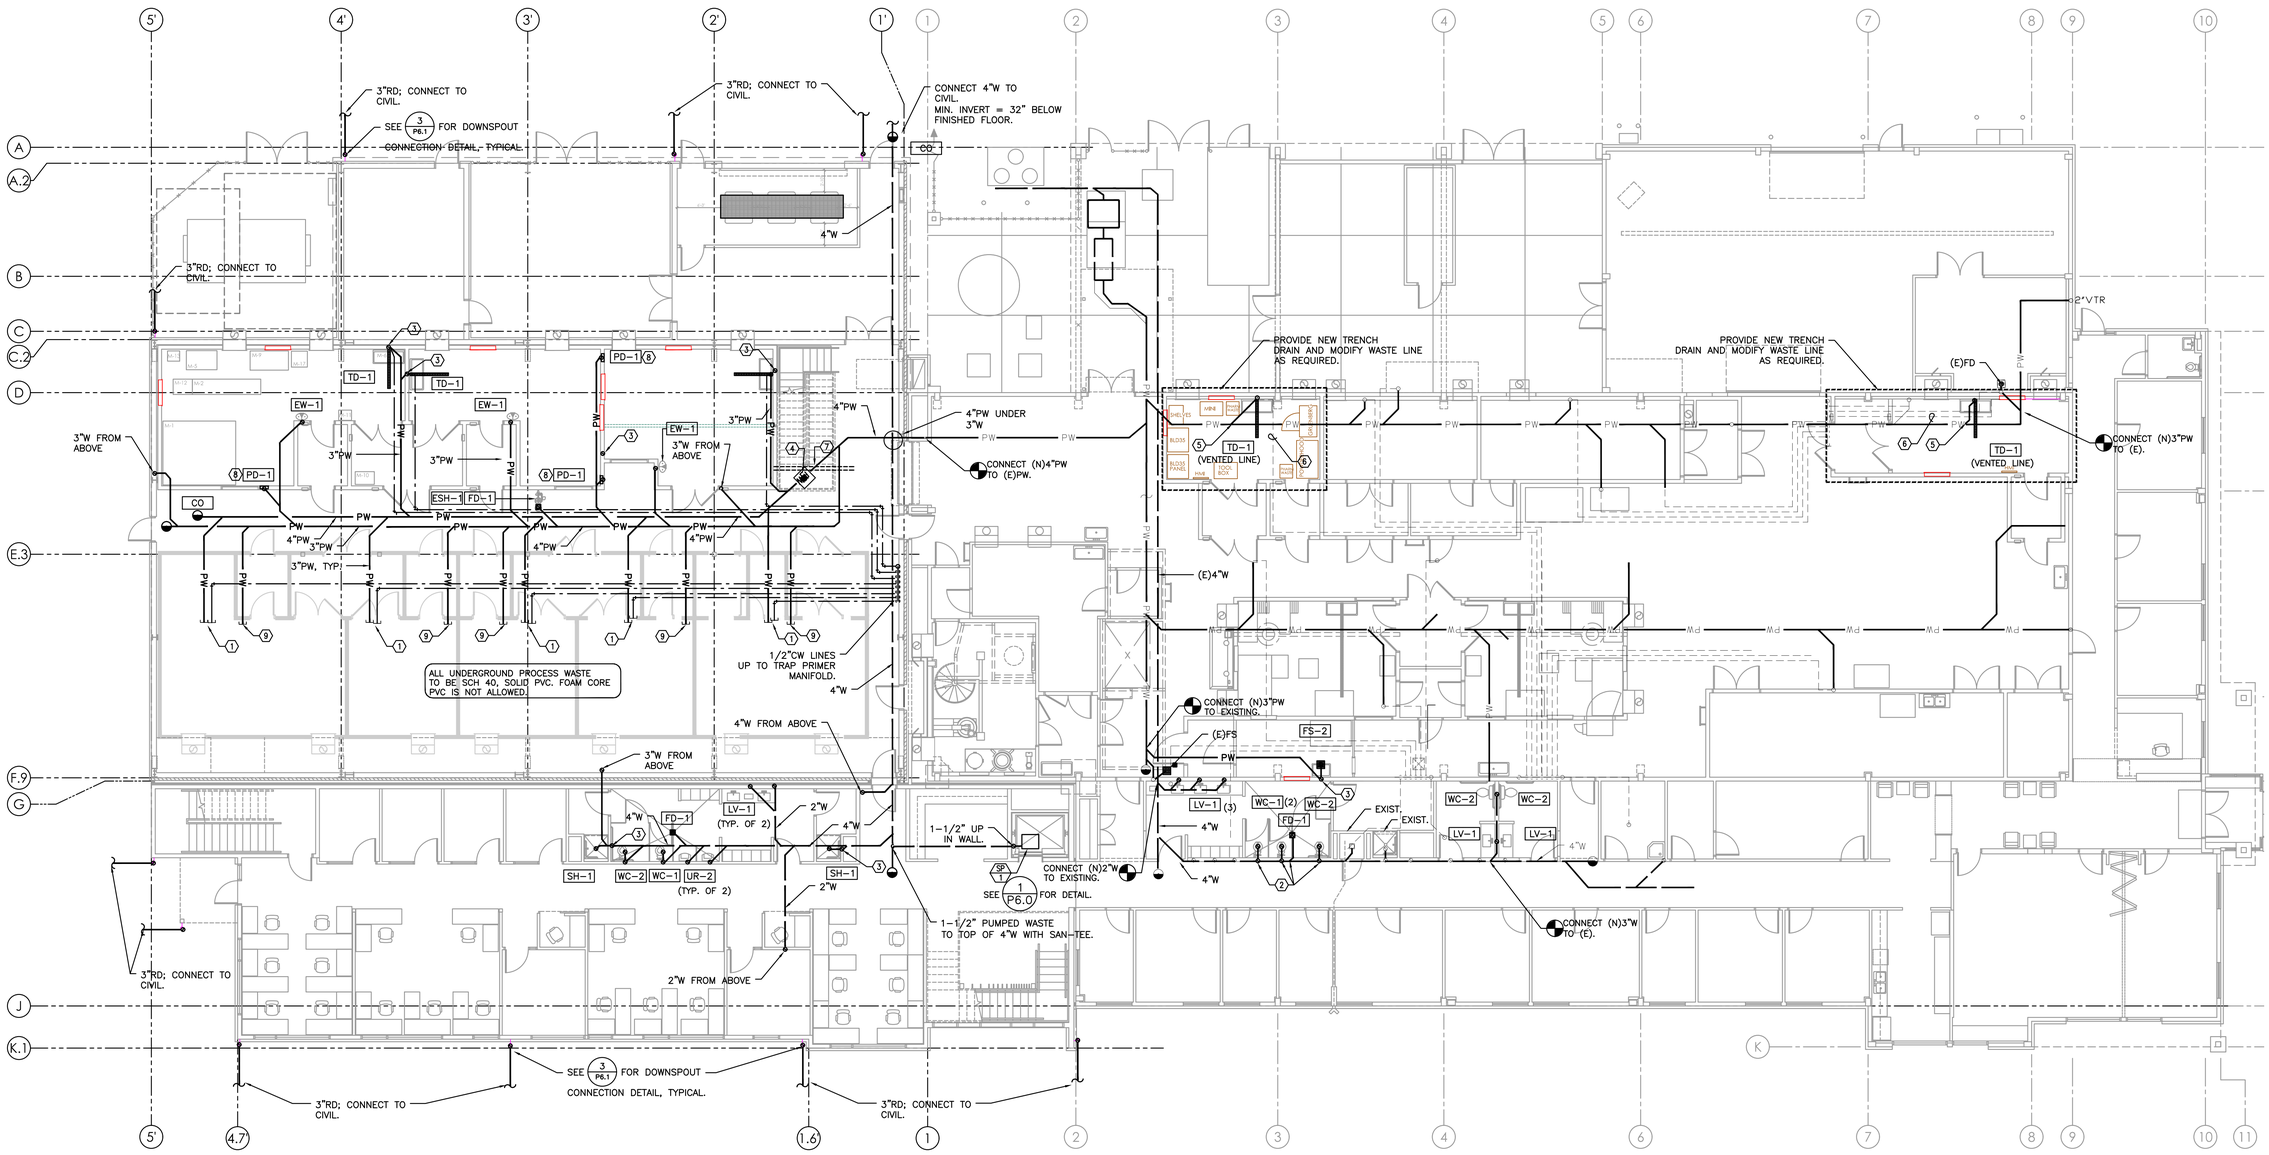

BEND RESEARCH, INC
CORPORATE PLACE FACILITY - BUILDING EXPANSION NORTH

1 / P1.0 UNDERSLAB PLUMBING PLAN
1/8"=1'-0"

KEYED NOTES:

1. 1/2" PRIMER LINE AND 3" PW STUBBED OUT FOR FUTURE SUITES.
2. CONNECT 3"W TO EXISTING.
3. 1-1/2"V UP IN WALL.
4. 4" NORMALLY CLOSED, PVC ELECTRIC SHUT-OFF VALVE IN VALVE BOX WITH COVER. SEE 1/P6.1 FOR DETAIL.
5. CONNECT (N)4"PW TO (E)4"PW VENTED LINE.
6. CONNECT (E)1/2"PRIMER LINE TO NEW TRAP LOCATION
7. PROVIDE 2" PVC SLEEVE FOR CONTROL WIRING FROM ACTUATOR TO VALVE CONTROL STATION.
8. PD-1 PROCESS DRAIN, INSTALL BOTTOM OF FIXTURE AT 3" ABOVE FINISHED FLOOR.
9. 2" PW STUBBED OUT FOR FUTURE PROCESS DRAIN AND EYE-WASH.

BCA
BLAISE CACCIOLA
ARCHITECT
1465 SW Knoll Avenue, Suite 250
Bend, OR 97702
Phone: 541.728.0375
www.BCA-Architect.com

DRAWN/ CHECKED: TB

ISSUES / REVISIONS:

UNDERSLAB PLUMBING PLAN

P1.0