
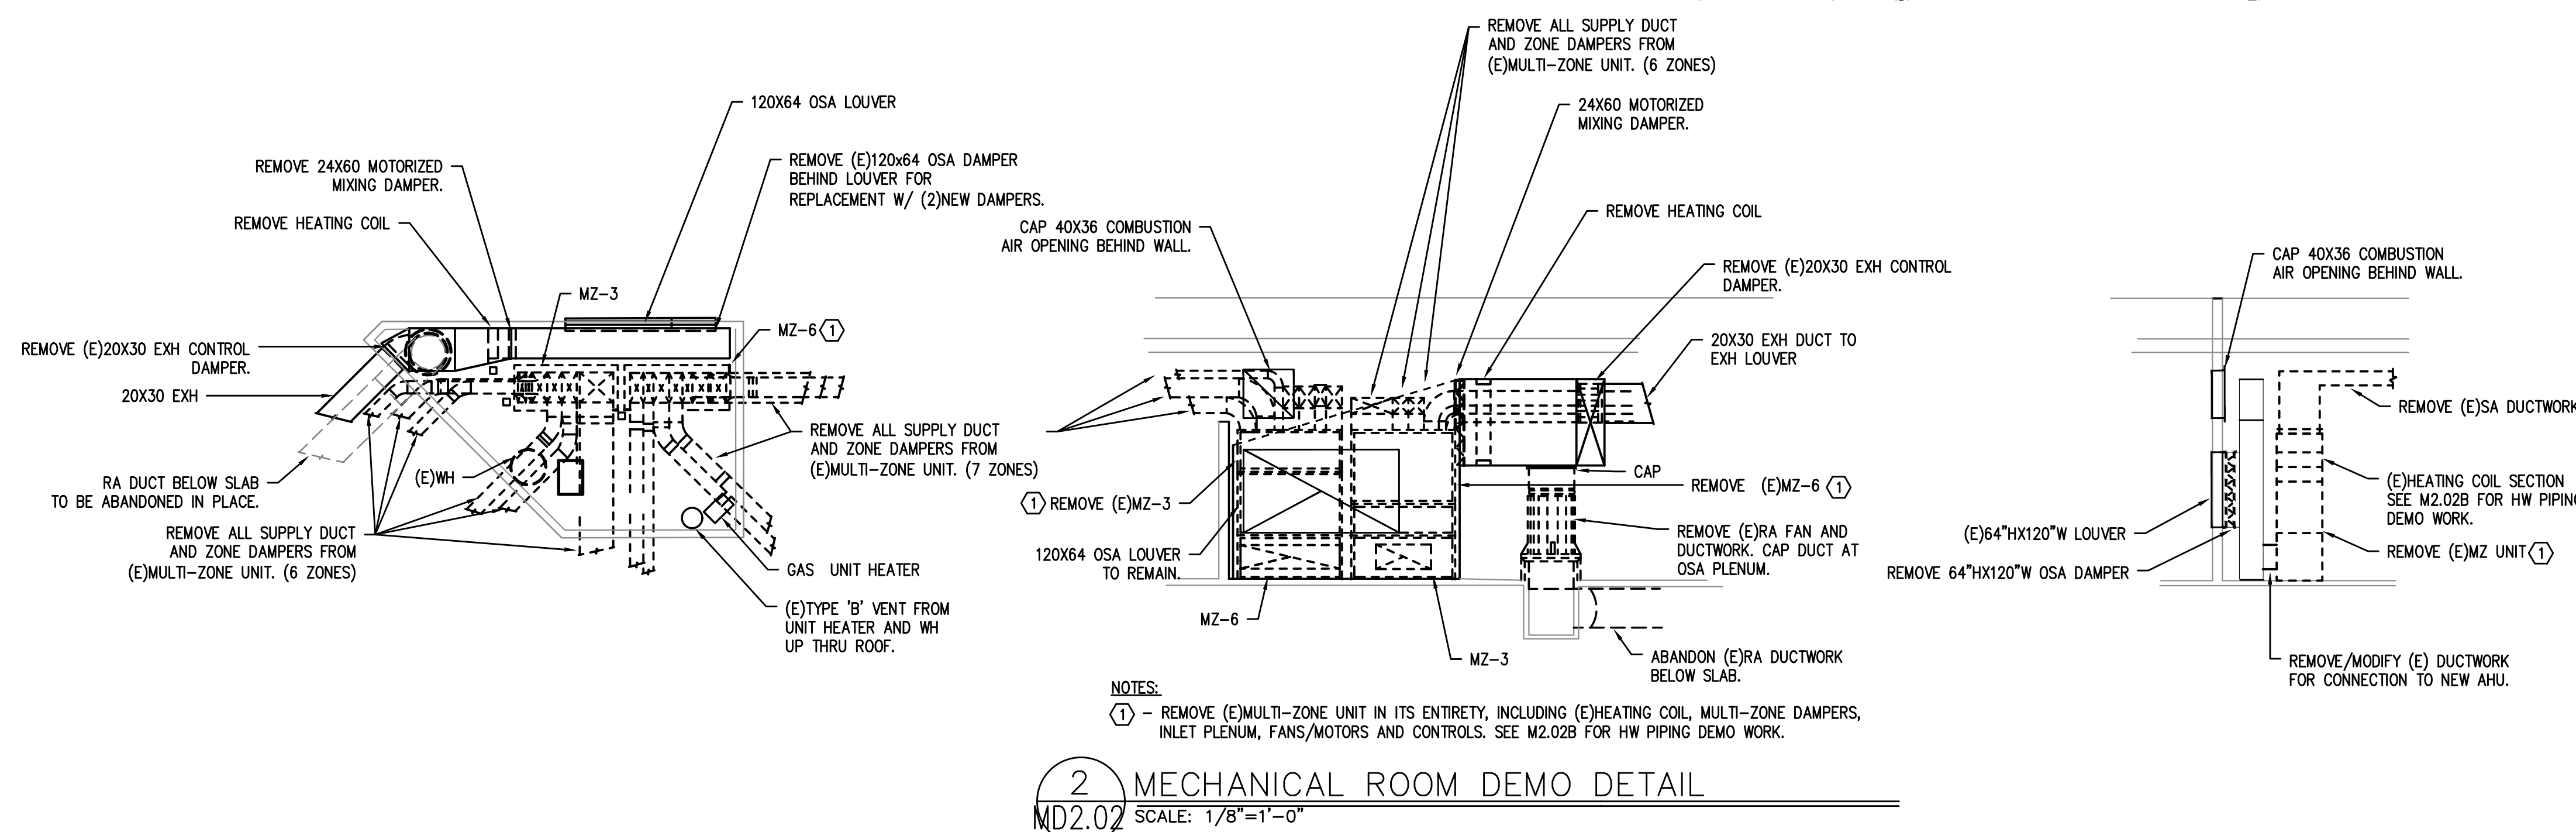


City Of Bend Approval Stamp

KEYED NOTES:

1. REMOVE LOW RA GRILLE AT CABINET AND CAP OFF DUCT BELOW FLOOR. COORDINATE FLOOR PATCH WITH ARCHITECT.
2. REMOVE (E) T-SHAT AND PATCH WALL. COORDINATE WALL PATCH WITH ARCHITECT.
3. REMOVE (E)GRILLE/DIFFUSER.
4. REMOVE (E)ELF GRILLE AND DUCT UP THRU ROOF. CAP CURB AT ROOF.
5. REMOVE (E)RELJEF GRILLE AND DUCT. RETAIN (E)RELJEF HOOD ON ROOF FOR NEW CONNECTION.
6. CAP OFF RA DUCT ABOVE CEILING OUTSIDE OF CHASE. ABANDON RA DUCT DOWN IN PLAM IN CHASE.
7. REMOVE (E)THRU THE WINDOW AC.
8. COORDINATE WALL PATCH WITH ARCH.
9. REMOVE (E)EXH FAN. E-12.

SHEET NOTES:
1. ASBESTOS ABATEMENT CONTRACTOR TO REMOVE ALL DUCTWORK OUTSIDE OF MECHANICAL ROOM..

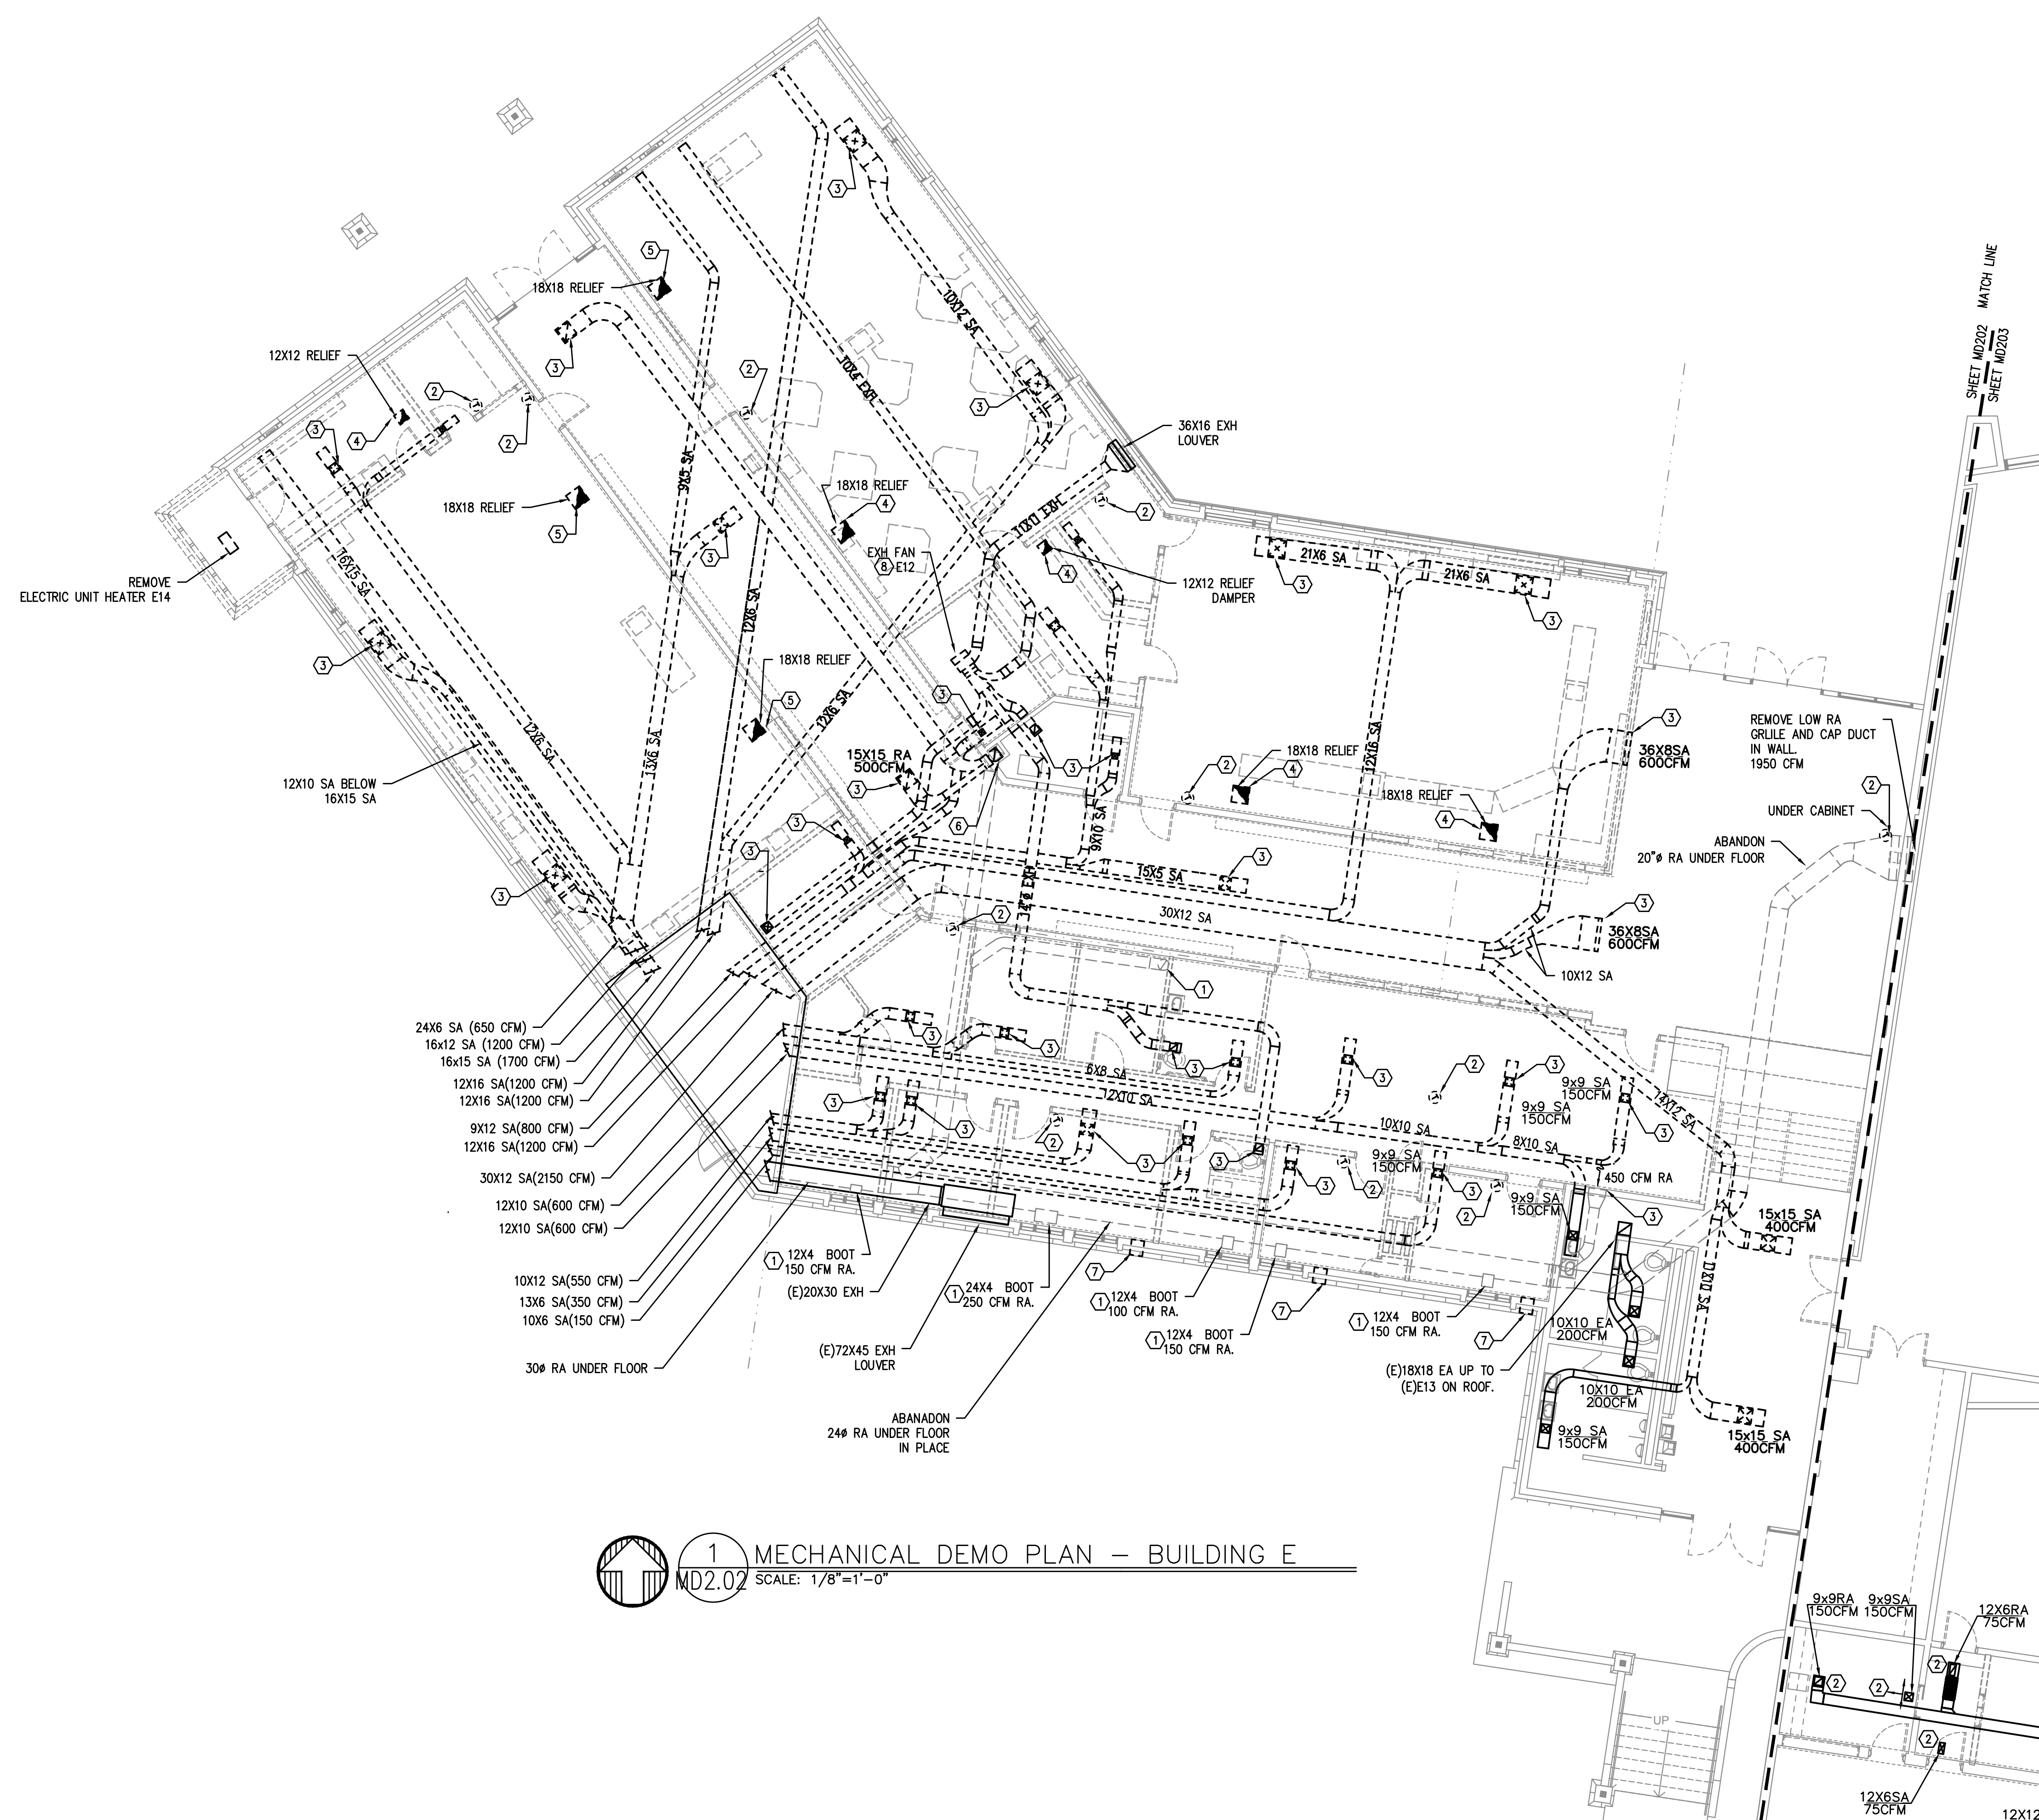

#	Date	Description
Revision Schedule		

PERMIT SET

**PILOT BUTTE MIDDLE
SCHOOL - BLDGS E&F**

1501 NE Neff Road,
Bend OR 97701

BLRB architects

Drawing Title:

MECHANICAL DEMO
PLAN - BUILDING E

Date :	02.09.2018	Drawn By :	INITIAL
--------	------------	------------	---------

Revised Date :	Project No.
----------------	-------------

Stamp	Sheet No.
-------	-----------

MFI Consulting Engineers
2007 S.E. Ash St.
Portland, OR 97214
PHN: (503) 234-0544
FAX: (503) 234-0677
INC. WWW.MFI-ENG.COM
CONTACT: TAKAKO BAKER

REGISTERED PROFESSIONAL
ENGINEER
17882
OREGON
JULY 25, 1995
SCOTT W. MILLER
EXPIRES: 31DEC18

MD2.02