




1 RTU-1 & 2 W/ VIBRATION ISOLATION CURB  
M6.02 SCALE: DETAIL

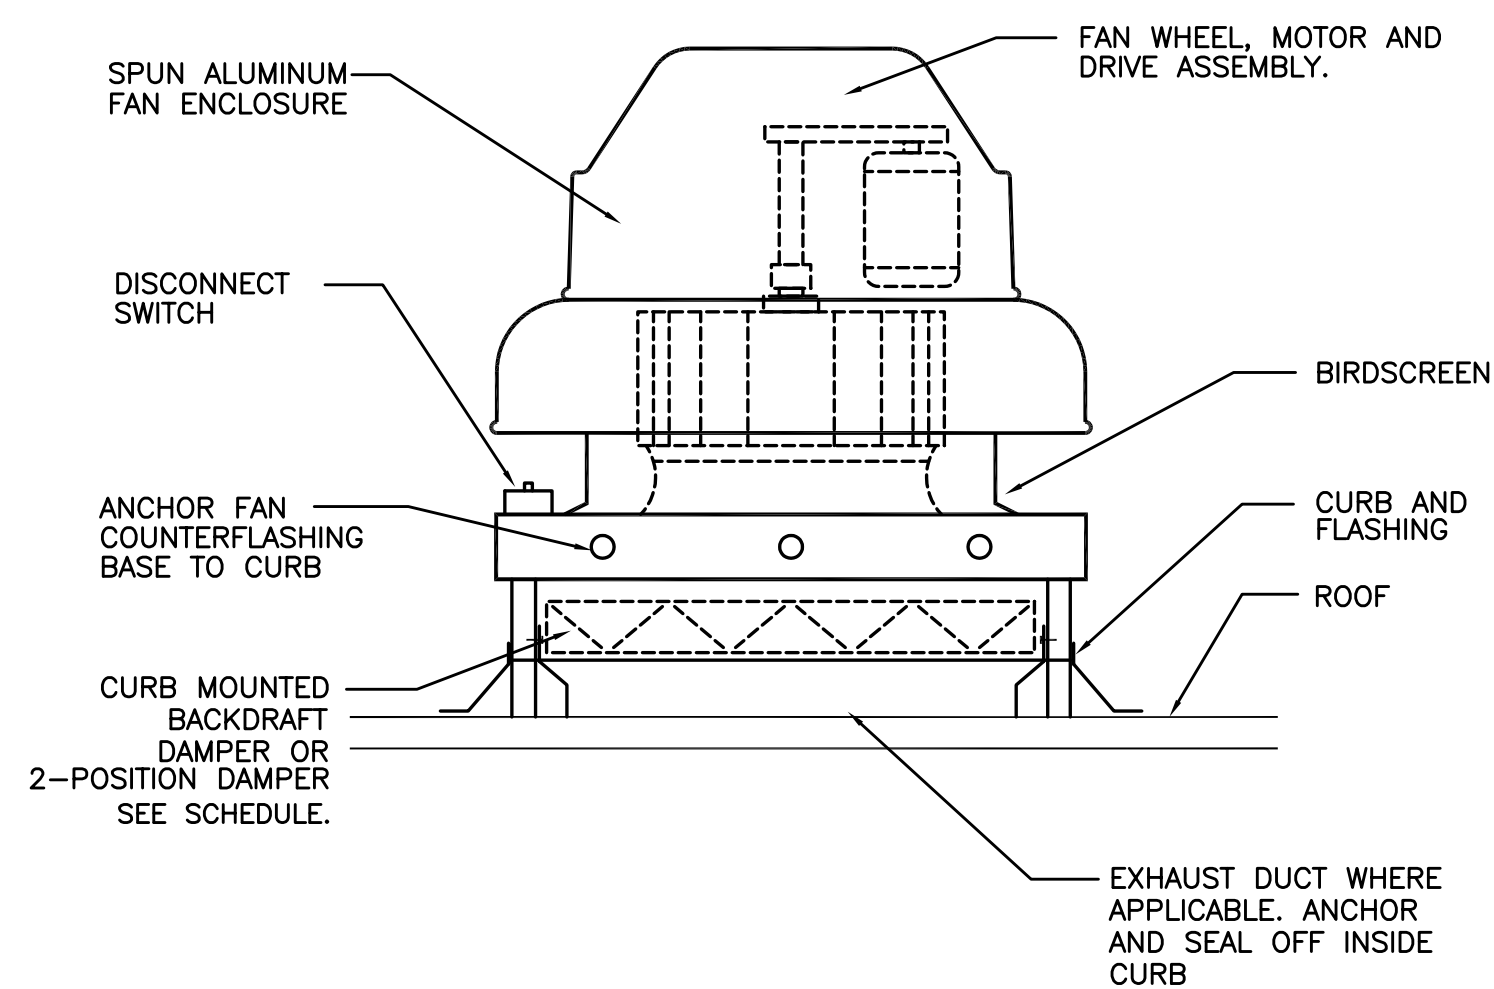


3 EXHAUST FAN  
M6.02 DETAIL

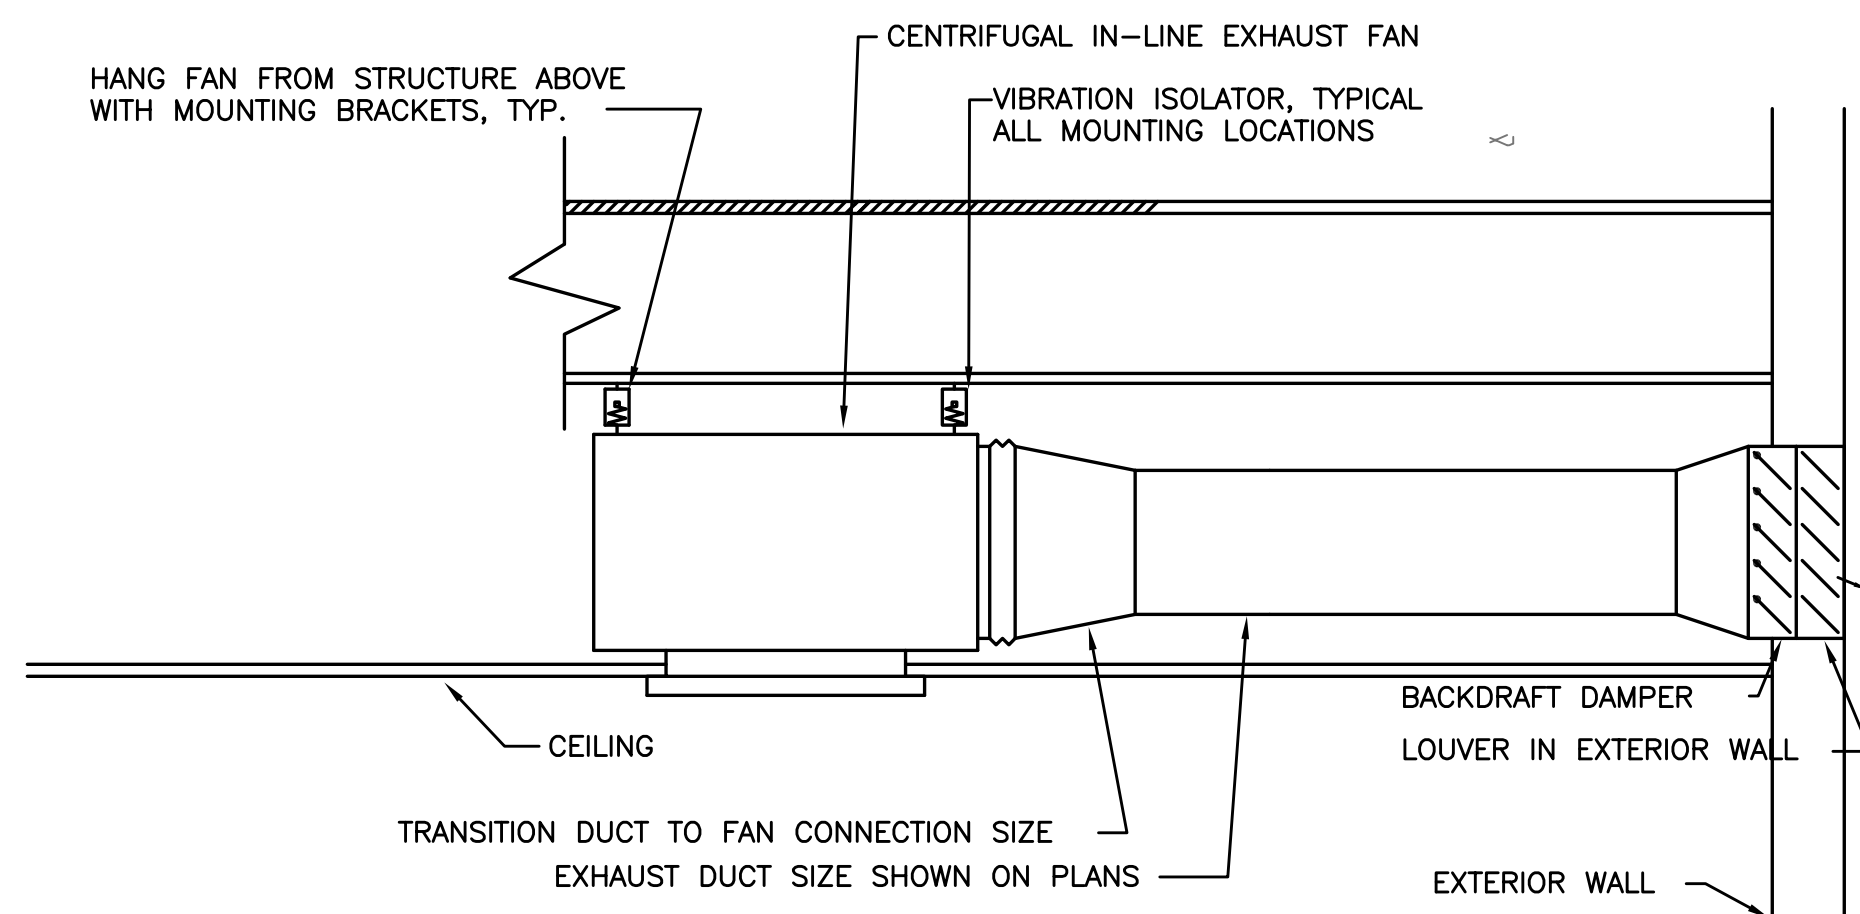

6 RESTROOM EXHAUST FAN  
M6.02 SCALE:DETAIL

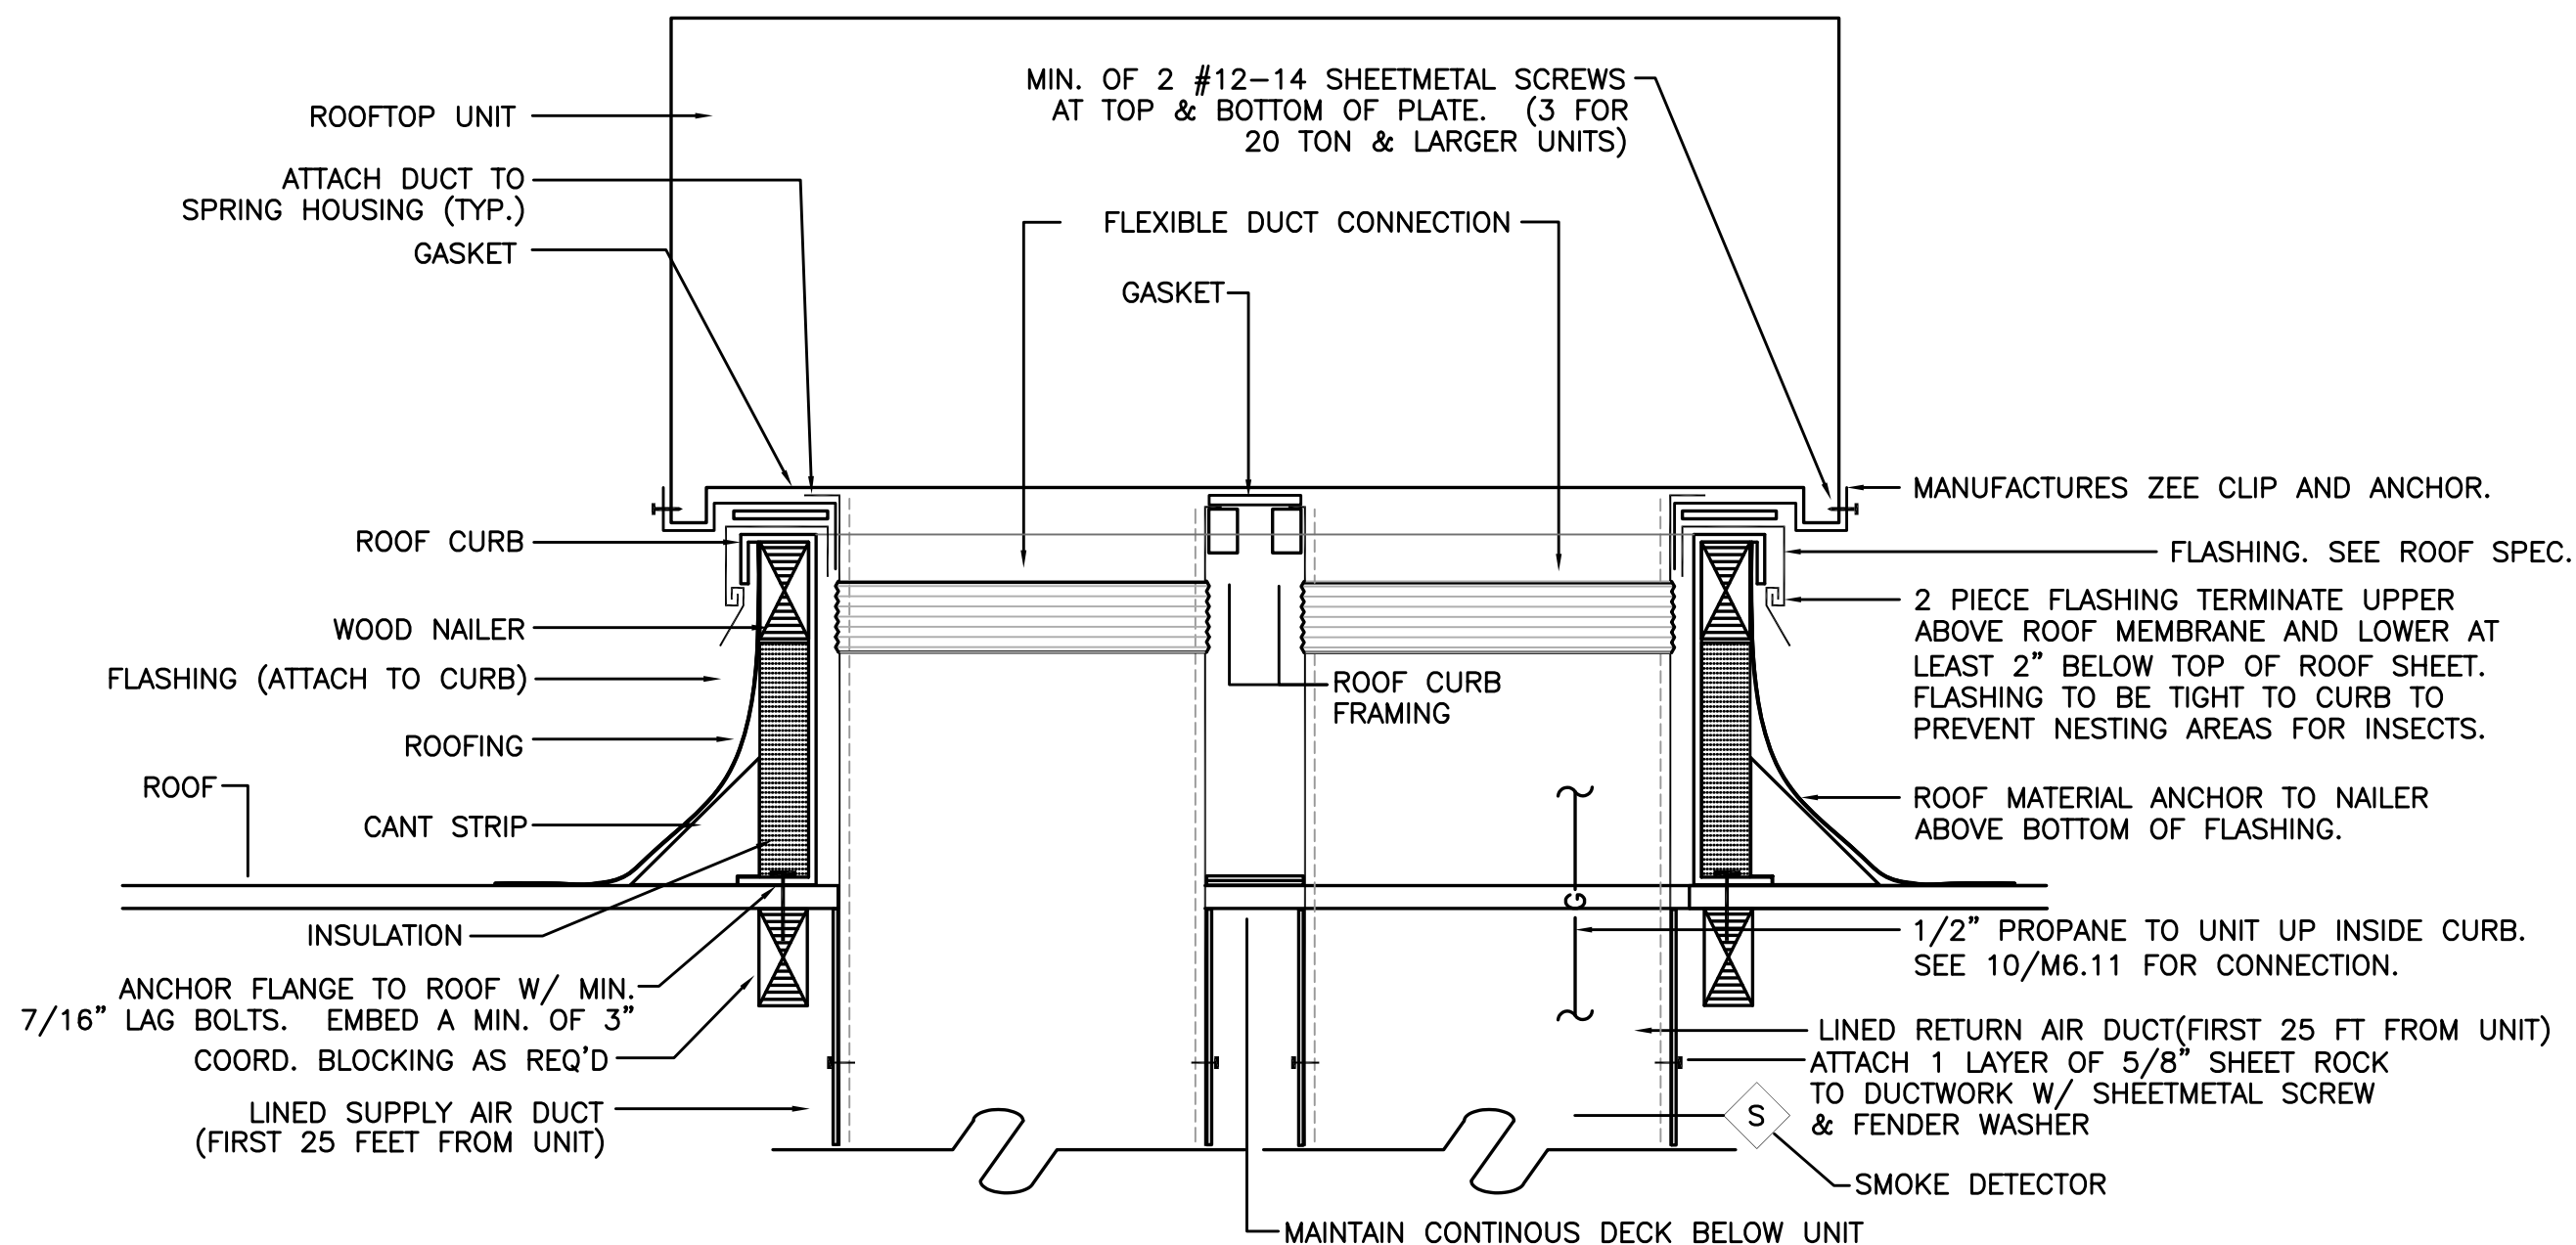


2 RTU-3 & 4 W/ CURB  
M6.02 SCALE: DETAIL

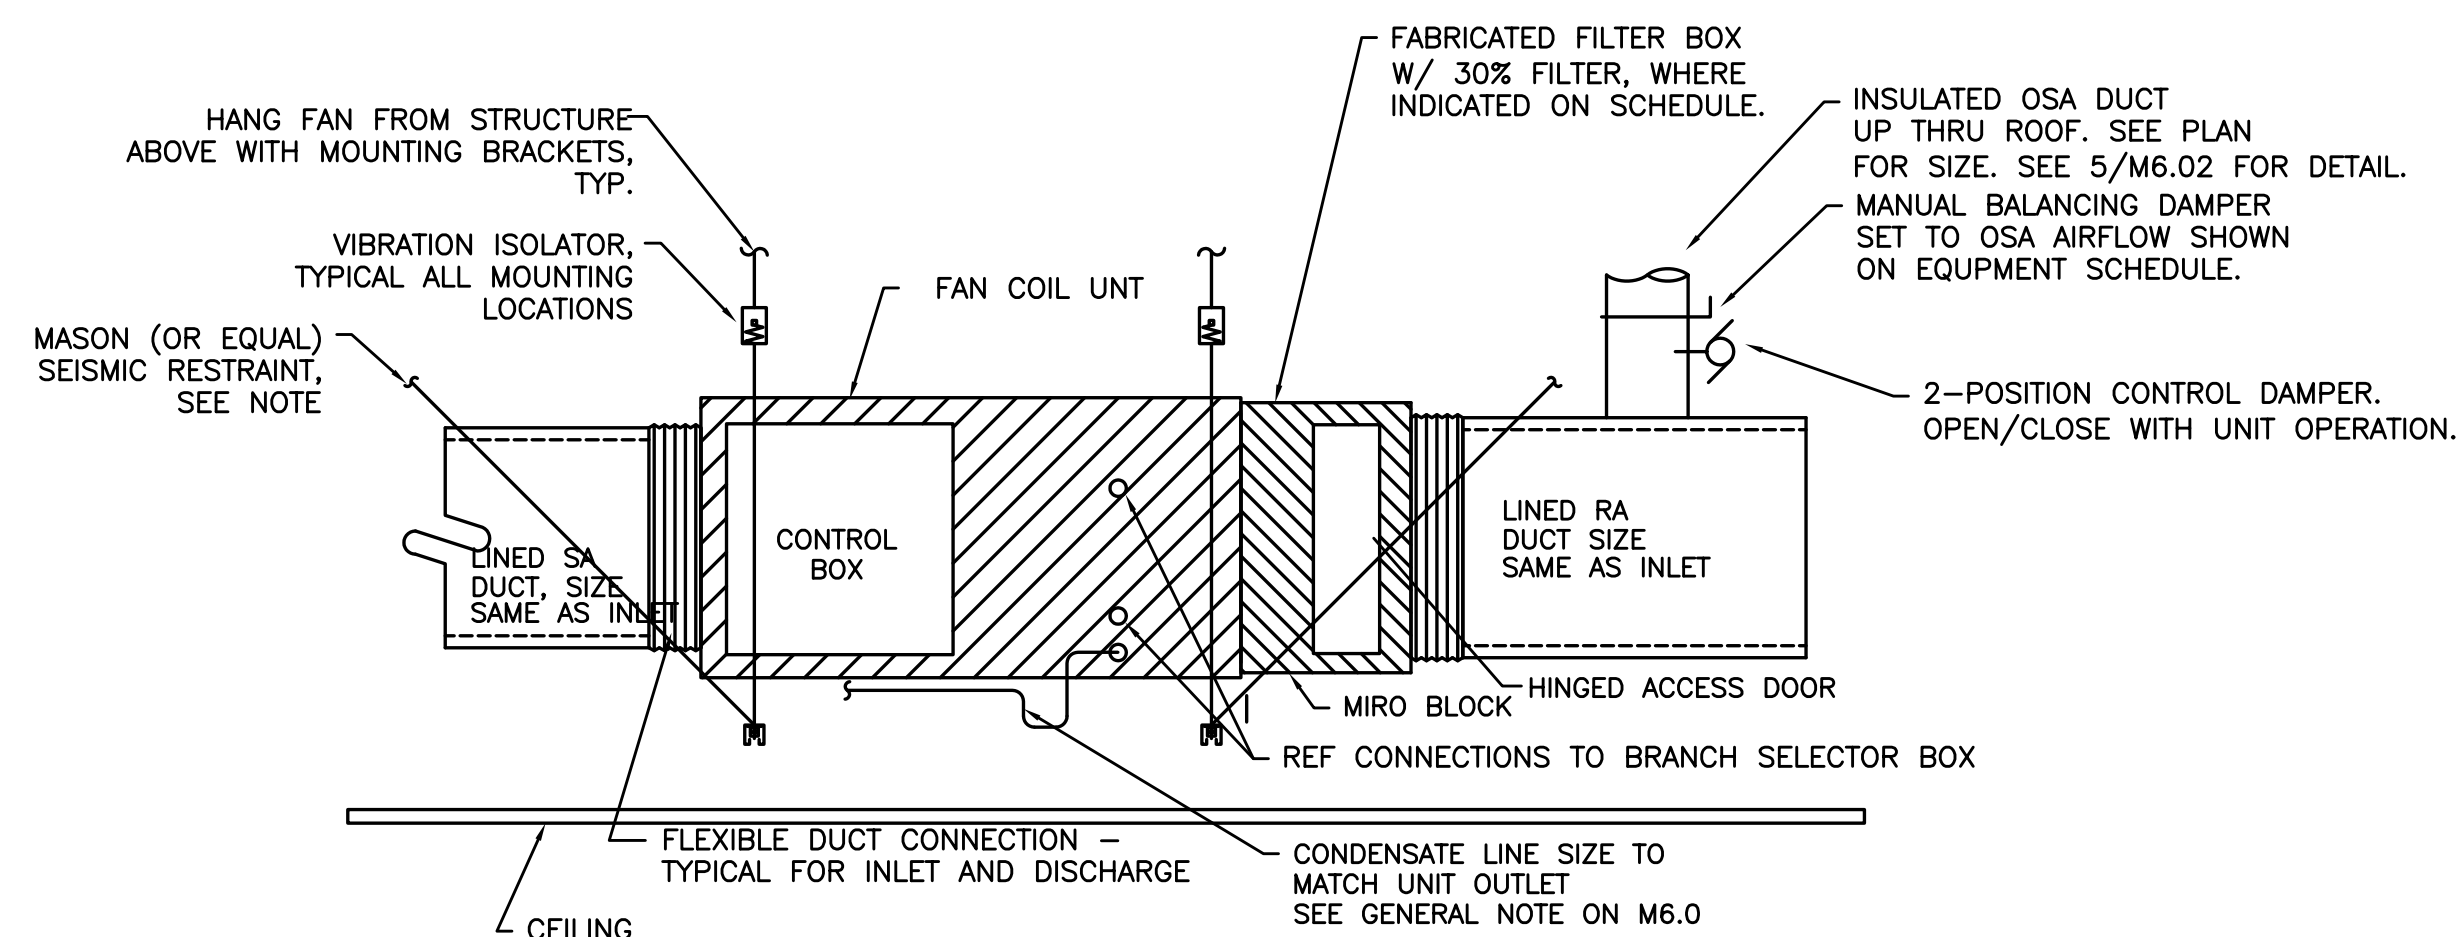


NOTE: LOCATE SUPPORT & SIESMIC TO MAINTAIN UNHINDERED ACCESS FOR MAINTENANCE OF UNIT.


4 DUCTED FAN COIL (IHP)  
M6.02 SCALE: DETAIL

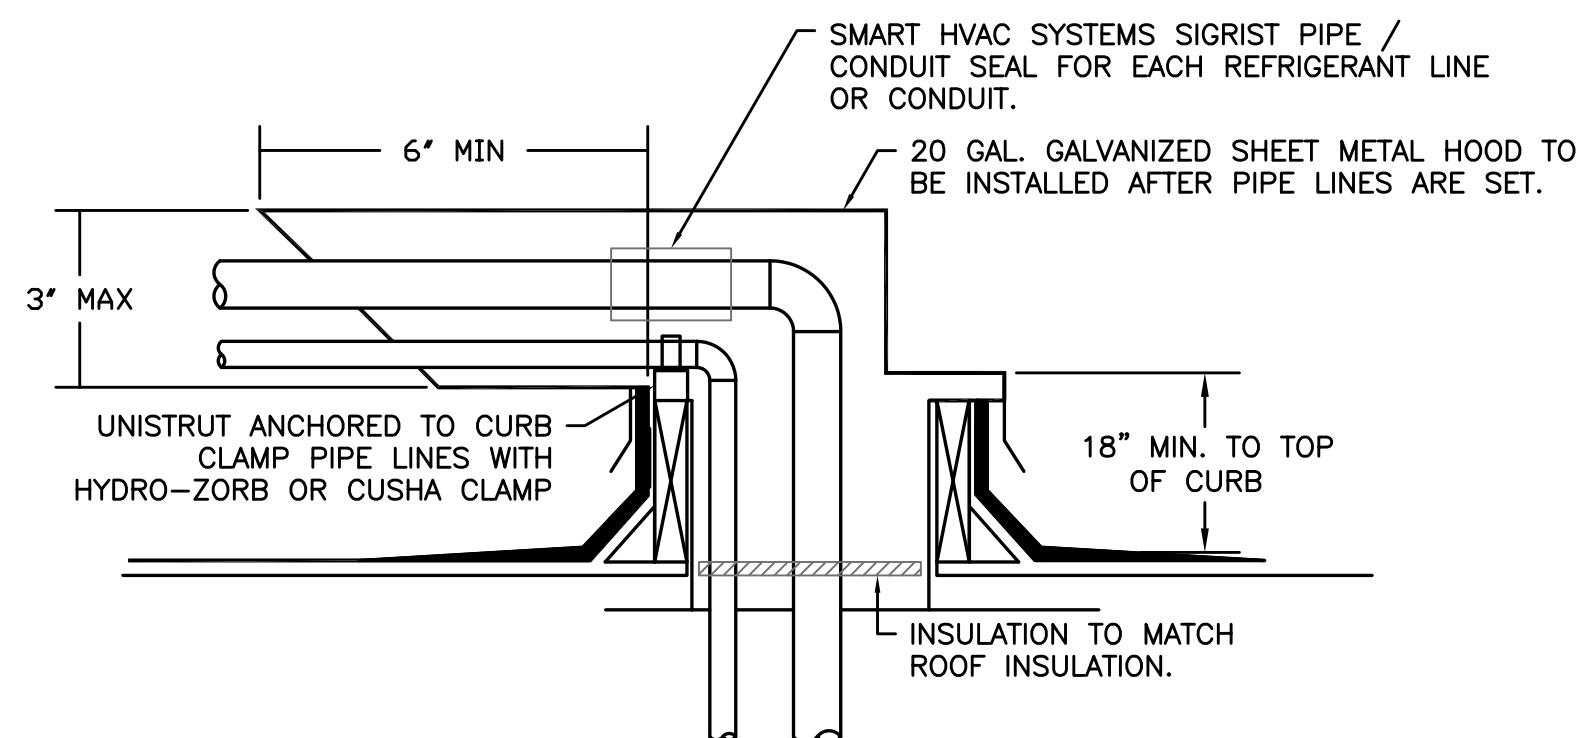


8 PIPE HOOD DETAIL  
M6.02 SCALE: DETAIL

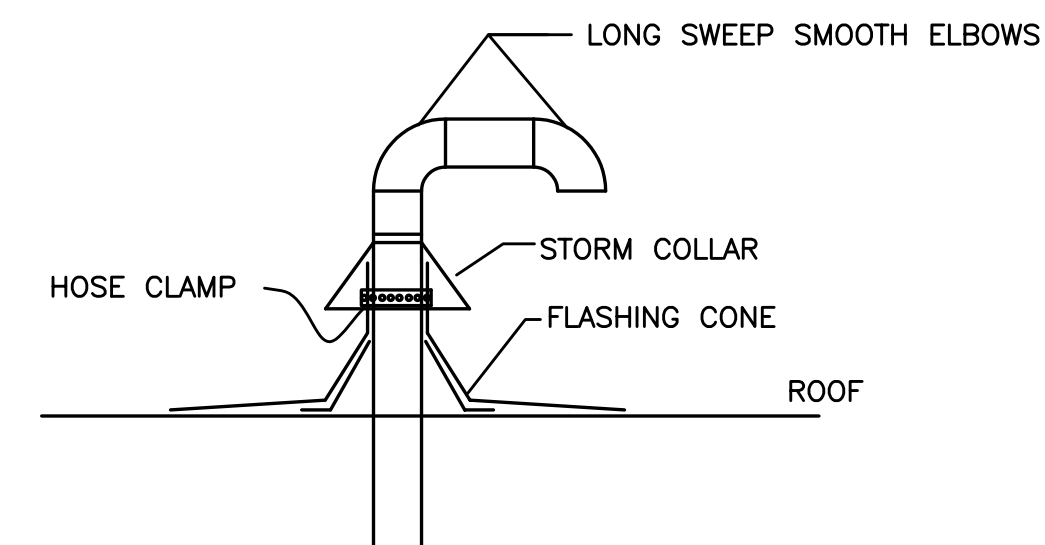

5 OSA INTAKE THRU ROOF  
M6.02 DETAIL

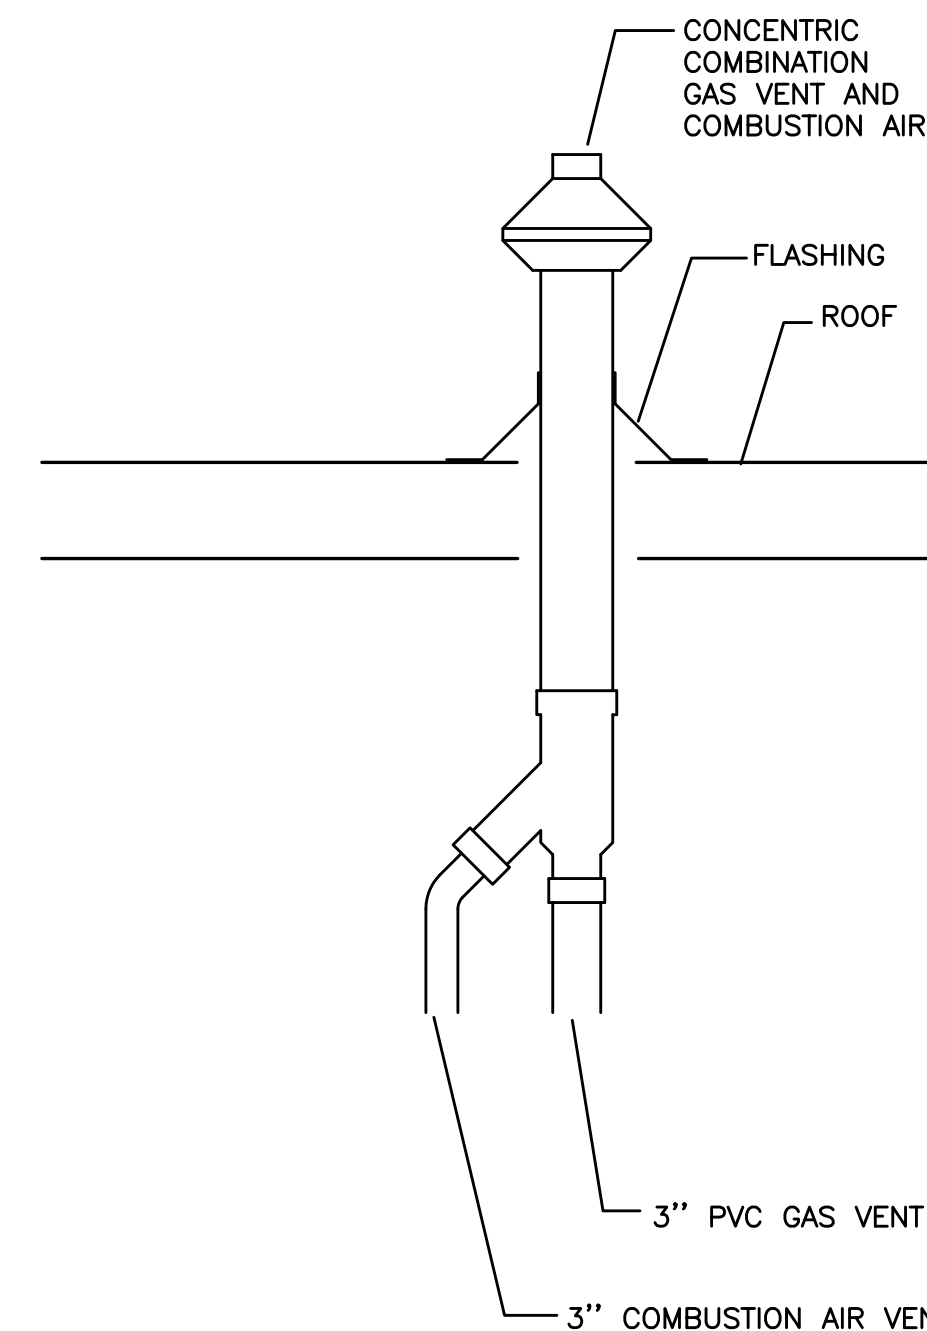

7 CONCENTRIC GAS VENT  
M6.02 SCALE:DETAIL

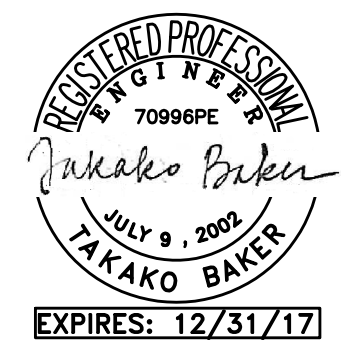

**BBT**  
ARCHITECTS

1160 sw Simpson Ave. - Suite 100 - Bend, Oregon 97702  
1.541.382.5535 | 1.541.389.8033

**MFA** Consulting Engineers  
2007 S.E. Ash St.  
Portland, OR 97214  
PHN: (503) 234-0548  
FAX: (503) 234-0877  
E.C. WWW.MFIA-ENG.COM  
CONTACT: TAKAKO BAKER

WARM SPRINGS TRAVEL CENTER

Madras, OR

No.	Description	Date
1	Owner/CMGC Revisions	10/19/2016

Project Number 1519  
Date OCT. 19, 2016  
Drawn By TB  
Checked By JVB

MECHANICAL  
DETAILS

BID SET

M6.02