


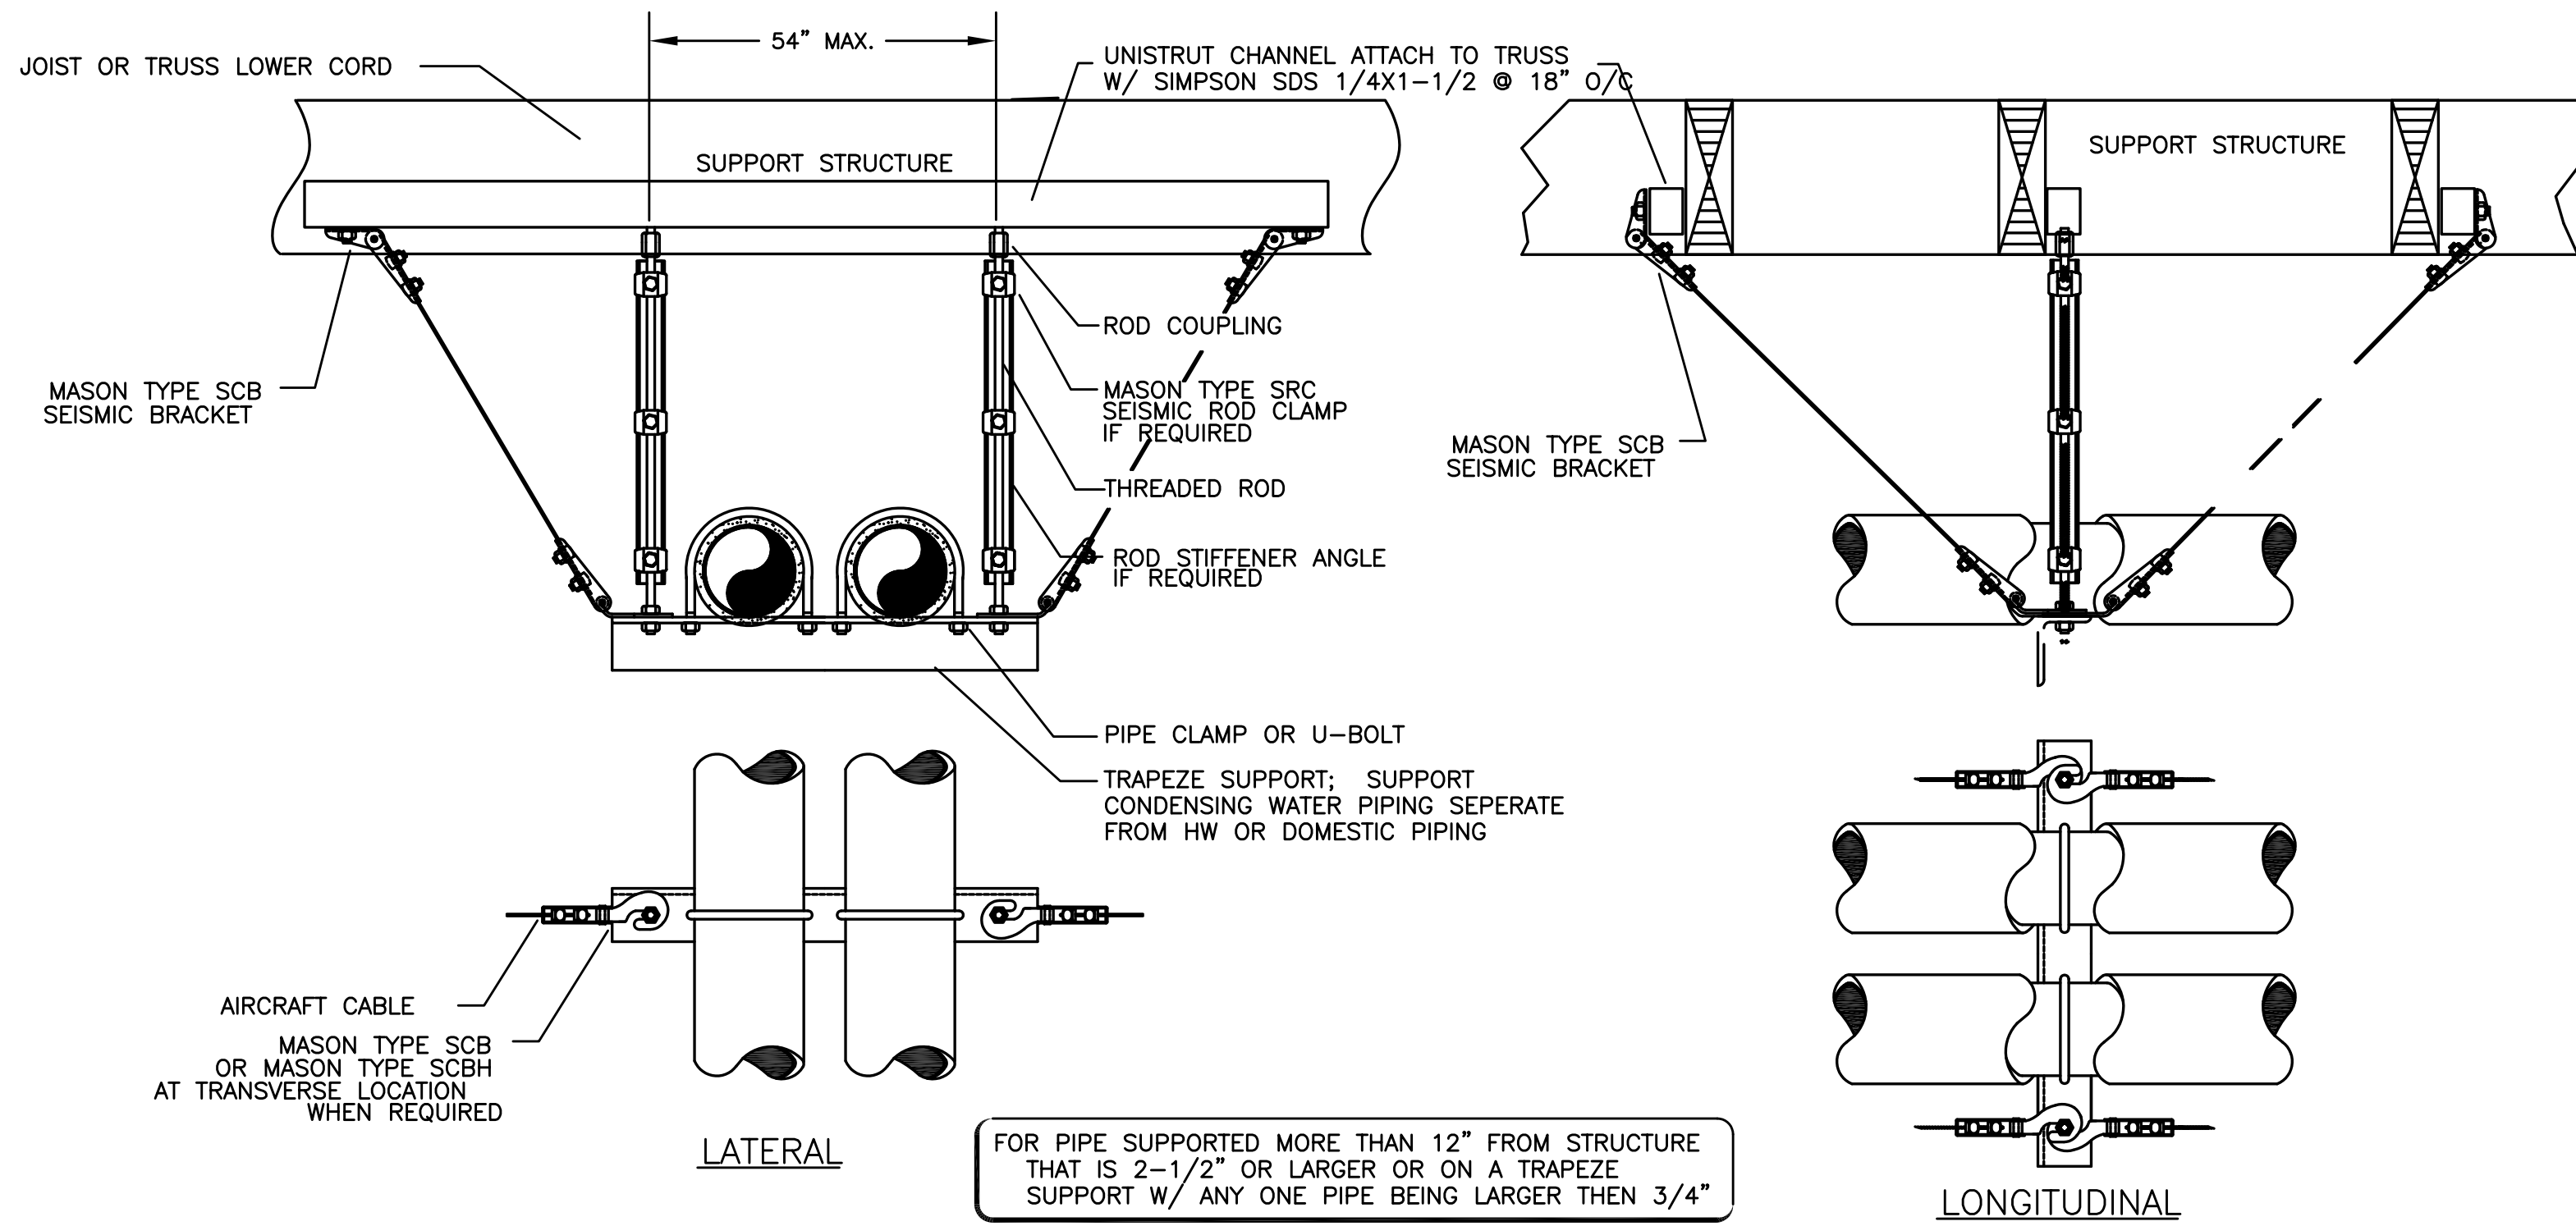

FOR PIPE SUPPORTED MORE THAN 12\"/>



NOTE: MATERIALS BASED ON MASON INDUSTRIES. SIZE MATERIALS BASED ON APPLICATION & MANUFACTURER REQUIREMENT.

1 SEISMIC PIPE SUPPORT
SCALE: DETAIL


2/P6.02 NOTES

1 - 1/4\"/>

* - MAXIMUM HANGER SPACING SHALL BE AS FOLLOWS:
1-1/4\"/>

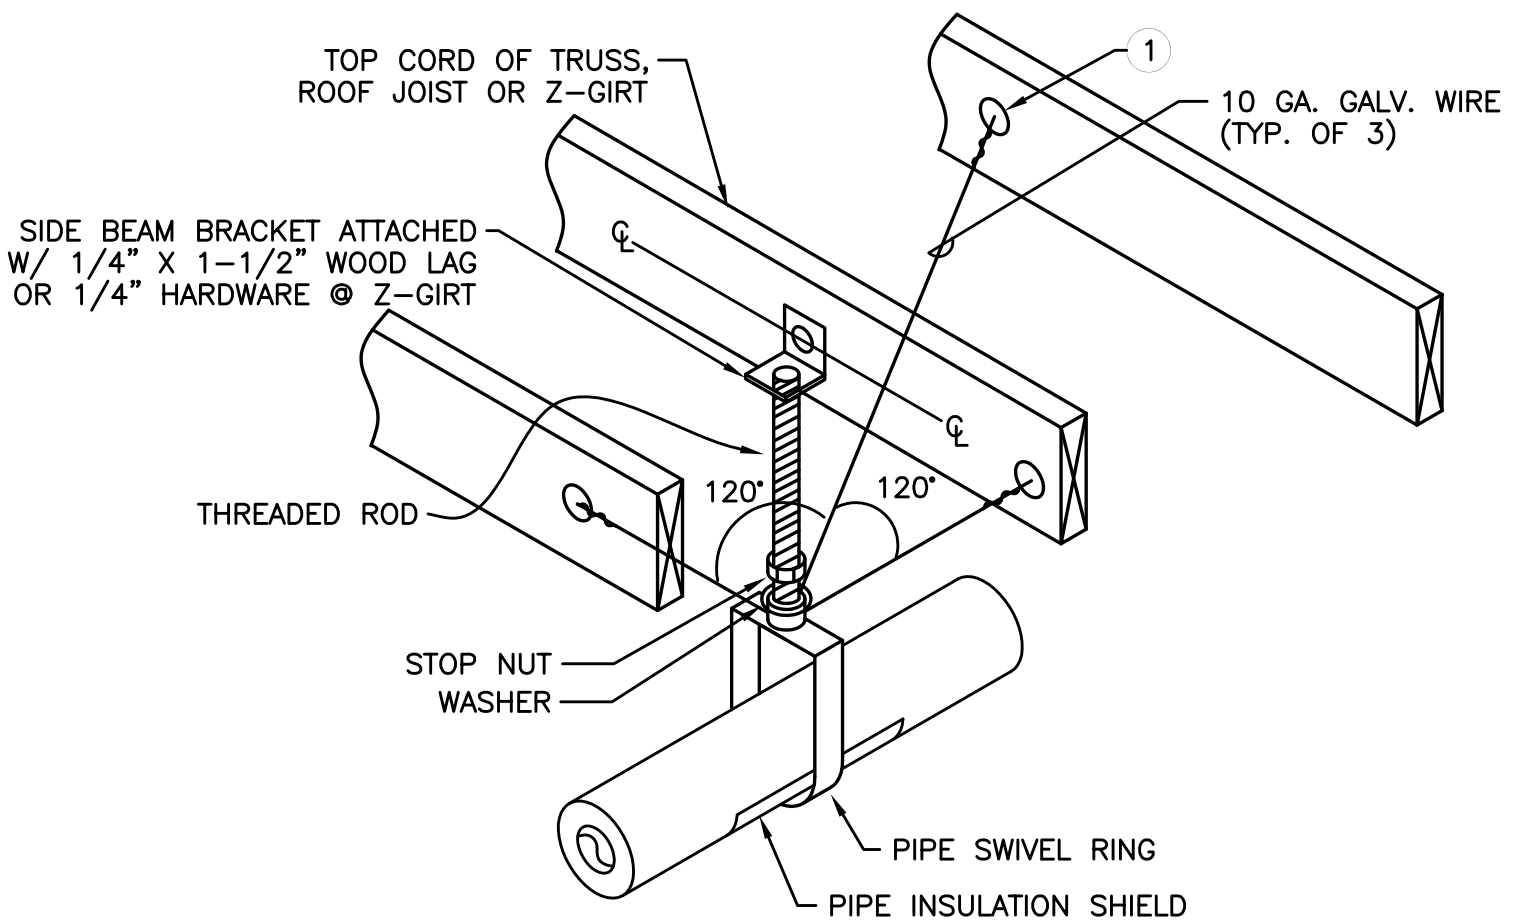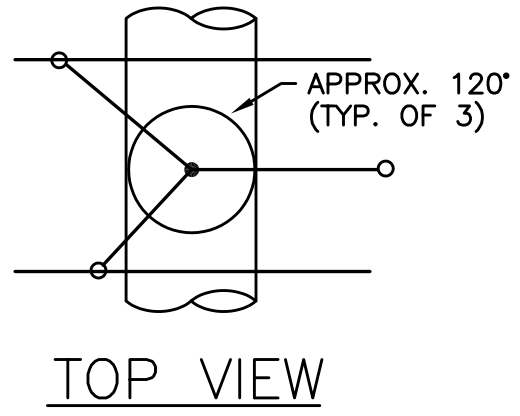


2 NON-SEISMIC PIPE SUPPORT
SCALE: DETAIL

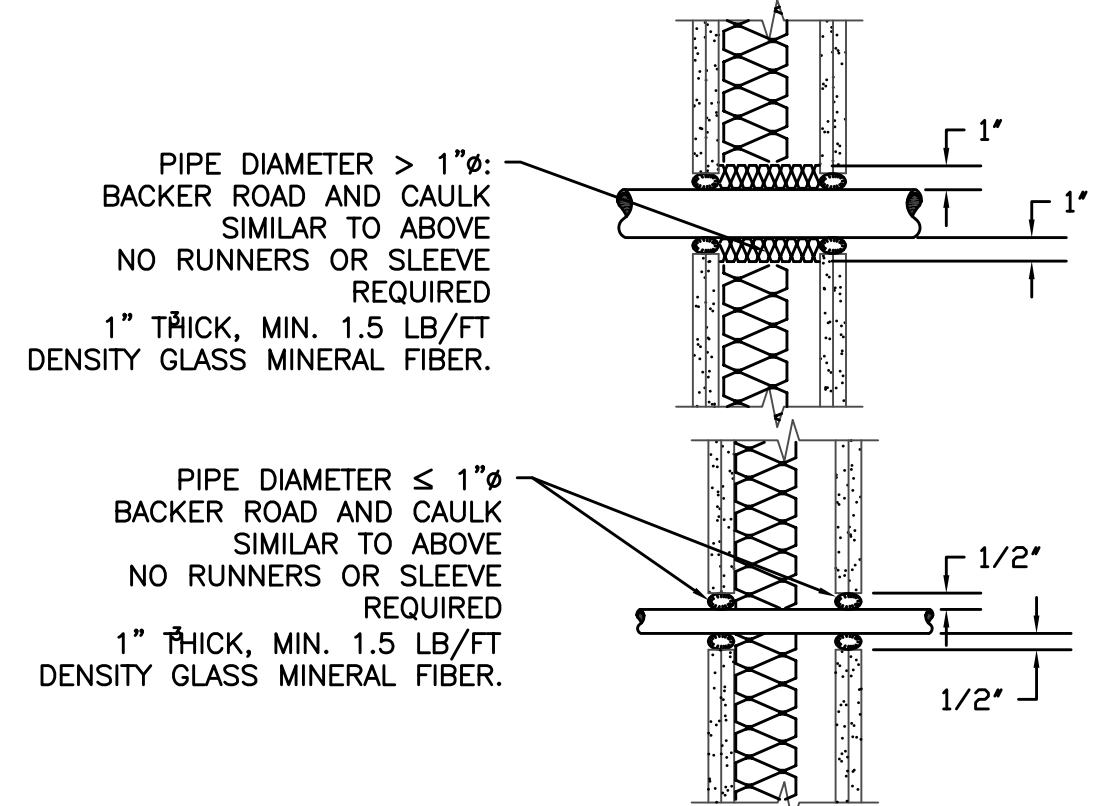

PIPE/CONDUIT PENETRATION DRYWALL CONSTRUCTION TO BE APPLIED TO WALLS WITH STC ≥49

SEE ARCHITECTURAL DRAWINGS FOR ACOUSTICALLY IMPORTANT WALLS (WALL TYPES). SEAL PENETRATIONS IN THOSE WALLS PER THESE DETAILS

3 ACOUSTIC DETAIL
SCALE: DETAIL

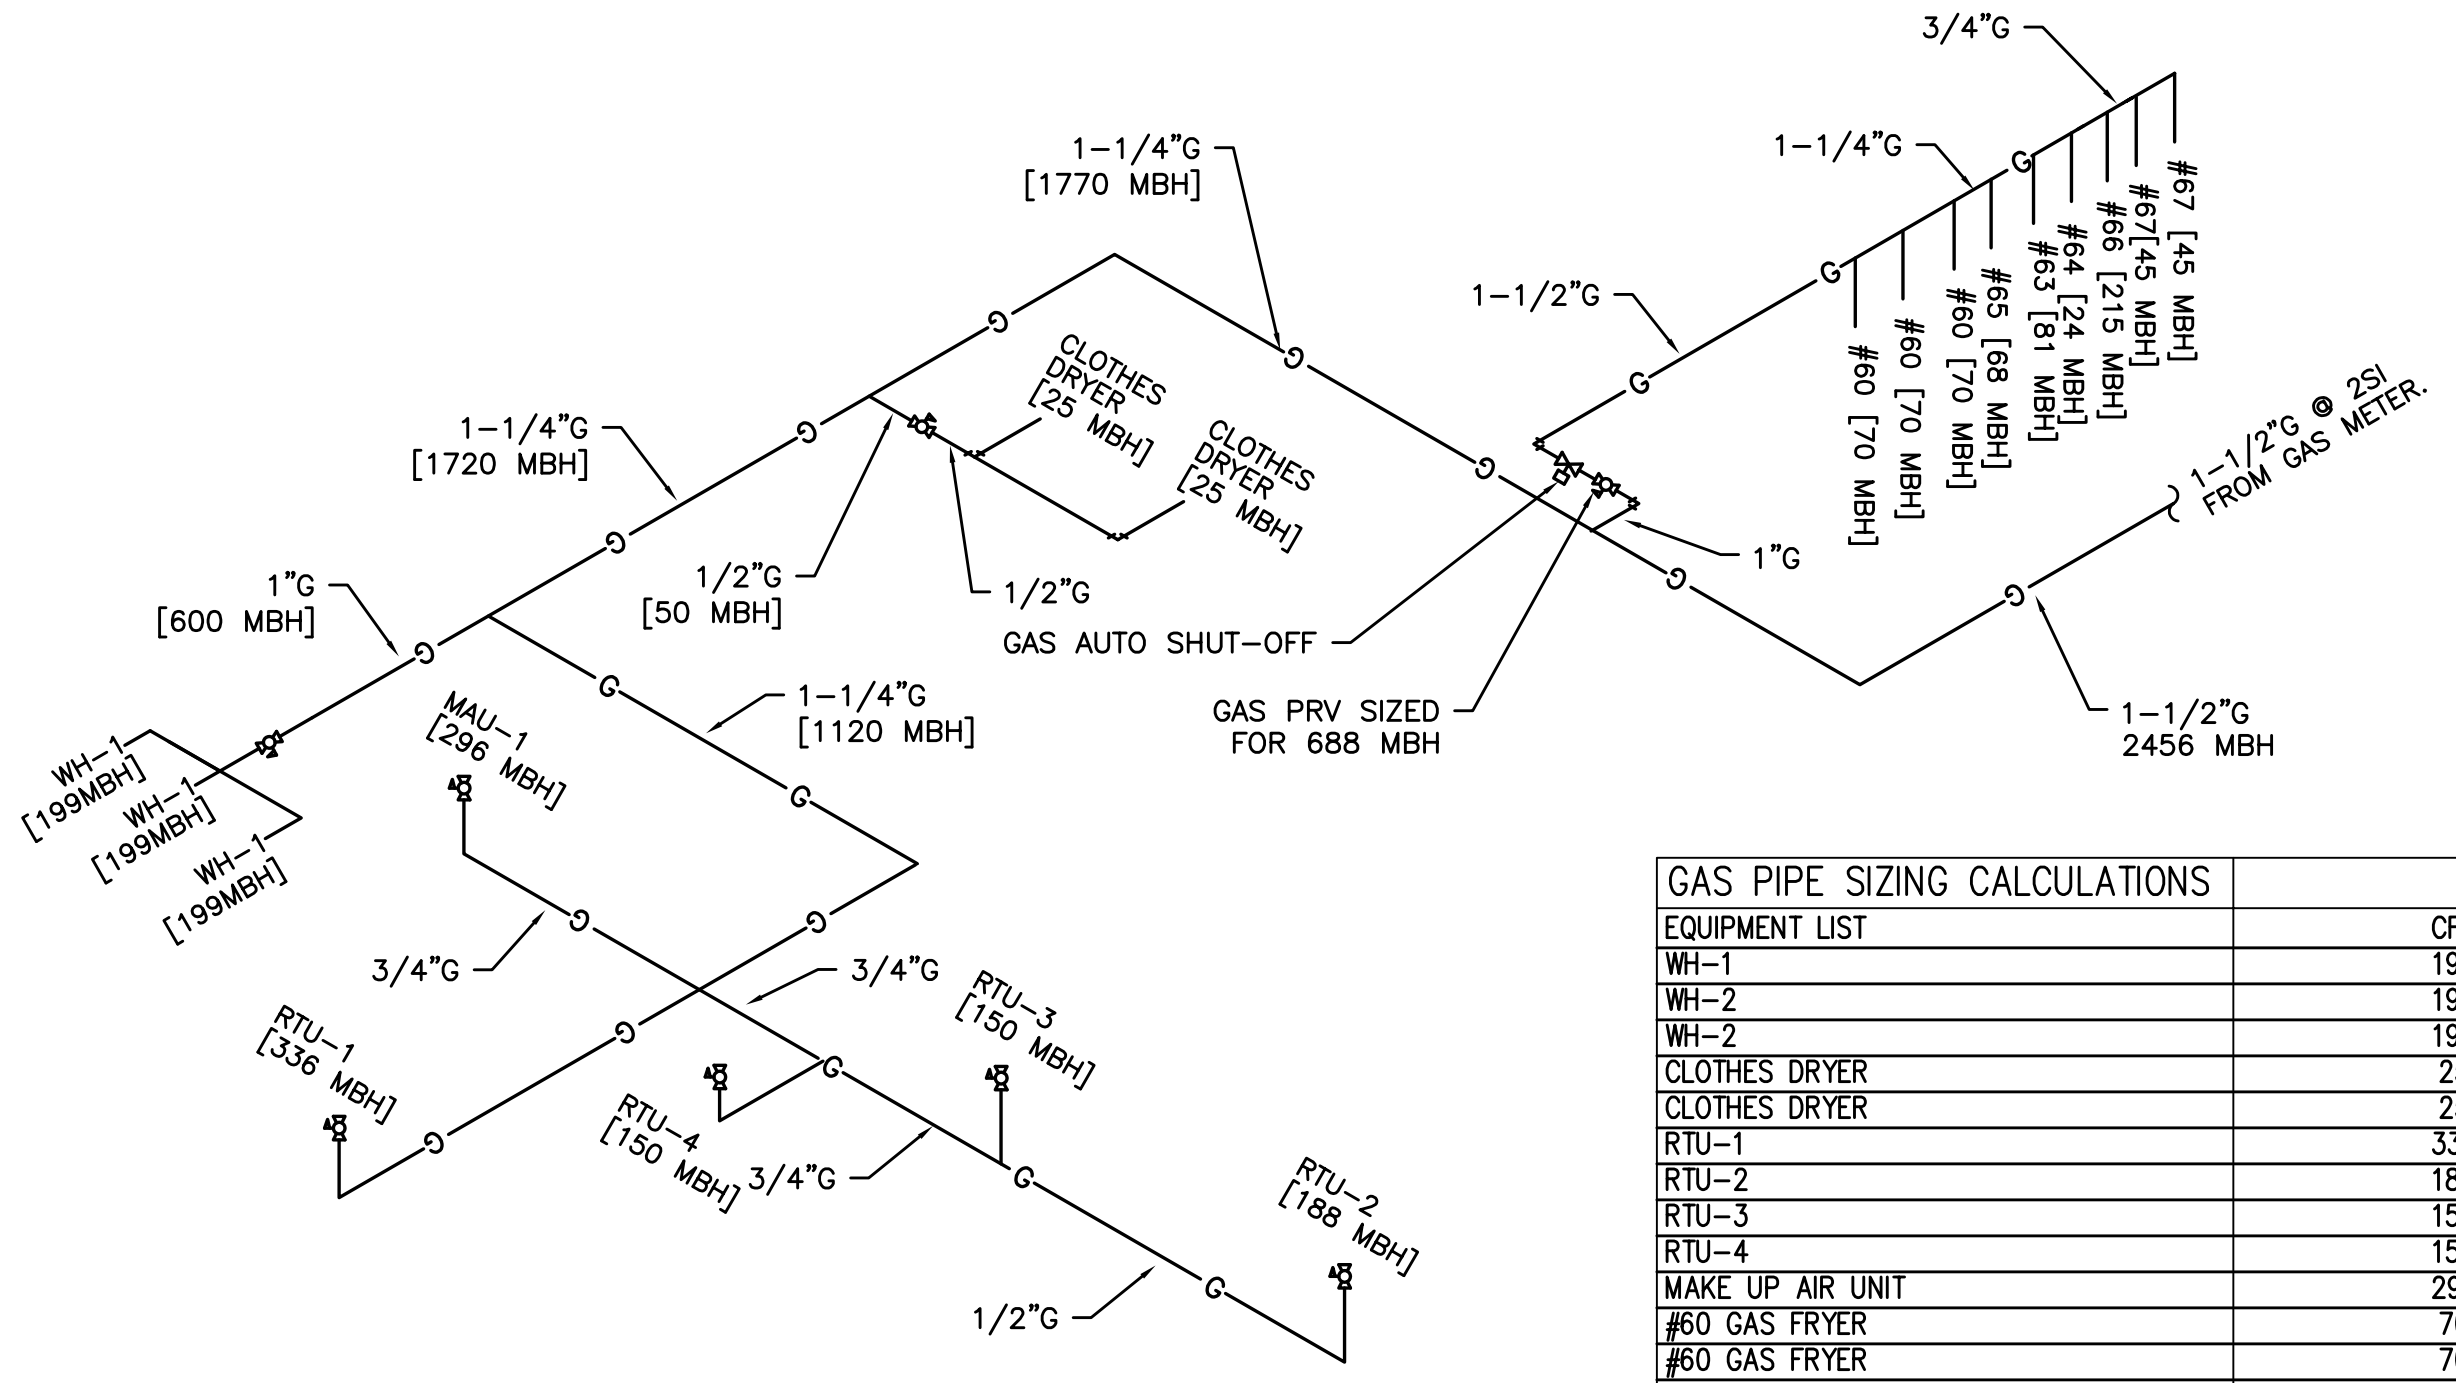

GAS PIPE SIZING CALCULATIONS	
EQUIPMENT LIST	CFH
WH-1	199
WH-2	199
WH-3	199
WH-4	199
CLOTHES DRYER	25
CLOTHES DRYER	25
RTU-1	336
RTU-2	188
RTU-3	150
RTU-4	150
MAKE UP AIR UNIT	296
#60 GAS FRYER	70
#60 GAS FRYER	70
#60 GAS FRYER	70
#63 GRIDDLE	81
#64 CHEESE MELTER	24
#65 BROILER	68
#66 RANGE WITH OVEN	215
#67 CONVECTION OVEN	45
#67 CONVECTION OVEN	45
TOTAL LOAD	2455

OMSC 2014, TABLE C402.14(2)
PRESSURE 2 PSI
TOTAL DEVELOPED PIPE LENGTH 250 FEET
MINIMUM MAIN PIPE SIZE 1-1/2\"/>

4 GAS PIPING DIAGRAM/CALCS
SCALE: DETAIL



BBT
ARCHITECTS
1160 sw Simpson Ave. - Suite 100 - Bend, Oregon 97702
1.541.382.5535 | 1.541.389.8033

MFA Consulting Engineers
2007 S.E. Ash St.
Portland, OR 97214
PHN: (503) 234-0548
FAX: (503) 234-0877
E-MAIL: WWW.MFA-ENG.COM
CONTACT: TAKAKO BAKER

WARM SPRINGS TRAVEL CENTER
Madras, OR

No.	Description	Date
1	Owner/CMGC Revisions	10/19/2016

Project Number 1519
Date OCT. 19, 2016
Drawn By TB
Checked By JVB

**PLUMBING
LEGEND &
DETAILS**

P6.02

BID SET