

NOTES 3. →  
NOTES 1,2. →  
NOTES 1,2. →

MECHANICAL EQUIPMENT SCHEDULE									
NO.	EQUIPMENT NAME	HP/KW	VOLTS	PH	AMPS	CONDUIT	WIRE	GND	CIRCUIT
EF-1	SIDEWALL EXHAUST FAN	1/4 HP	120	1	---	1/2"	2 #12	#12	BNK1-26.
GEF-1	ROOFTOP EXHAUST FAN	1/4 HP	208	3	---	1/2"	3 #12	#12	BNK1-28,30,32.
GEF-2	ROOFTOP EXHAUST FAN	1/2 HP	208	3	---	1/2"	3 #12	#12	BNK1-34,36,38.
HP-1	SPLIT SYSTEM ( OUTDOOR )	---	208	1	16.5 MCA	1/2"	2 #10	#10	BNL1A-15,17.
IAC-1A	SPLIT SYSTEM ( INDOOR )	---	208	1	0.5 MCA	1/2"	2 #12	#12	BNL1A-19,21.
IAC-1B	SPLIT SYSTEM ( INDOOR )	---	208	1	0.5 MCA	1/2"	2 #12	#12	BNL1A-23,25.
IAC-1C	SPLIT SYSTEM ( INDOOR )	---	208	1	0.4 MCA	1/2"	2 #12	#12	BNL1A-27,29.

MECHANICAL SCHEDULE NOTES:

- NOTE 1: ROUTE EQUIPMENT BRANCH CIRCUIT VIA CONTROL CONTACTOR. SEE 2  
E3.2
- NOTE 2: MOTOR STARTER TO BE INTERLOCK WITH HOOD CONTROL SYSTEM. SEE KITCHEN DRAWINGS.
- NOTE 3: ROUTE EQUIPMENT BRANCH CIRCUIT VIA "N-LIGHT" POWER PACK / RELAY MODULE. SEE LIGHTING PLANS.

HATCHED AREAS DENOTE FUTURE WORK. TYPICAL.

PLAN NOTES

- ①

CONNECT TO SPARE CIRCUIT BREAKER IN EXISTING PANEL.
- ②

MULTI-GANG FLUSH FLOORBOX. PROVIDE WITH ALL NECESSARY HARDWARE, DEVICE PLATES, COMPARTMENT DIVIDERS, COVER PLATE, AND FINISH FLANGE FOR A COMPLETE INSTALLATION. UEGRAND / EFB68-06 / SERIES. COORDINATE INSTALLATION WITH EXISTING UNDERSLAB STORM AND WASTE LINES.
- ③

TRANSFORMER "XBK1" AND 300A ENCLOSED CIRCUIT BREAKER. SEE ONE LINE DIAGRAM.
- ④

DISCONNECT FOR ELEVATOR CAB LIGHTS / CONTROLS.
- ⑤

WATER LEVEL ALARM PANEL. COORDINATE LOCATION PRIOR TO ROUGH-IN.
- ⑥

EXTEND EXISTING BRANCH CIRCUIT TO SERVE EXTERIOR RECEPTACLE.
- ⑦

COORDINATE FIRE/SMOKE DAMPER CONTROL REQUIREMENTS WITH MECHANICAL AND LOW-VOLTAGE.

SEE SHEET E3.2 FOR WORK IN THIS AREA

1  
E3.1 BASEMENT POWER PLAN  
SCALE: 1/8" = 1'-0"

**M** Consulting Engineers  
2007 S.E. Ash St.  
Portland, OR 97214  
PHN: (503) 234-0548  
FAX: (503) 234-0877  
INC. WWW.MPTA-ENG.COM  
CONTACT: CHRIS WINER



BLUE ROOM ARCHITECTURE & DESIGN, P.S.

HISTORIC SALTESE SCHOOLHOUSE  
BOX 628, VERADALE, WA 99037  
(509) 456-6800

www.brdstudio.com

CIVIL ENGINEER

FOOD SERVICE CONSULTANT  
DK DESIGN, INC.  
15040 NE 95TH ST., #101  
REDMOND, WA 98052  
(425) 861-8622

MECHANICAL ENGINEERS

MFIA INC CONSULTING ENGINEERS  
2007 SE ASH STREET  
PORTLAND, OR 97214  
(503) 234-0548


ELECTRICAL ENGINEER

MFIA INC CONSULTING ENGINEERS  
2007 SE ASH STREET  
PORTLAND, OR 97214  
(503) 234-0548



THIS PROJECT INCLUDES THE INTERIOR REMODEL OF AN EXISTING CRITICAL ACCESS HOSPITAL FACILITY THAT IS TO REMAIN OPERATIONAL AT ALL TIMES. CONTRACTOR BIDS SHALL BE BASED ON VERIFICATION OF EXISTING ON-SITE CONDITIONS. UNINTERRUPTED ESSENTIAL HEALTHCARE SERVICES DURING THE CONSTRUCTION PERIOD, ONGOING COORDINATION OF ALL RELATED TRADES FOR CURRENT CODE COMPLIANCE, PATIENT SAFETY, JURISDICTIONAL REVIEW, SYSTEM PERFORMANCE AND UNFORESEEN CLINICAL DISRUPTIONS).

INTERIOR REMODEL FOR:

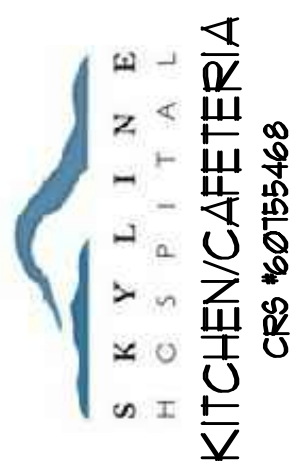

211 SKYLINE DRIVE  
WHITE SALMON, WASHINGTON 98612

PROJECT NUMBER: 18002c  
DATE: 2/14/2018  
DRAWN: CW  
REVISIONS:

BASEMENT  
POWER  
PLAN

E3.1