


GENERAL NOTES:

1. SEE $\frac{1}{M6.1}$ FOR DUCT SUPPORT DETAIL.
2. SEE $\frac{2}{M6.1}$ FOR PIPE SUPPORT DETAIL.
3. SEE $\frac{3}{M6.1}$ FOR SEISMIC DUCT SUPPORT DETAIL.
4. SEE $\frac{4}{M6.1}$ FOR SEISMIC PIPE SUPPORT DETAIL.
5. CONTRACTOR TO FIELD VERIFY EXISTING CONDITIONS PRIOR TO ANY INSTALLATION.
6. COORDINATE WORK WITH NEW AND EXISTING DUCTWORK, PIPING, PLUMBING LINES AND ELECTRICAL.
7. $\textcircled{\text{TU-X}}$ DENOTES (E)VAV BOXES. $\textcircled{\text{TU-X}}$ ARE NEW EQUIPMENTS.

KEYED NOTES:

1. 1" HWS/HWR CAPPED WITH SHUT-OFF VALVES FOR FUTURE

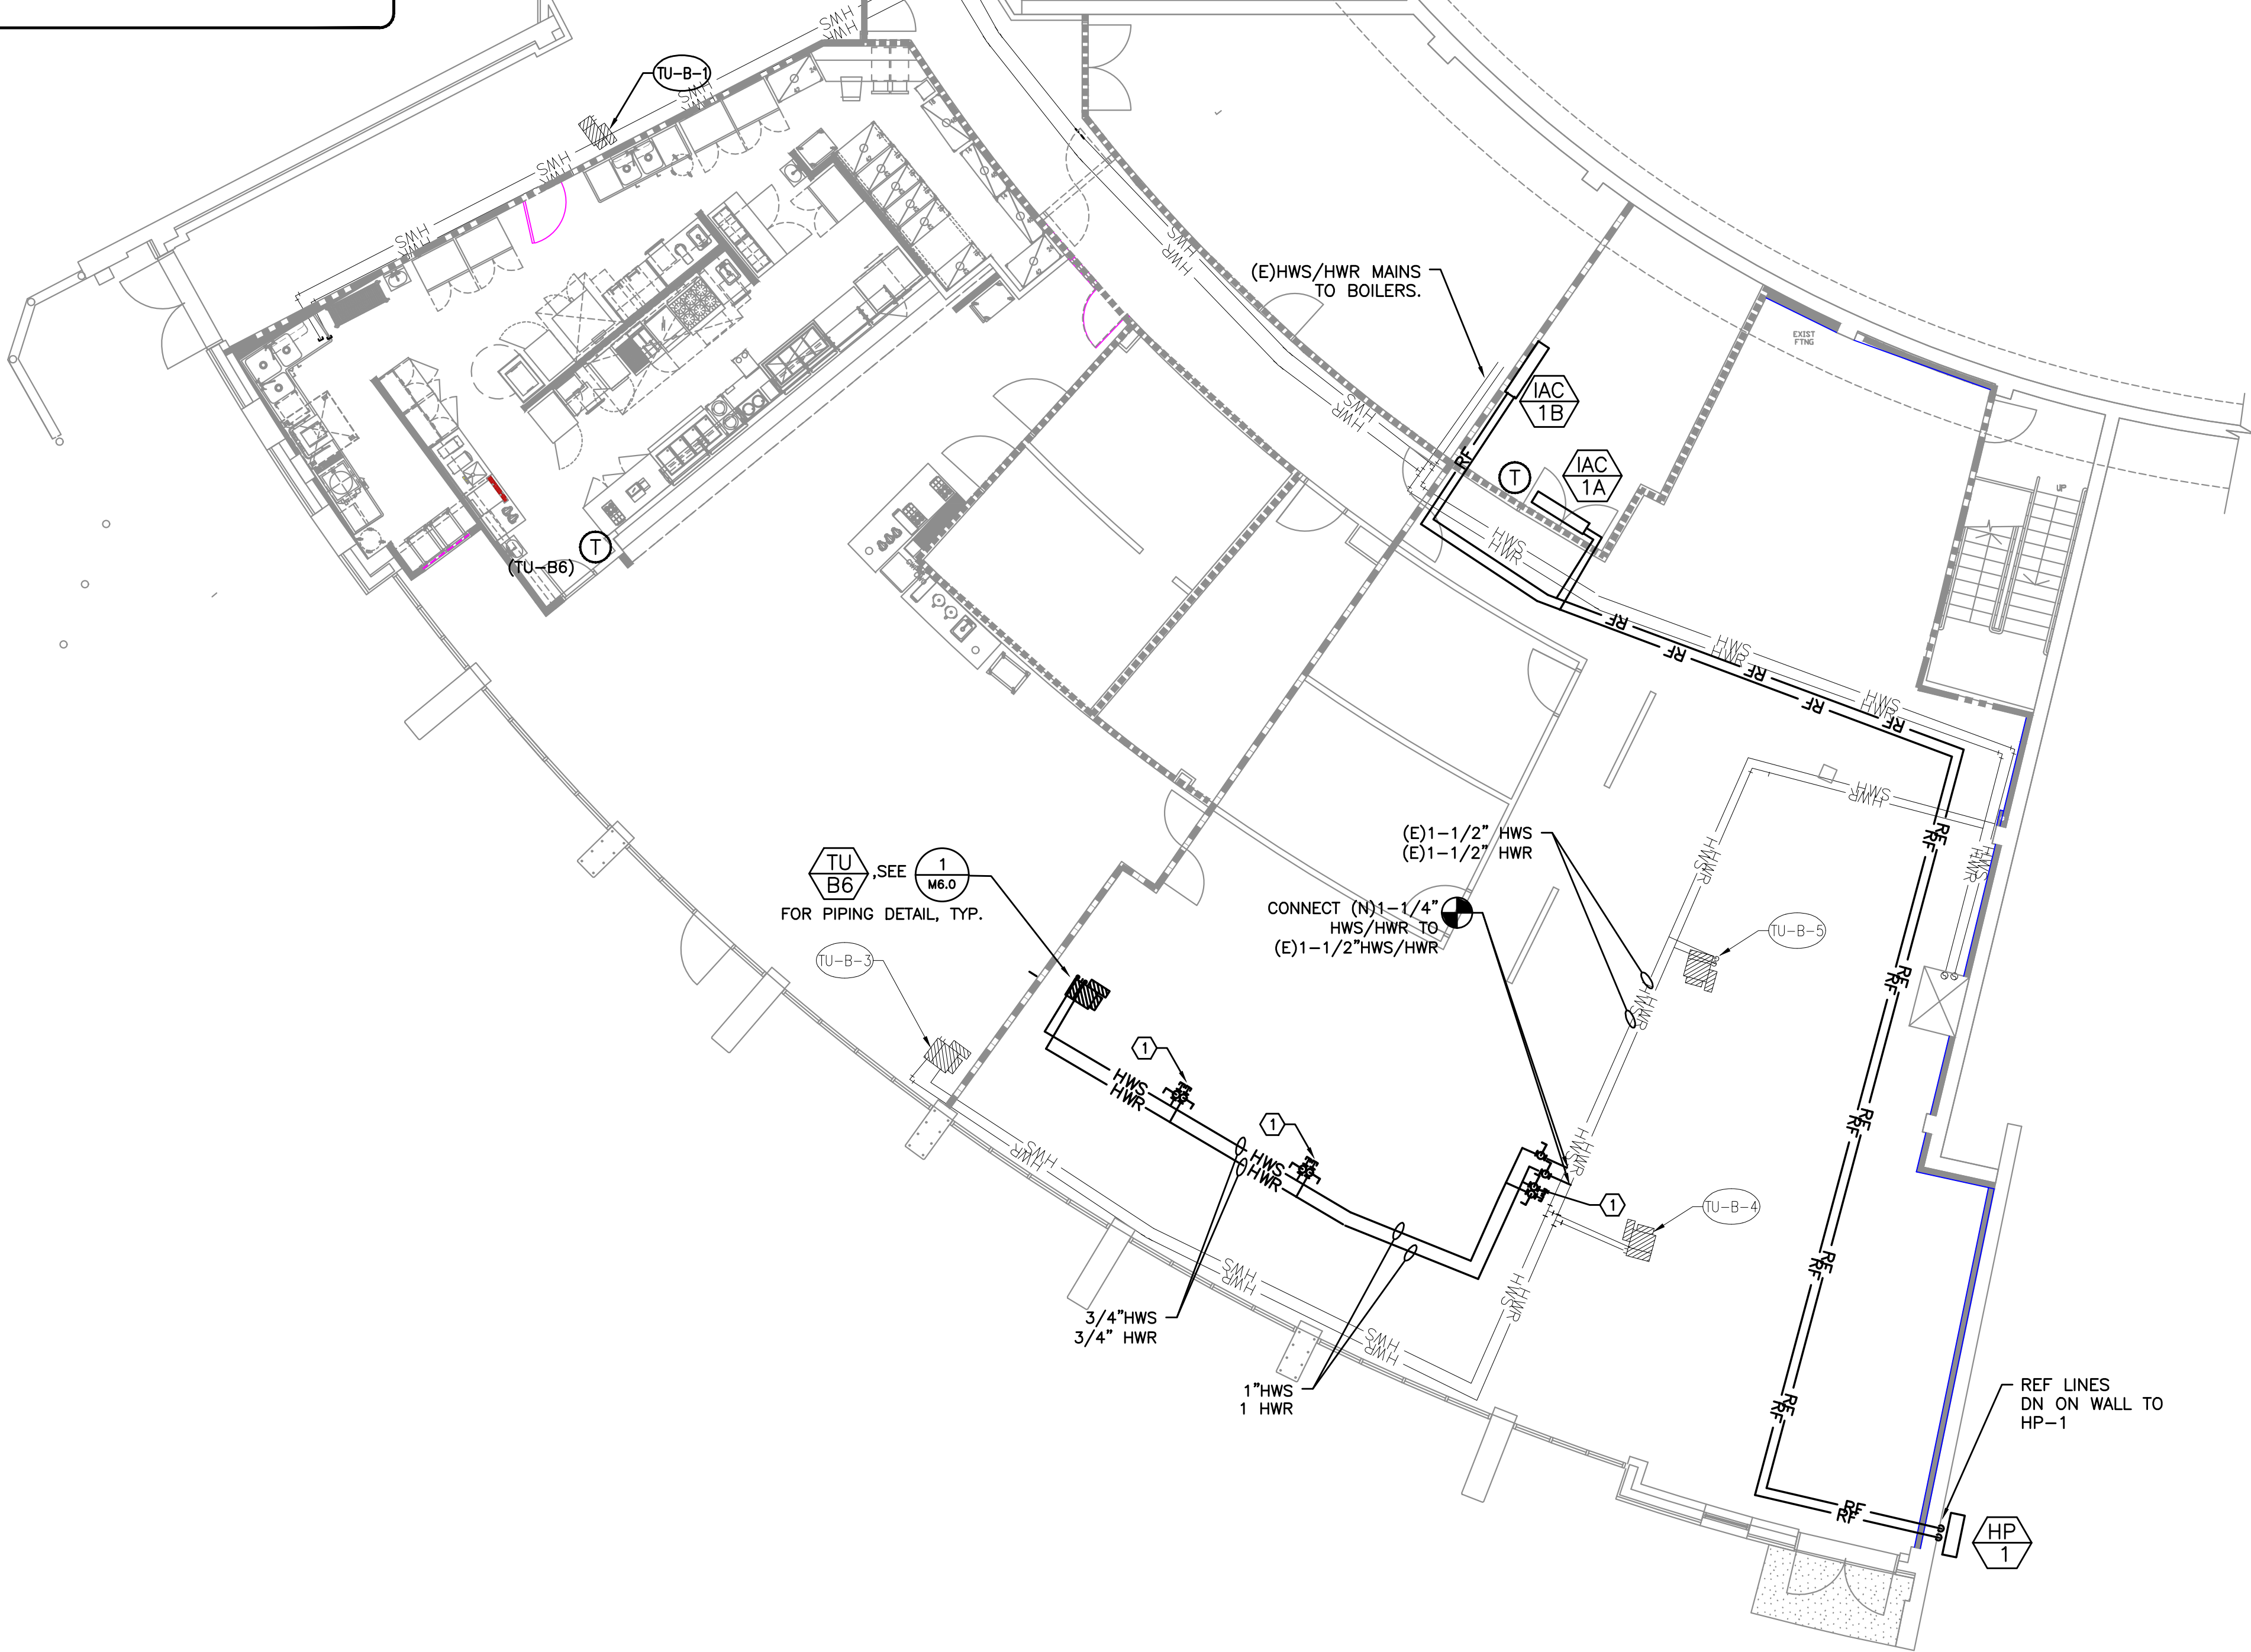

1 BASEMENT MECHANICAL PIPING PLAN
MP2.0 1/8"=1'-00"

MEIA INC. Consulting Engineers
2007 S.E. Ash St.
Portland, OR 97214
PHN: (503) 234-0548
FAX: (503) 234-0577
WWW.MEIA-ENG.COM
CONTACT: TAKAKO BAKER



BLUE ROOM ARCHITECTURE & DESIGN, P.S.

HISTORIC SALTESE SCHOOLHOUSE
BOX 628, VERADALE, WA 99037
(509) 456-6800

www.brdstudio.com

CIVIL ENGINEER

FOOD SERVICE CONSULTANT


DK DESIGN, INC.
15040 NE 95TH ST., #101
REDMOND, WA 98052
(425) 881-8622

MECHANICAL ENGINEERS

MFIA INC CONSULTING ENGINEERS
2007 SE ASH STREET
PORTLAND, OR 97214
(503) 234-0548

ELECTRICAL ENGINEERS

MFIA INC CONSULTING ENGINEERS
2007 SE ASH STREET
PORTLAND, OR 97214
(503) 234-0548

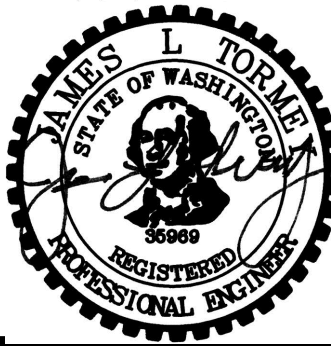

THIS PROJECT INCLUDES THE INTERIOR REMODEL OF AN EXISTING CRITICAL ACCESS HOSPITAL FACILITY THAT IS TO REMAIN OPERATIONAL AT ALL TIMES. CONTRACTOR BIDS SHALL BE BASED ON VERIFICATION OF EXISTING ON-SITE CONDITIONS. UNINTERRUPTED ESSENTIAL HEALTHCARE SERVICES DURING THE CONSTRUCTION PERIOD. ONGOING COORDINATION OF ALL RELATED TRADES FOR CURRENT CODE COMPLIANCE, PATIENT SAFETY, JURISDICTIONAL REVIEW, SYSTEM PERFORMANCE AND UNFORESEEN CLINICAL DISRUPTION(S).

INTERIOR REMODEL FOR:



211 SKYLINE DRIVE
WHITE SALMON, WASHINGTON 98672

PROJECT NUMBER: 18002c
DATE: 2/14/2018
DRAWN: TB
REVISIONS:

PERMIT SET

BASEMENT
MECHANICAL
PIPING PLAN

MP2.0

© 2018 BLUE ROOM ARCHITECTURE & DESIGN, P.S.