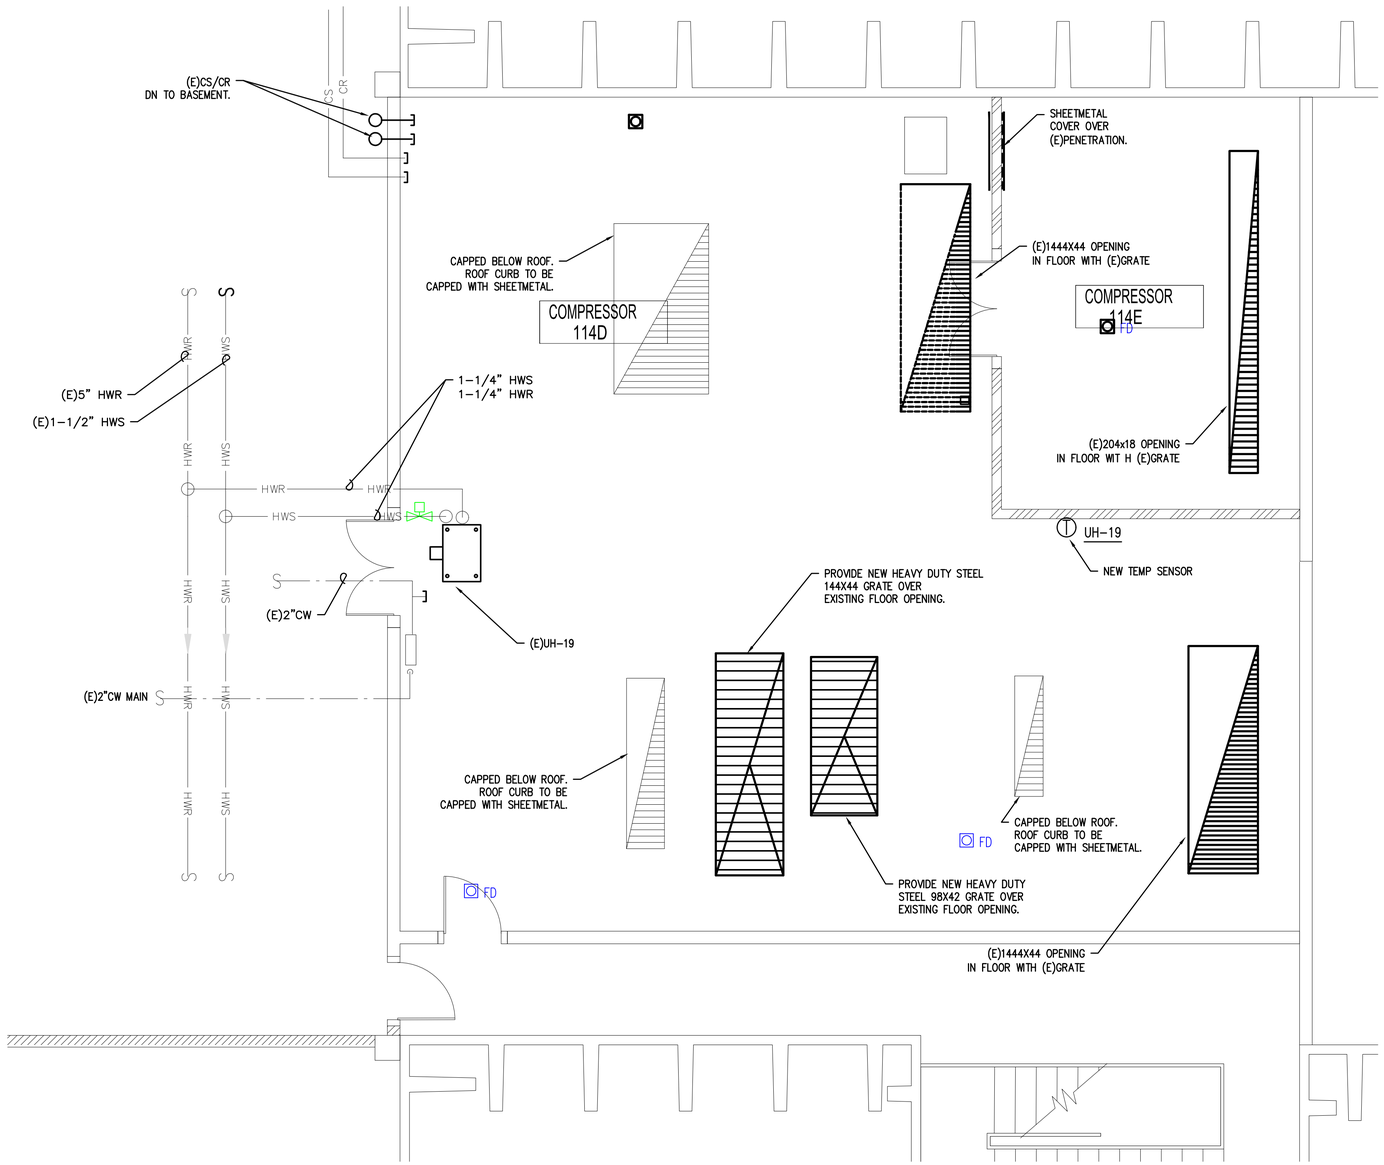

1 / M12 COOLING TOWER ROOM – 1ST FLOOR– PIPING PLAN

SCALE: 1/4"=1'-0"

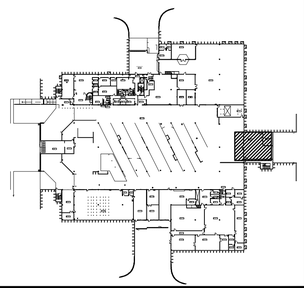

Multnomah County
Facilities & Property Management
401 N. Dixon Street
Portland, OR 97227-1865

REGISTERED PROFESSIONAL ENGINEER
70996PE
Takako Baker
JULY 9, 2002
TAKAKO BAKER
EXPIRES: 12/31/19

MFA INC. Consulting Engineers
2007 S.E. Ash St.
Portland, OR 97214
PHN: (503) 234-0548
FAX: (503) 234-0577
WWW.MFIA-ENG.COM
CONTACT: TAKAKO BAKER

12 SEPTEMBER 2018

REPLACE COOLING TOWER

JOHN B. YEON FACILITY
1620 SE 190TH ST
GRESHAM, OREGON, 97233

PRICING ISSUE

Mark	Date	Description of Revision	By

Consultant Project No: 16050-16
CAD DWG File: M1.2
Drawn By:
Checked By:
Approved By:
M.C. Bldg.# - Proj.# B425 - CP08.18.24
Sheet Title: COOLING TOWER ROOM 1ST FLOOR - PIPING PLAN
Date: 09.12.2018

M1.2
M Sheet or TNS