

REPLACE COOLING TOWER

JOHN B. YEON FACILITY
1620 SE 190TH ST
GRESHAM, OREGON, 97233

PRICING ISSUE

Mark	Date	Description of Revision	By

Consultant Project No: 16050-16

CAD DWG File: M4.0 Drawn By:

Checked By: Approved By:

M.C. Bldg # Proj# B425 - CP08.18.24

Sheet Title: COOLING TOWER PIPING DEMO DIAGRAM


Date: 09.12.2018

M4.0

M Sheet or TNS

KEYED NOTES:

1. ABANDON (E)6"CS/CR LINES IN PLACE.
2. CAP AT WALL AND DEMO ALL PIPING IN MECHANICAL ROOM.
3. RELOCATE (E)CHEM FEEDERS AND CONTROLLER TO CHILLER ROOM.
4. REMOVE (E)COOLING TOWER.

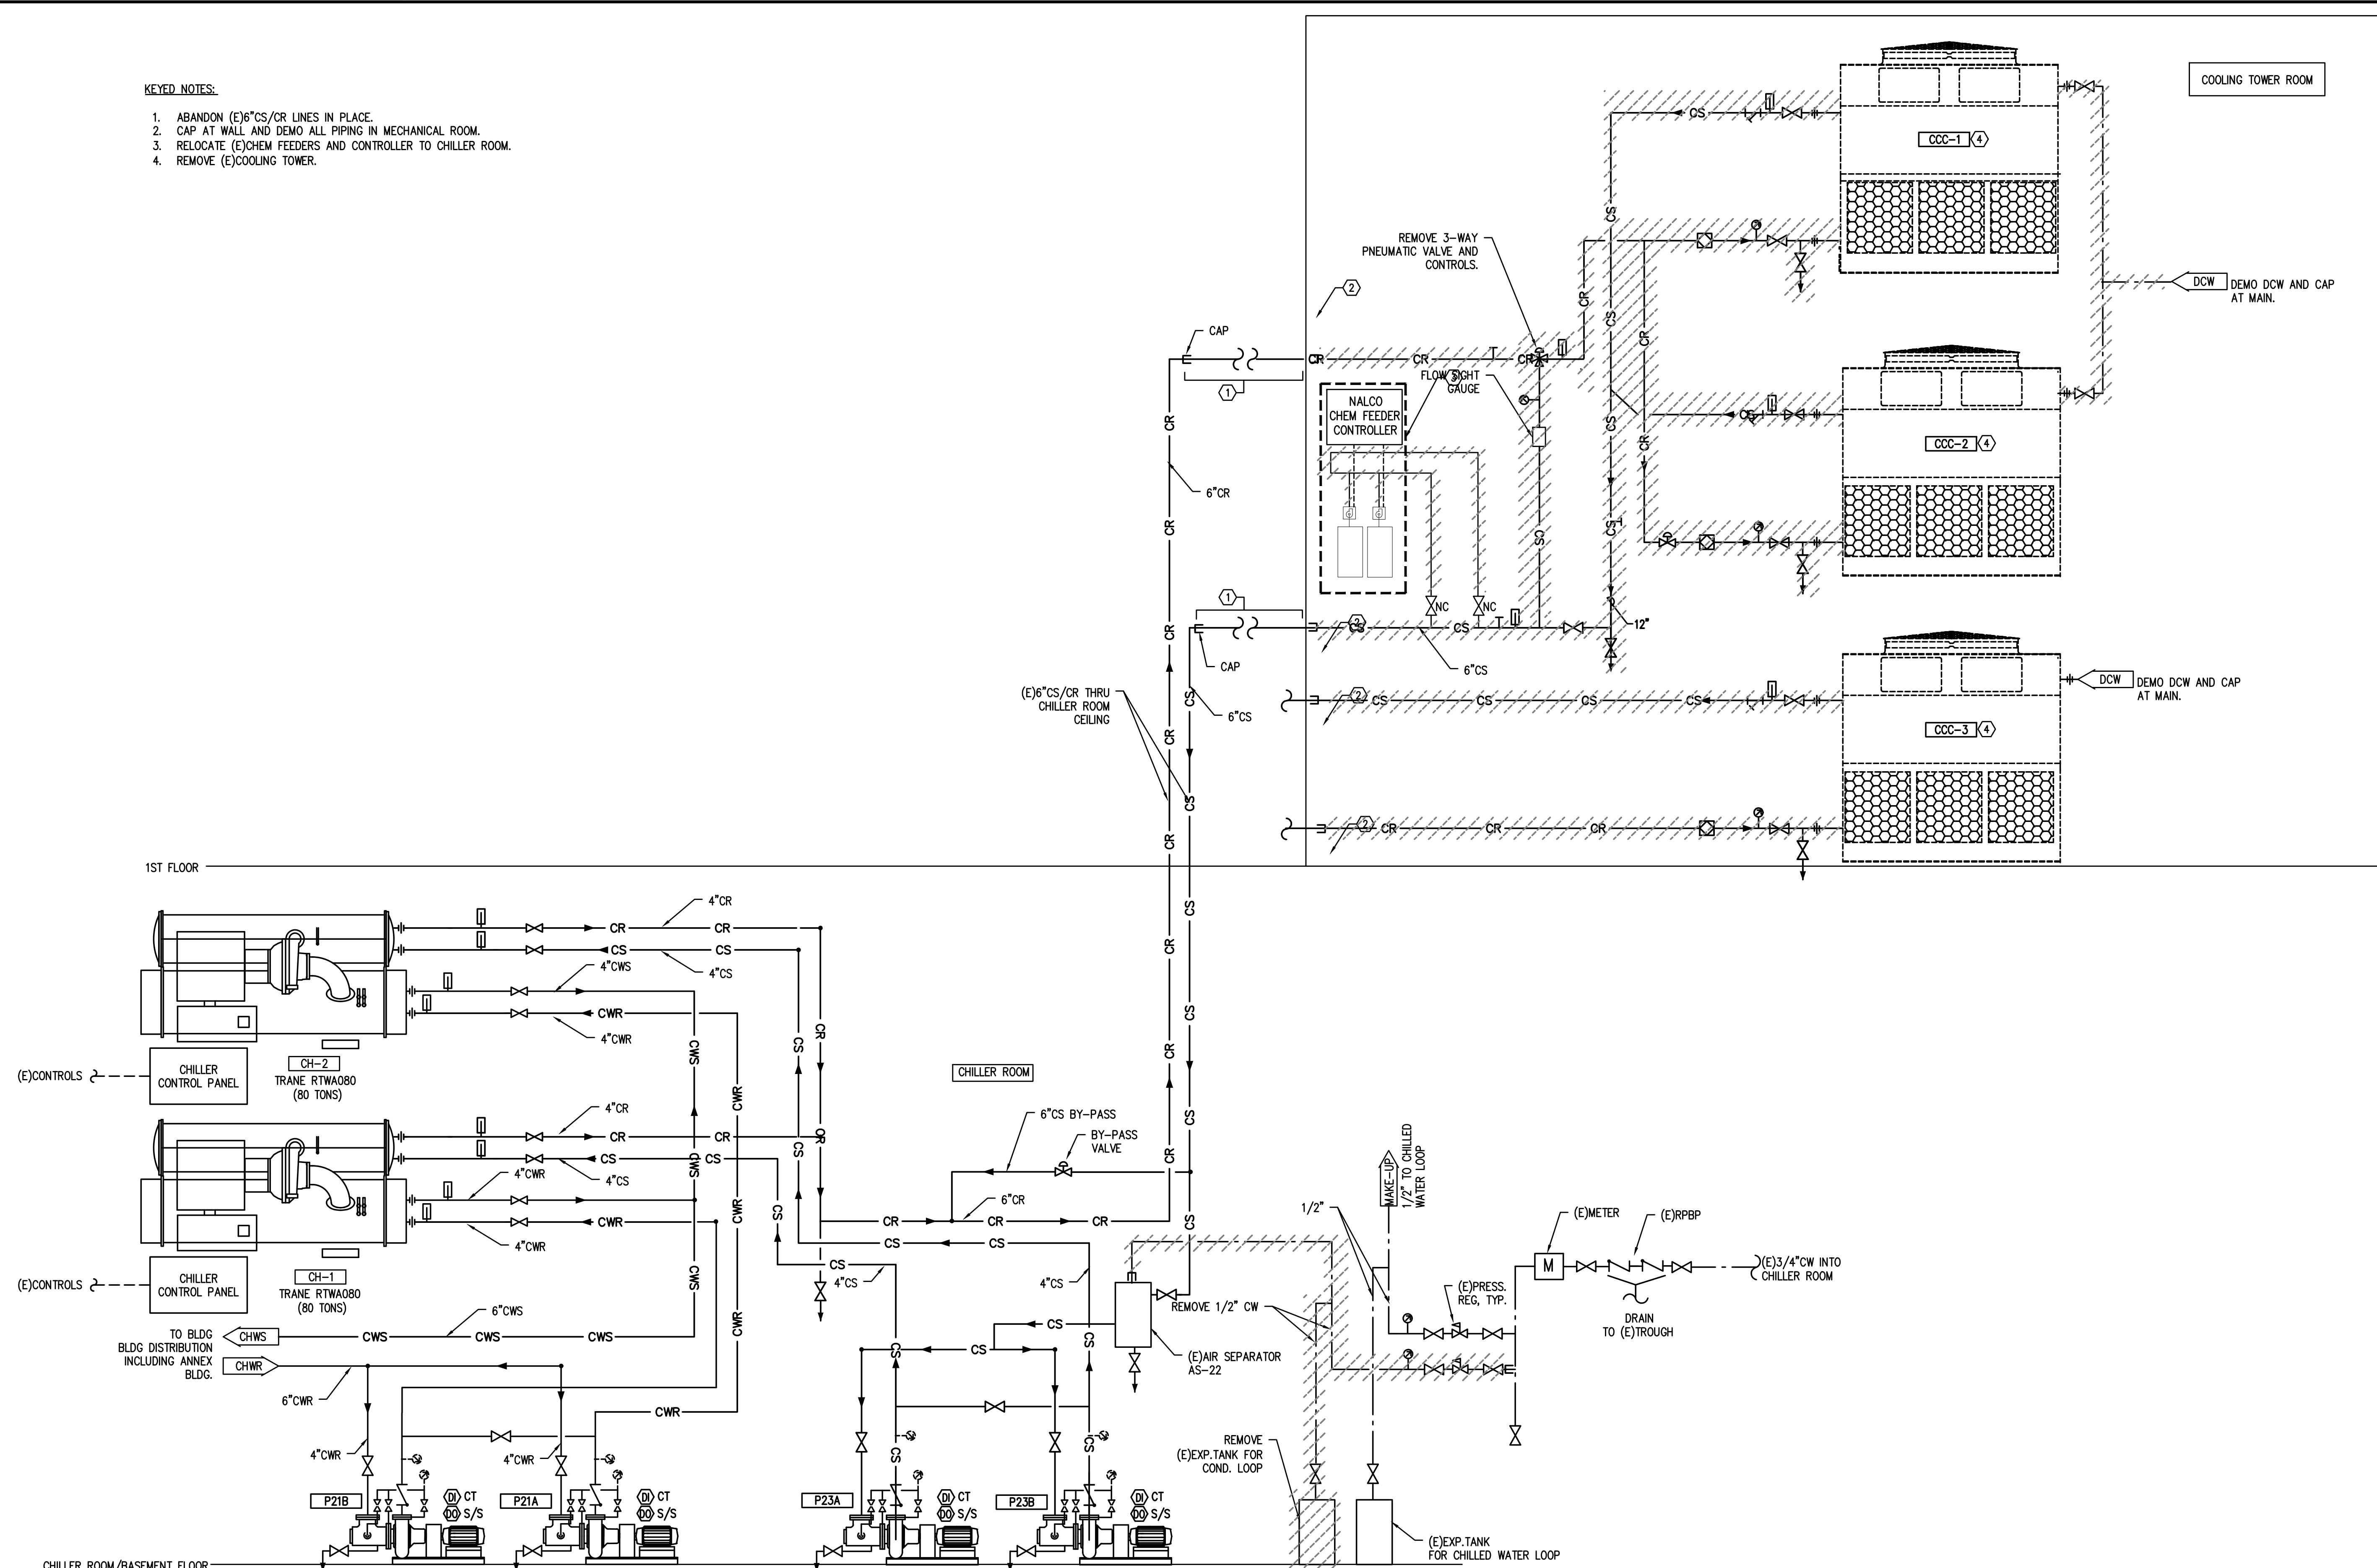

1 COOLING TOWER PIPING DIAGRAM - DEMO
SCALE: N/A