



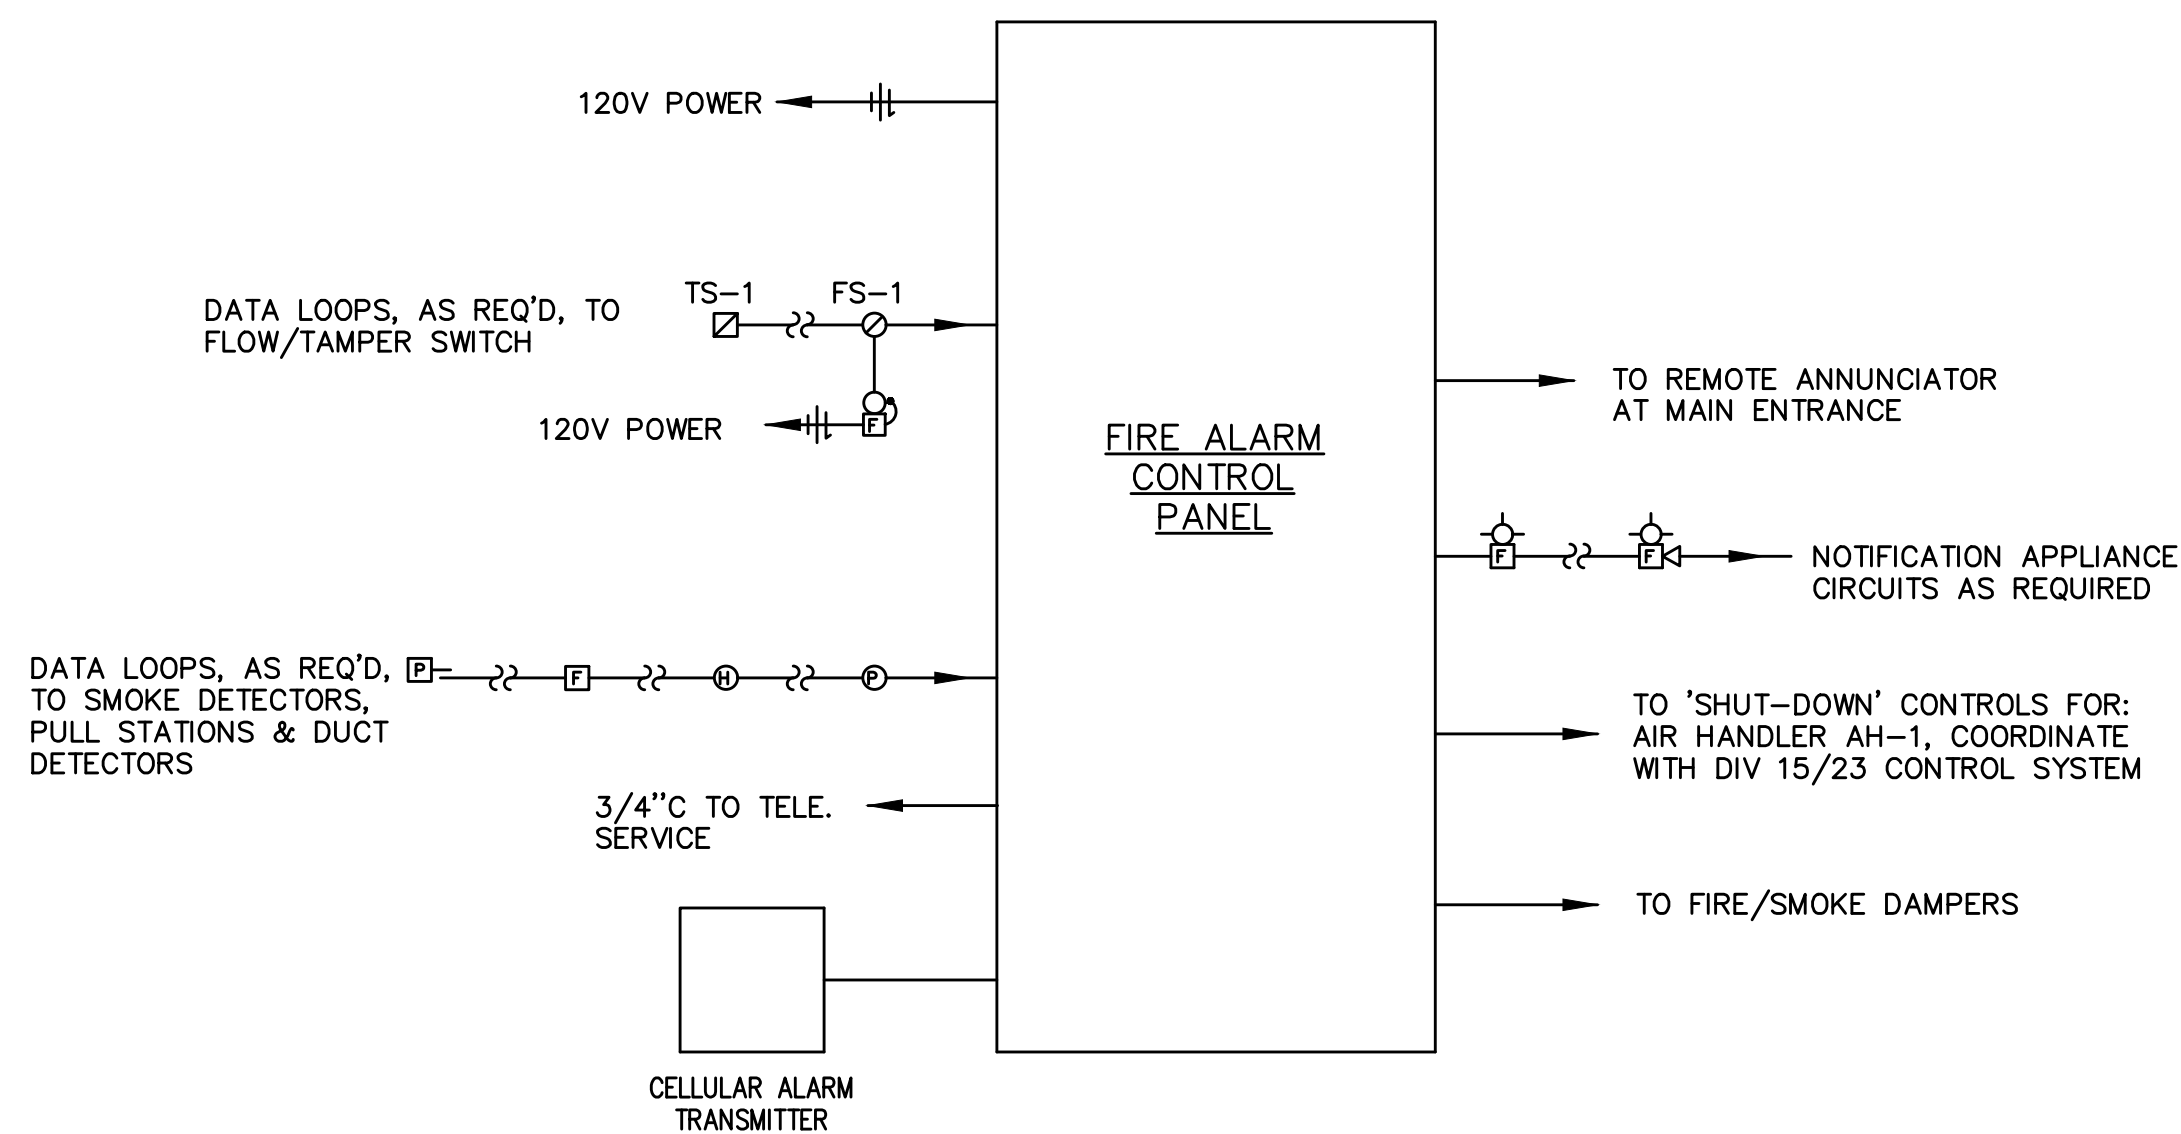

1 FIRE ALARM DETAIL

T2.01 N.T.S.

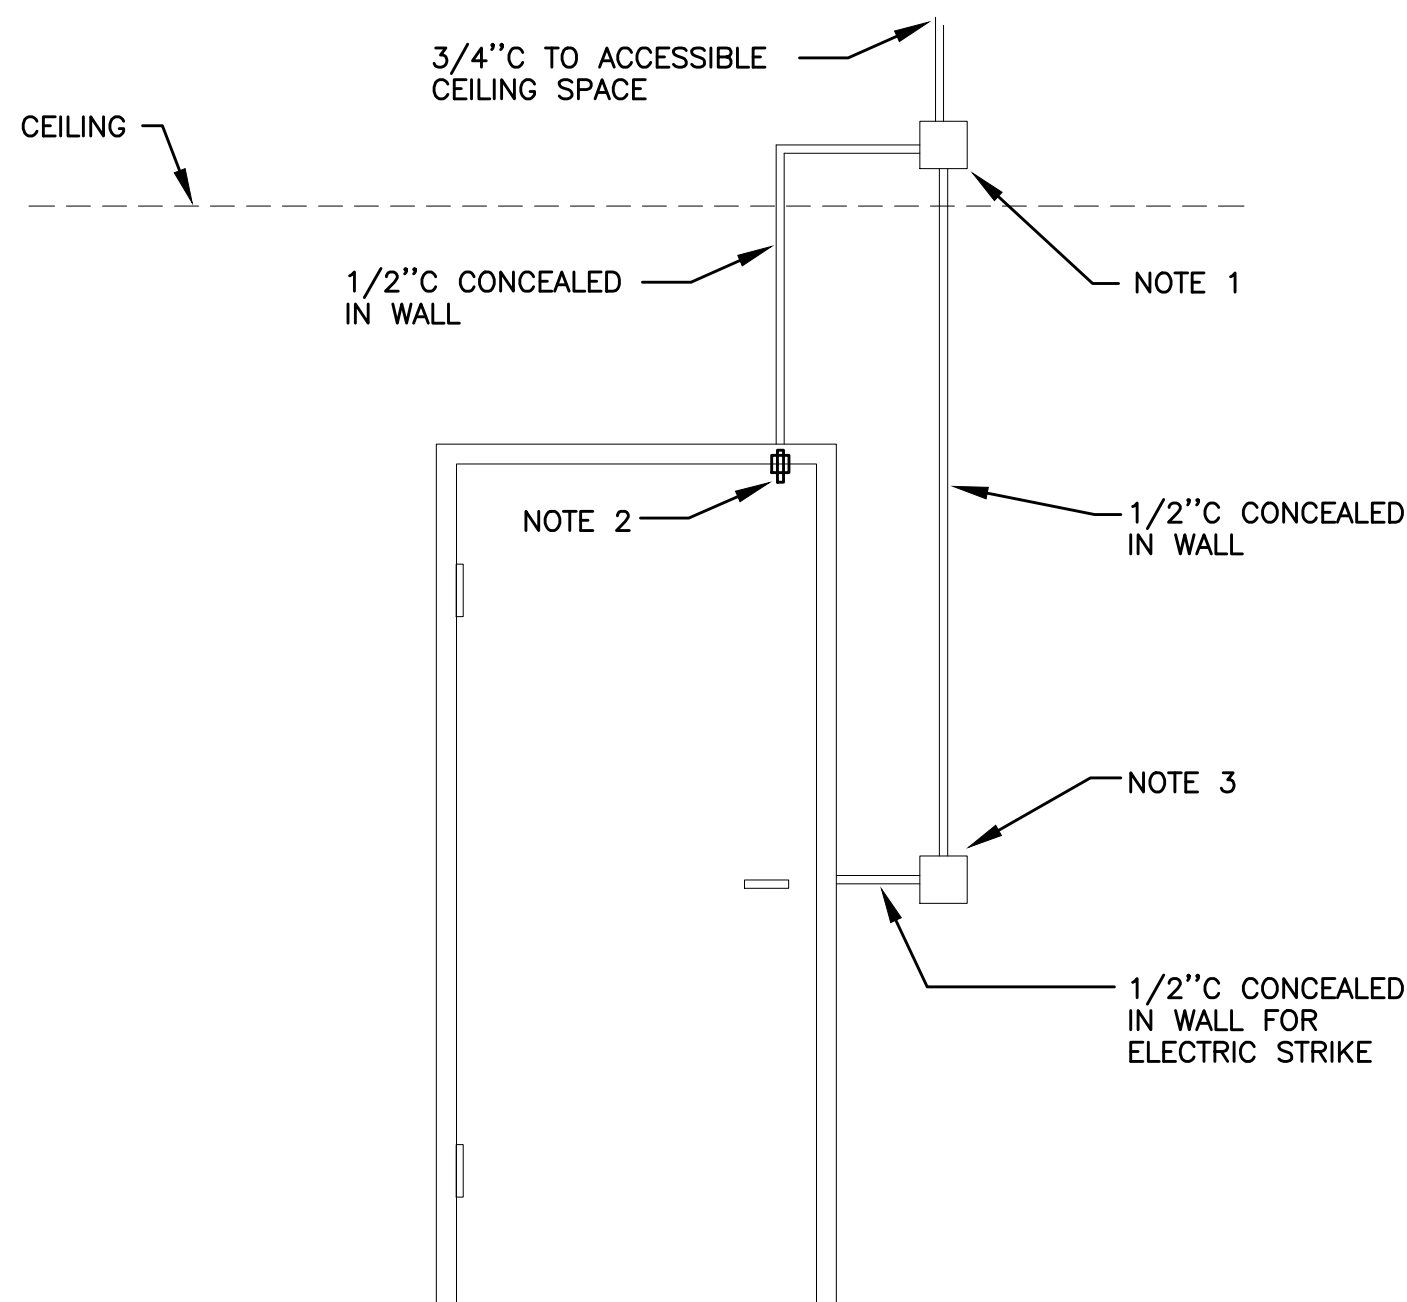


SECURITY ROUGH-IN NOTES

1. 4 SQUARE J-BOX @ 0'-6" ABOVE FINISHED CEILING, VERIFY WITH ARCHITECT.
2. DOOR STATUS CONTACT, ONLY NEEDED WHEN STRIKE DOES NOT HAVE INTEGRAL SWITCH.
3. DBL GANG BOX, PROVIDE SNGL GANG REDUCER RING IF NEEDED BY SECURITY DEVICE. COORDINATE WITH ARCHITECT TO MEET ADA REQUIREMENTS.

3 ACCESS CONTROL ROUGH-IN ELEVATION

T2.01 N.T.S.

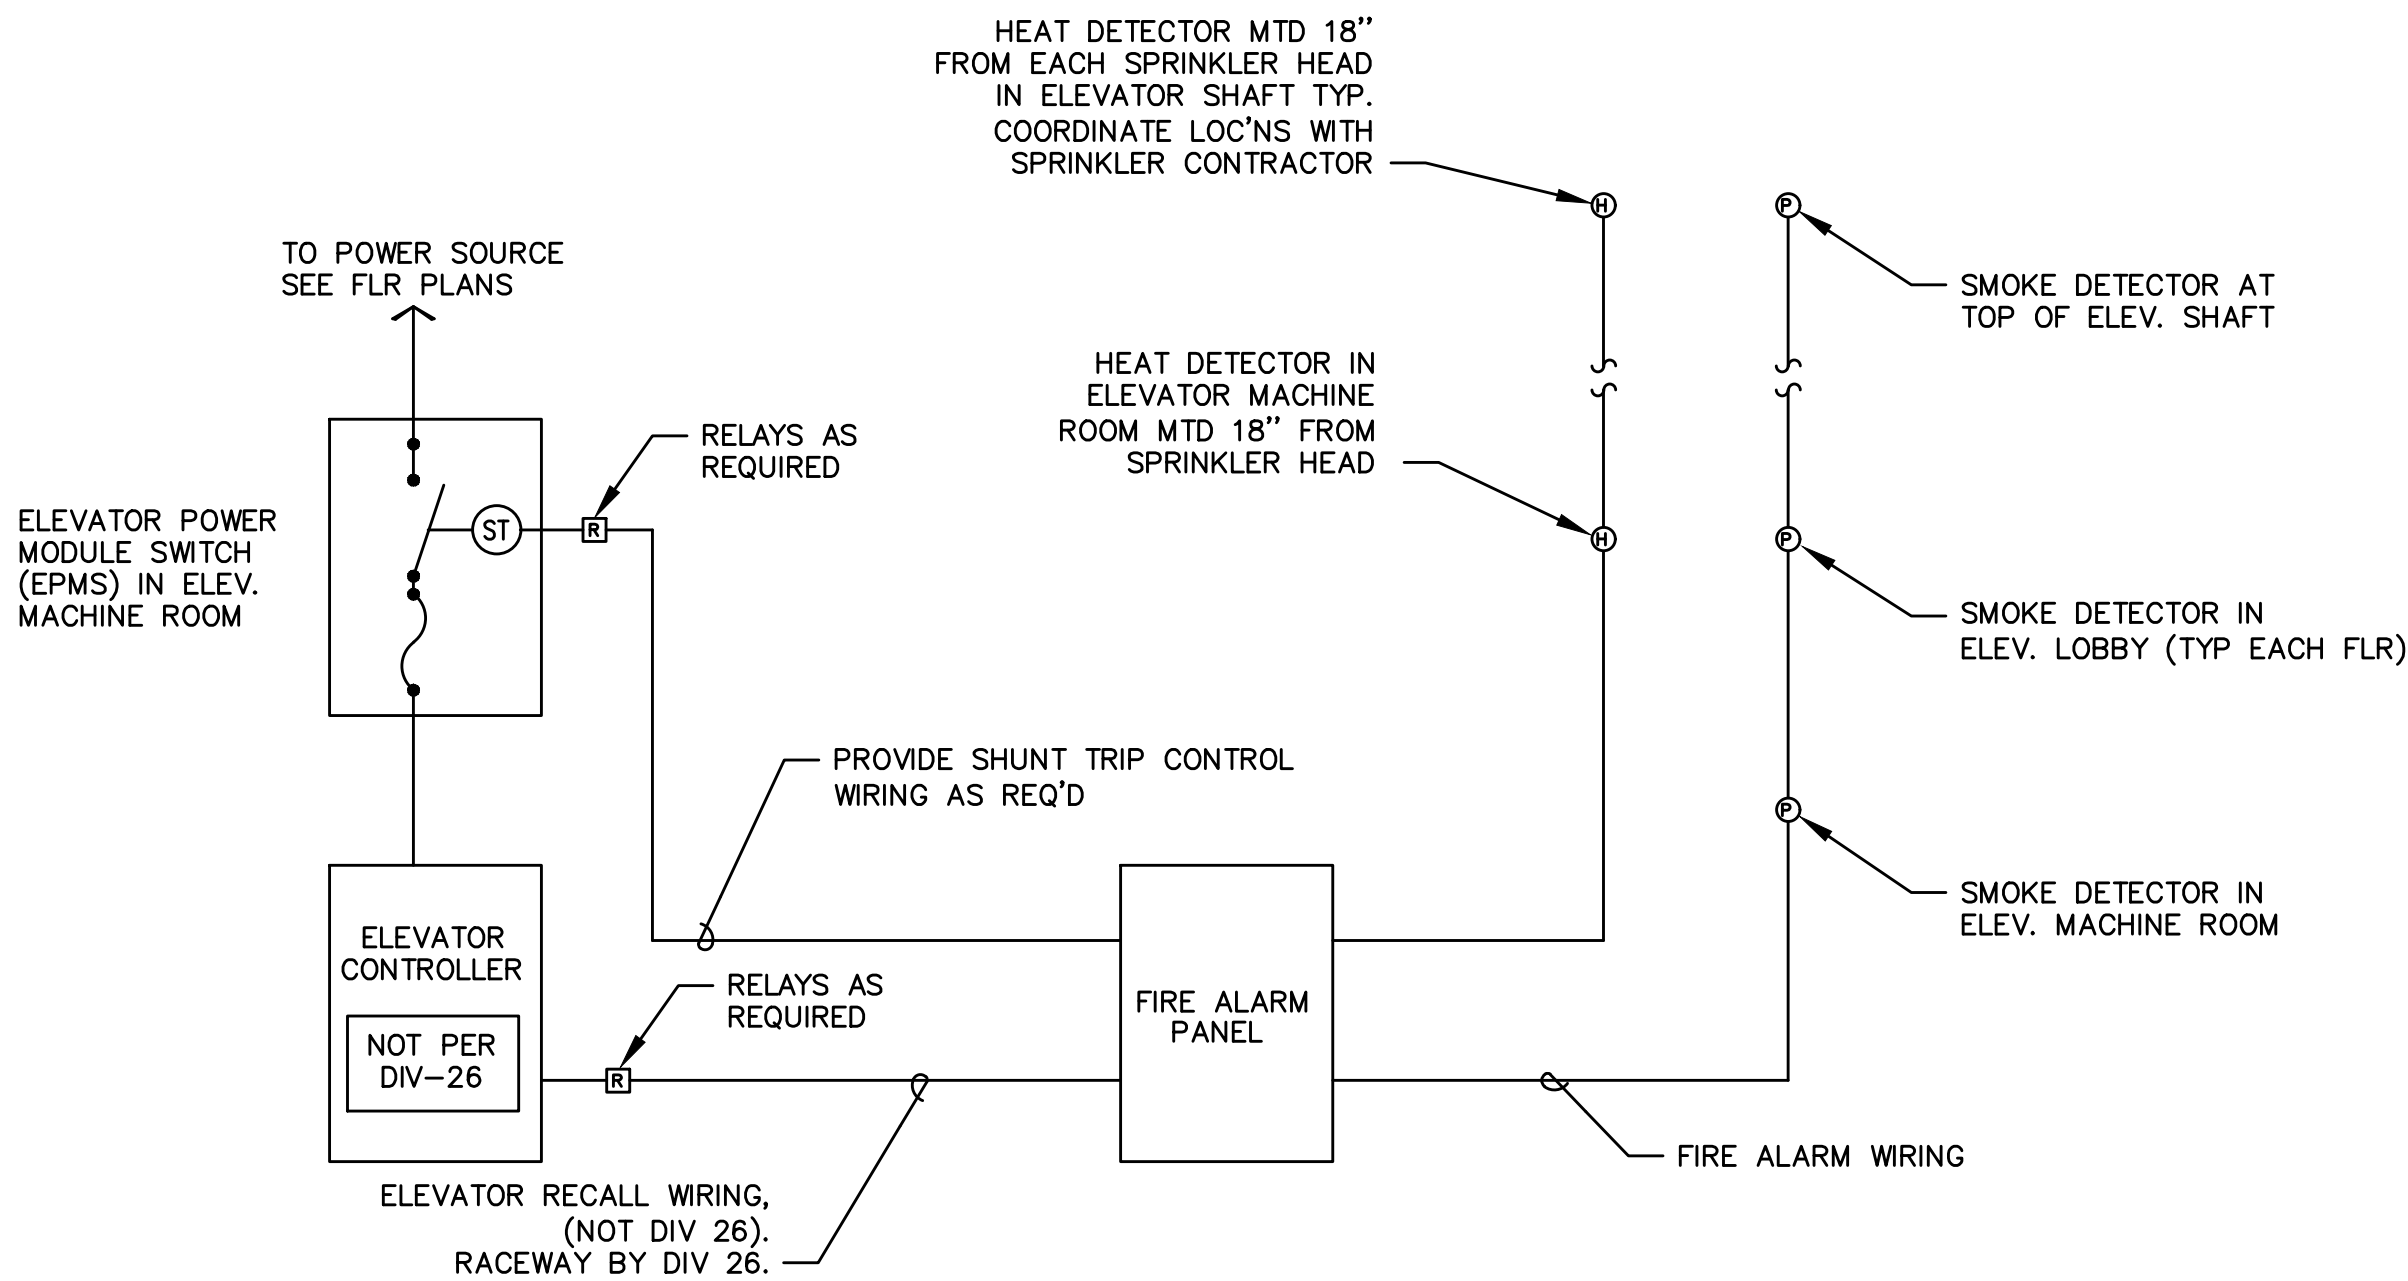


NOTES

1. CONNECT HEAT DETECTORS IN MACHINE RM AND ELEVATOR SHAFT SUCH THAT AN ALARM CONDITION WILL ACTIVATE SHUNT TRIP DEVICE IN 'EMPS'.
2. CONNECT SMOKE DETECTORS IN MACHINE ROOM, ELEVATOR LOBBYS, AND ELEVATOR SHAFT SUCH THAT AN ALARM CONDITION WILL ACTIVATE ELEVATOR RECALL SYSTEM. COORDINATE WITH ELEVATOR SUPPLIER.

2 ELEVATOR RECALL & AUTO DISCONNECT DETAIL

T2.01 SCALE: NOT TO SCALE

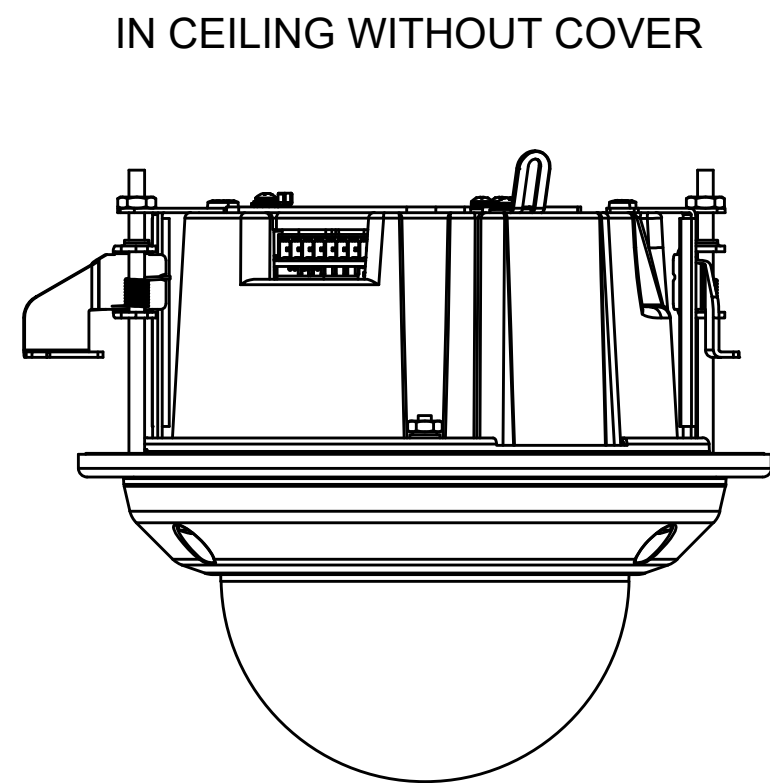

FIRE ALARM AND DETECTION SYSTEM SHOWN ON PLAN(S) ARE FOR DESIGN INTENT ONLY. THIS IS A DEFERRED SUBMITTAL SYSTEM REQUIRING THE CONTRACTOR TO COMPLETE THE PERMIT READY DESIGN AND CALCULATIONS AS REQUIRED PER THE AUTHORITY HAVING JURISDICTION. VERIFY BUILDING OCCUPANCY TYPE AND OCCUPANT LOAD WITH ARCHITECTURAL PLANS.

M Consulting Engineers
E 2007 S.E. Ash St.
A Portland, OR 97214
INC. PHN: (503) 234-0548
FAX: (503) 234-0677
CONTACT: GARY ADOVNIK

PRELIMINARY
NOT FOR
CONSTRUCTION



CARLETON HART ARCHITECTURE P.C.
830 SW 10th Avenue #200 Portland Oregon 97206
503 243 2252 | www.carlethonhart.com

SUSAN EMMONS - NORTH BUILDING
624 NW 18TH AVENUE, PORTLAND, OR

NORTHWEST HOUSING ALTERNATIVES

CONSTRUCTION DOCUMENT
CHECK SET

TECHNOLOGY
DETAILS

PROJECT NO.
17004

07/06/2020

REVISIONS: A

PRELIMINARY
NOT FOR
CONSTRUCTION

T2.01

NOTE: DRAWINGS ARE AT HALF SCALE WHEN PRINTED AT 11X17
COPYRIGHT: CARLETON HART ARCHITECTURE DO NOT REPRODUCE WITHOUT PERMISSION