



PLAN NOTES

- EXISTING CRITICAL BRANCH DISTRIBUTION BOARD "4LC1".
- EXISTING EQUIPMENT BRANCH DISTRIBUTION BOARD "MEP".
- EXISTING LIFE SAFETY BRANCH DISTRIBUTION BOARD "LSDP".
- EXISTING NORMAL BRANCH SUB-DISTRIBUTION BOARD "4N3".
- FOUR SECTION BARRIERED PULL VAULT WITH HEAVY-TRAFFIC RATED LID.
- EXISTING DIRECT-BURY PRIMARY LINE TO BE ABANDONED IN PLACE.
- REMOVE EXISTING TRANSFORMER PAD. COORDINATE REMOVAL OF EXISTING PADMOUNT TRANSFORMER WITH UTILITY.
- EXISTING (5) 4"C.
- INTERCEPT EXISTING (5) 4"C AND RE-ROUTE TO NEW TRANSFORMER VAULT AS SHOWN.
- NEW TRANSFORMER PAD/VAULT PER UTILITY REQUIREMENTS.
- PROTECTIVE REMOVABLE BOLLARD PER UTILITY REQUIREMENTS. TYPICAL OF 3.
- PRIMARY LINE TO BE INSTALLED BY UTILITY.
- PROPOSED ROUTE FOR UNDERGROUND FEEDERS TO PHASE 1 PENTHOUSE. SEE ONE-LINE DIAGRAM FOR SPECIFIC FEEDER REQUIREMENTS.
- EXISTING CATV AND TELEPHONE PEDESTALS TO REMAIN.
- COORDINATE FEEDER BURY DEPTH WITH ARCHITECT TO AVOID CONFLICTS WITH FUTURE BUILDING FOOTINGS.
- EXISTING CRITICAL BRANCH DISTRIBUTION BOARD "CDP-208".

1 ELECTRICAL SITE PLAN  
E1.11 SCALE: 1/32" = 1'-0"

M Consulting Engineers  
2007 S.E. Ash St.  
Portland, OR 97214  
PH: (503) 234-0548  
FAX: (503) 234-0677  
INC. WWW.MFA-ENG.COM  
CONTACT: CHRIS WINER

ELECTRICAL  
SITE PLAN

E1.11

SLCH - ED and Surgery

Samaritan Health Services: Lebanon Community Hospital


525 N. Santiam Highway, Lebanon, OR 97355



ISSUE DATE: 06.05.2015

REVISIONS:

8/20/15

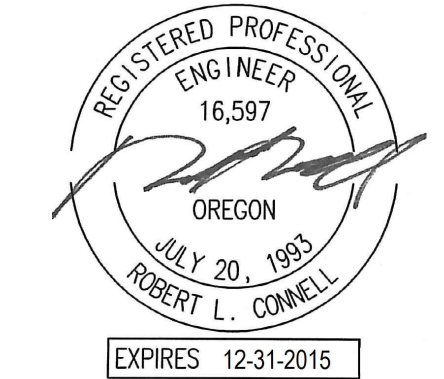

CLARK KJOS  
ARCHITECTS, LLC

333 NW 5th Ave.  
Portland, OR 97209  
Phone: 503/224-4848  
Fax: 503/224-7116

Permit Set