

## Submittal Form

ARCHITECT

ENGINEER

## AHSC

(Project)

Submittal No. 001

**Description:** Common HVAC Materials

**Date:** 07/17/17 **Return By:** 07/31/17

Division: 23

Section: 23 05 00

Andersen

Subcontract/Supplier:

The review by O'Neill Walsh Community Builders ("OWCB") of the above Submittal shall not relieve Subcontractor/Supplier from any of its obligations under the agreement with OWCB nor give rise to any claim in favor of the Subcontractor/Supplier or third parties against OWCB or Owner.

**By:** Logan Bright

O'Neill Walsh Community Builders

Notes:

No Exception taken.

Checking is only for general conformance with the design concept of the project and general compliance with the information given in the contact documents. Any action shown is subject to the requirements of the plans and specifications. Contractor is responsible for: Dimensions, which shall be confirmed and correlated at the job site; fabrication processes and techniques of construction; coordination of his work with that of all other trades; and the satisfactory performance of his work.

MFIA, Inc. Consulting Engineers

By: Takako Baker, Date: 7/24/17

Notes:

See attached for submtital review letter.



**"Your Green Heating & Cooling Professionals  
Dedicated to Serving Your and Your Community"**

## **HVAC Submittals**

**Asian Health & Service Center  
9005 SE Foster Rd.  
Portland, OR 97266**

**General Contractor  
O'Neill / Walsh Community Builders  
2905 SW First Avenue  
Portland, OR 97201**

**Submitted By  
Andersen Mechanical  
16285 SW 85<sup>th</sup> Ave, Suite 410  
Tigard, OR 97224**

***Andersen Mechanical – 16285 SW 85<sup>th</sup> Ave, Suite 410 – Tigard, OR 97224 (503)992-6664  
WA License ANDERH1936QL : OR CCB 168214 : OR Plumbing License PB1464  
MBE Certification #8561***



"Your Green Heating & Cooling Professionals  
Dedicated to Serving Your and Your Community"

## HVAC Submittal Index

<u>23 05 00</u>	<u>Common HVAC Materials and Methods</u>
<u>23 05 48</u>	<u>Mechanical Sound &amp; Vibration Control</u>
<u>23 05 90</u>	<u>Testing, Adjusting and Balancing</u>
<u>23 07 00</u>	<u>HVAC Insulation</u>
<u>23 23 00</u>	<u>Refrigerant Piping System</u>
<u>23 30 48</u>	<u>Air Distribution</u>
<u>23 34 90</u>	<u>HVAC Fans</u>
<u>23 74 00</u>	<u>Packaged HVAC Units</u>
<u>23 77 00</u>	<u>VRV Heat Recovery</u>
<u>23 80 00</u>	<u>Terminal HVAC Equipment</u>



23\_05\_00

## Common HVAC Materials and Methods



**FR Series****Fire Rated Wall Access Doors**

**Doors** are Fire Rated by Underwriters Laboratories Inc., for 1-1/2 hours, "B" Label, ANSI-UL 10B standard, and CAN/ULC S104 for 2 hours in walls. Door has a heavy duty spring closer to assure positive latching when panel closes. ***This door is for wall installation only.***

**Door and Frame** are fabricated from 16 gage, galvanized steel with a white prime coat finish.

**Door** has a heavy duty spring to assure positive latching.

**Frame** is equipped with both masonry anchors and bolt holes to facilitate installation in all types of wall construction.

**Concealed Hinge** operates completely out of sight so that only the door and frame is visible.

**Exterior Latch** is recessed and is operated using a ring attached to the sliding bolt.

**Interior Latch Release Slide** is included enabling door to be opened from the inside.

**Finish** is a white prime coat suitable for painting.

**Guide Specification**

Provide Elmdor® FR Series, Fire Rated Access Doors (specify model number and options). Access door and frame shall be fabricated from 16 gage, galvanized steel with a white prime coat finish. Hinge shall be concealed type. Door shall have a heavy duty spring to provide positive latching when closed and an interior latch release slide enabling door to be opened from the inside. Exterior latch shall be recessed and operated using ring attached to the sliding bolt. Finish shall be a white prime coat suitable for painting.



Member of U.S. Green  
Building Council

**FR**

Revised: 10/25/16

Recyclable  
Product

**MODEL NUMBER AND OPTIONS SELECTION**
**BASE MODEL NUMBER**
☐ FR Fire Rated Access Door

**Suffix Options**

- ☐ -CL Cylinder Lock (one per door)  
☐ -CLD Cylinder Lock with Dust Shutter (one per door)  
☐ -SS Stainless Steel Construction (Type 304 No. 4 Satin Finish)



**STANDARD AVAILABLE SIZES**

Special sizes available upon request.

NOMINAL DOOR SIZE (W X H)	WALL OPENING (minimum required)	LATCHES	WEIGHT
FR 8" x 8"	8-3/8" x 8-3/8"	1	6 lbs.
FR 10" x 10"	10-3/8" x 10-3/8"	1	7.5 lbs.
FR 12" x 12"	12-3/8" x 12-3/8"	1	9 lbs.
FR 12" x 18"	12-3/8" x 18-3/8"	1	10.5 lbs.
FR 12" x 24"	12-3/8" x 24-3/8"	1	13 lbs.
FR 14" x 14"	14-3/8" x 14-3/8"	1	10 lbs.
FR 16" x 16"	16-3/8" x 16-3/8"	1	12.5 lbs.
FR 18" x 18"	18-3/8" x 18-3/8"	1	15 lbs.
FR 20" x 20"	20-3/8" x 20-3/8"	1	18 lbs.
FR 22" x 22"	22-3/8" x 22-3/8"	1	22 lbs.
FR 22" x 30"	22-3/8" x 30-3/8"	2	28 lbs.
FR 24" x 24"	24-3/8" x 24-3/8"	2	24.5 lbs.
FR 24" x 36"	24-3/8" x 36-3/8"	2	33 lbs.
FR 24" x 48"	24-3/8" x 48-3/8"	2	42 lbs.
FR 30" x 30"	30-3/8" x 30-3/8"	2	33.5 lbs.
FR 32" x 32"	32-3/8" x 32-3/8"	2	35 lbs.
FR 36" x 36"	36-3/8" x 36-3/8"	2	43 lbs.
FR 36" x 48"	36-3/8" x 48-3/8"	2	74 lbs.

**NOTES:**

1. CHIP OUT MASONRY TO CLEAR BOLT COVER
2. CONCEALED HINGE
3. DOOR
4. RECESSED LATCH
5. INTERIOR LATCH RELEASE SLIDE
6. CLOSING SPRING
7. FRAME

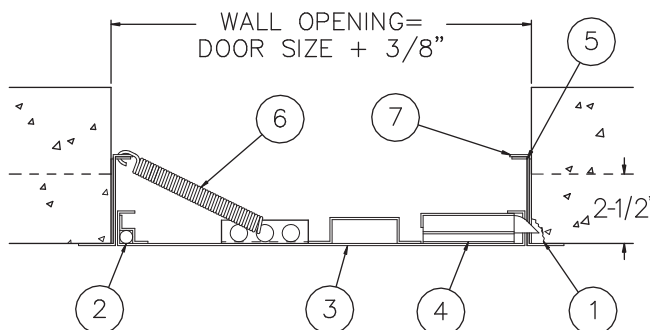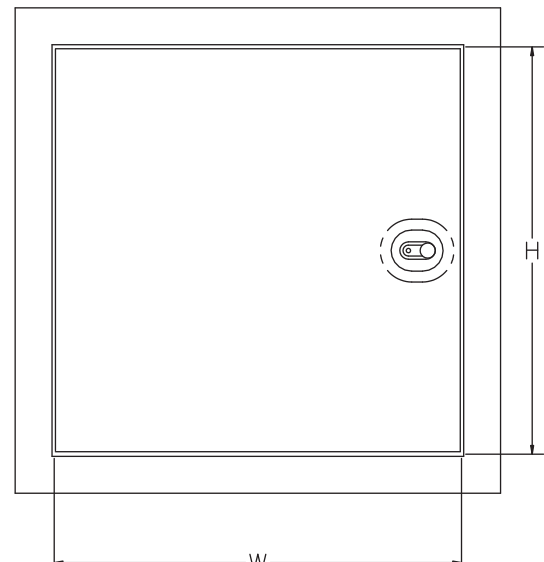
**SIDE VIEW**

**FRONT VIEW**

Dimensions are subject to manufacturer's tolerance of plus or minus 1/4". Elmdor/Stoneman assumes no responsibility for use of void or suspended data. Please visit [www.elmdorstoneman.com](http://www.elmdorstoneman.com) for most current specifications. © Copyright 2009 Elmdor/Stoneman, City of Industry, CA, A Division of Acorn Engineering Company.

**SELECTION SUMMARY & APPROVAL FOR MANUFACTURING**

Model Number & Options \_\_\_\_\_ Quantity \_\_\_\_\_  
 Company \_\_\_\_\_ Date \_\_\_\_\_  
 Contact \_\_\_\_\_ Title \_\_\_\_\_  
 Approval for Manufacturing/Signature \_\_\_\_\_

**FR**

Revised: 10/25/16

### CFR Series



#### Ceiling Fire Resistant Access Doors

**Doors** are designed for use in a suspended dry wall ceiling as part of a fire rated ceiling assembly. The CFR Series door, itself, **is not fire rated**. However, the combination of steel and fire rated tile maintains the fire resistant quality of the ceiling assembly. Door is recessed 1-1/2" to accommodate dual layered ceiling tile.

**Door** is fabricated from 16 gage, galvanized steel with a white prime coat finish.

**Frame** is fabricated from 18 gage, galvanized steel with a white prime coat finish.

**Hinge** is a continuous piano type.

**Latch** is screwdriver operated.

#### Guide Specification

Provide Elmdor® CFR Series, ceiling fire resistant access doors (specify model number and options). Access door frame shall be fabricated from 16 gage steel. Access door panel shall be fabricated from 18 gage steel. Door shall be recessed 1-1/2" to accept ceiling tile. Hinge shall be continuous piano type. Latch shall be screwdriver operated.



Member of U.S. Green  
Building Council

CFR

Revised: 10/25/16

Recyclable  
Product



**MODEL NUMBER AND OPTIONS SELECTION**
**BASE MODEL NUMBER**
☐ CFR Ceiling Fire Resistant Access Door

**Suffix Options**

- ☐ -AKL Allen Key Latch
- ☐ -CL Cylinder Lock (one per door)
- ☐ -CLD Cylinder Lock with Dust Shutter (one per door)
- ☐ -SS Stainless Steel Construction (Type 304 No. 4 Satin Finish)



**STANDARD AVAILABLE SIZES**

Special sizes available upon request.

<b>NOMINAL DOOR SIZE (W X H)</b>	<b>CEILING OPENING</b>	<b>LATCHES</b>	<b>WEIGHT</b>
CFR 12" x 12"	10-1/2" x 10-1/2"	1	7.3 lbs.
CFR 18" x 18"	16-1/2" x 16-1/2"	2	12.5 lbs.
CFR 24" x 24"	22-1/2" x 22-1/2"	2	21.8 lbs.
CFR 22" x 30"	20-1/2" x 28-1/2"	4	26.0 lbs.

**NOTES:**

1. DOOR
2. SCREWDRIVER OPERATED LATCH
3. MOUNTING HOLES
4. CONCEALED HINGE

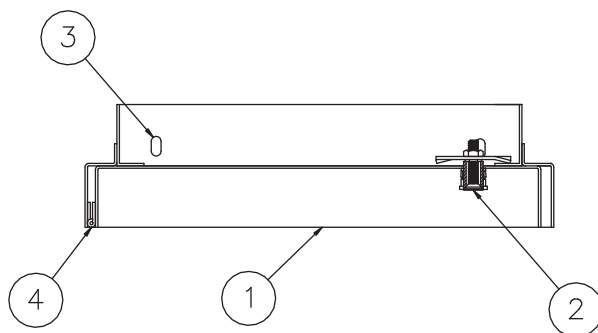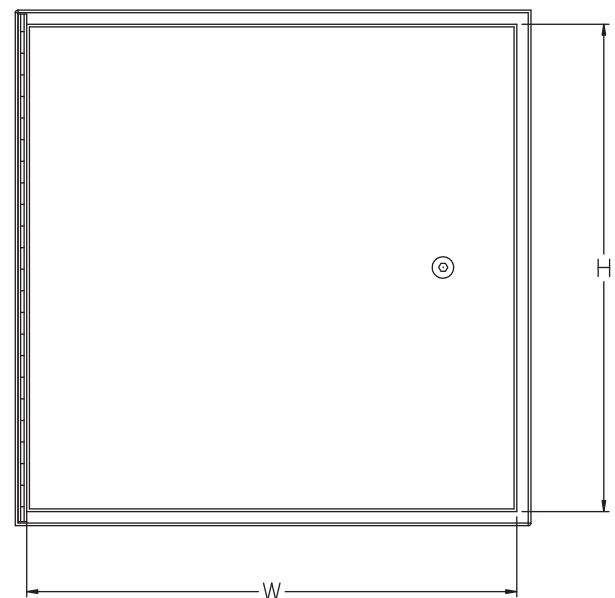
**SIDE VIEW**

**FRONT VIEW**

Dimensions are subject to manufacturer's tolerance of plus or minus 1/4". Elmdor/Stoneman assumes no responsibility for use of void or suspended data. Please visit [www.elmdorstoneman.com](http://www.elmdorstoneman.com) for most current specifications. © Copyright 2009 Elmdor/Stoneman, City of Industry, CA, A Division of Acorn Engineering Company.


**SELECTION SUMMARY & APPROVAL FOR MANUFACTURING**

Model Number & Options \_\_\_\_\_ Quantity \_\_\_\_\_  
 Company \_\_\_\_\_ Date \_\_\_\_\_  
 Contact \_\_\_\_\_ Title \_\_\_\_\_  
 Approval for Manufacturing/Signature \_\_\_\_\_

**CFR**

Revised: 10/25/16

**HYDRA-ZORB**

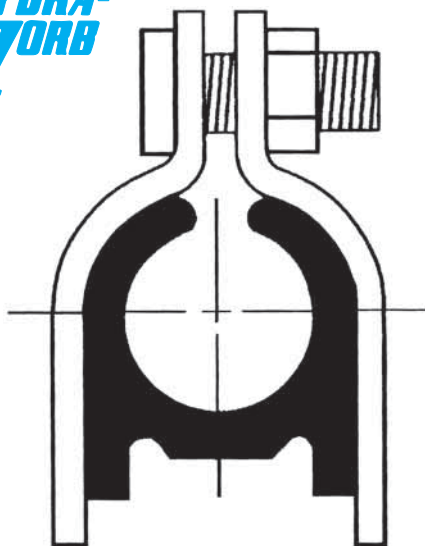


### FS-1400 SERIES HYDRA-ZORB CUSHION CLAMPS

Part No.	CT Size	Copper & Steel Tube O.D. Size
FS-1400-025.....	1/8"	1/4"
FS-1400-037.....	1/4"	3/8"
FS-1400-050.....	3/8"	1/2"
FS-1400-062.....	1/2"	5/8"
FS-1400-075.....	5/8"	3/4"
FS-1400-087.....	3/4"	7/8"
FS-1400-112.....	1"	1-1/8"
FS-1400-137.....	1-1/4"	1-3/8"
FS-1400-162.....	1-1/2"	1-5/8"
FS-1400-212.....	2"	2-1/8"
FS-1400-262.....	2-1/2"	2-5/8"
FS-1400-312.....	3"	3-1/8"
FS-1400-362.....	3-1/2"	3-5/8"
FS-1400-412.....	4"	4-1/8"

Contact Factory For Additional Sizes

Part No.	Nom. Pipe Size	Part No.	Nom. Pipe Size
FS-1400P-025.....	1/4"	FS-1400P-200.....	2"
FS-1400P-037.....	3/8"	FS-1400P-250.....	2-1/2"
FS-1400P-050.....	1/2"	FS-1400P-300.....	3"
FS-1400P-075.....	3/4"	FS-1400P-350.....	3-1/2"
FS-1400P-100.....	1"	FS-1400P-400.....	4"
FS-1400P-125.....	1-1/4"	FS-1400P-500.....	5"
FS-1400P-150.....	1-1/2"	FS-1400P-600.....	6"

Contact Factory For Additional Sizes

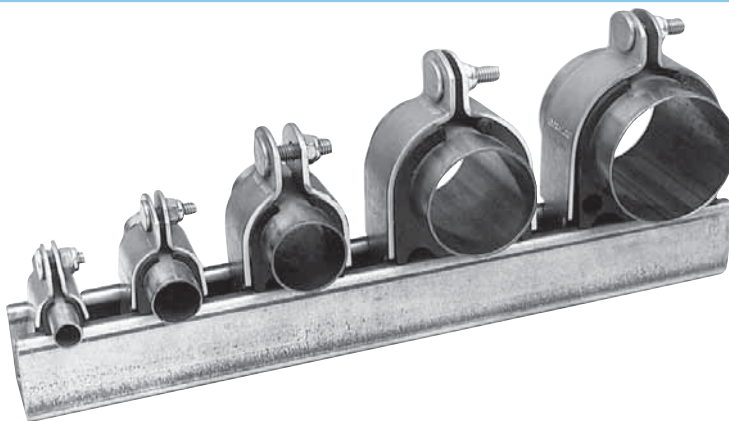


### HYDRA-ZORB CUSHION CLAMP ASSEMBLIES FOR PIPES, TUBES, AND HOSES.

- Reduce noise, shock and vibration caused by fluid surges in tubes, pipes, and hoses used in the construction of stationery and mobile equipment.
- Eliminate metal to metal contact between fluid conductors and clamps.
- Resist most fuels, oils, gases, greases, solvents, mineral acids, etc.
- Allow fluid conductors to be added or removed from installations without disturbing adjacent conductors.
- Permit various fluid conductors to be mixed to suit installation.
- Allow center distances between fluid conductors to be variable and not critical for compact installation.
- Are usable to temperatures down to -65°F and up to 275°F.
- Provide fast and simple installation. Only one man and one tool needed for assembly after base channel is in place.

**Standard Finish – electro-galvanized with yellow chromate rinse**  
Also available in stainless steel, 304 or 316, aluminum and hot dip galvanized.



### FLEX-WRAP - FS-3792





25 FT / Box

# STAINLESS STEEL TWO HOLE STRAPS



## APPLICATION

- Used to mount conduit systems flat against walls and other surfaces to provide extra support
- Manufactured in stainless steel to help prevent corrosion
- Can be installed using ordinary hand tools and require little maintenance or repair
- Provided in a bright, polished finish that does not require touch up or painting

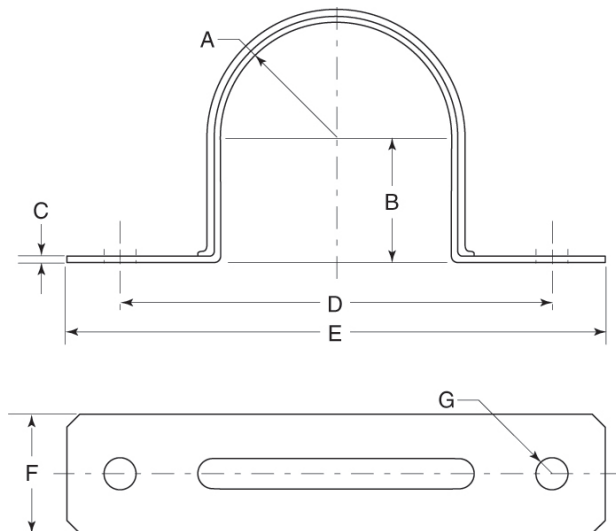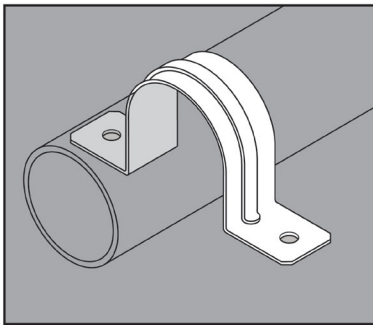

## PRODUCT DETAILS

### Material:

316 SS

### Standards:

ASTM A240

### Country of Origin:

100% Made in USA

Part Number	Pipe/Rigid Conduit Size	Weight/ 100 (lbs.)	Dimension (in.)						
			A	B	C	D	E	F	G
3038-2	3/8 in.	2	0.35	0.32	.024 - .030	1.56	2.00	0.50	0.19
3050-2	1/2 in.	2	0.42	0.39	.024 - .030	1.78	2.25	0.56	0.19
3075-2	3/4 in.	3	0.52	0.50	.024 - .030	2.18	2.62	0.62	0.19
3100-2	1 in.	4	0.65	0.62	.033 - .038	2.53	3.20	0.75	0.25
3125-2	1-1/4 in.	6	0.83	0.80	.033 - .038	3.16	4.00	0.87	0.25
3150-2	1-1/2 in.	9	0.95	0.92	.043 - .050	3.37	4.20	0.93	0.25
3200-2	2 in.	11	1.18	1.15	.043 - .050	4.25	5.12	1.00	0.38
3250-2	2-1/2 in.	16	1.43	1.40	.053 - .060	4.95	5.87	1.00	0.38
3300-2	3 in.	20	1.75	1.70	.053 - .060	5.50	6.50	1.00	0.38
3350-2	3-1/2 in.	26	2.00	1.95	.068 - .075	6.18	7.12	1.00	0.44
3400-2	4 in.	29	2.25	2.20	.068 - .075	6.81	7.75	1.00	0.44



© 2015 GIBSON STAINLESS & SPECIALTY, INC. - REV 12/2015

PO BOX 847, GREENSBURG, PA 15601  
PHONE: 1-800-945-4316 • FAX: 724-838-1544

WEB: GIBSONSTAINLESS.COM





# FASTENERS THREADED ROD

Threaded rod is used for general purpose fastening and installation. Used in any place that a long bolt is required, threaded rod can be cut to the exact desired length. Common applications include sprinkler systems, H.V.A.C., suspended ceilings, ductwork, lighting, electrical systems, and concrete form work.

## Color Coded Labels & Tube End Caps



-  Bright Unplated
-  Hot Dipped Galvanized
-  Zinc Plated
-  Stainless Steel

- ☒ Right hand coarse thread
- ☒ Low carbon steel
- ☒ Conforms to ASTM A307
- ☒ Available in a wide variety of dimensions, lengths, and finishes
- ☒ Rolled thread to UNC Class 1A



### Threaded Rod - Bright Unplated

Size	Threads per Inch	Weight per Piece	Pieces per Tube	Tubes per Pallet	Pallets per 20 ft. Container	SKU
3/8" x 6'	16	1.69 lb.	25	50	19	AT38072
3/8" x 10'	16	2.82 lb.	25	40	15	AT38120
3/8" x 12'	16	3.39 lb.	25	40	12	AT38144
1/2" x 6'	13	3.03 lb.	12	50	22	AT12072
1/2" x 10'	13	5.06 lb.	12	40	15	AT12120
1/2" x 12'	13	6.07 lb.	12	40	13	AT12144
5/8" x 6'	11	5.06 lb.	8	50	21	AT58072
5/8" x 10'	11	8.44 lb.	8	40	15	AT58120
5/8" x 12'	11	10.13 lb.	8	40	13	AT58144
3/4" x 6'	10	7.30 lb.	5	50	23	AT34072
3/4" x 10'	10	12.17 lb.	5	40	15	AT34120
3/4" x 12'	10	14.61 lb.	5	40	14	AT34144
7/8" x 6'	9	10.00 lb.	4	50	21	AT78072
7/8" x 10'	9	16.68 lb.	4	40	15	AT78120
7/8" x 12'	9	20.01 lb.	4	40	13	AT78144
1" x 6'	8	13.13 lb.	3	50	21	AT1072
1" x 10'	8	21.89 lb.	3	40	15	AT1120
1" x 12'	8	26.26 lb.	3	40	13	AT1144
1-1/8" x 6'	7	20.84 lb.	2	50	25	AT118072
1-1/8" x 10'	7	34.73 lb.	2	40	15	AT118120
1-1/8" x 12'	7	41.70 lb.	2	40	15	AT118144
1-1/4" x 6'	7	21.39 lb.	2	50	20	AT114072
1-1/4" x 10'	7	35.64 lb.	2	40	15	AT114120
1-1/4" x 12'	7	42.77 lb.	2	40	12	AT114144
1-1/2" x 6'	6	30.31 lb.	1	50	27	AT112072
1-1/2" x 10'	6	50.52 lb.	1	40	15	AT112120
1-1/2" x 12'	6	60.62 lb.	1	40	15	AT112144

### Threaded Rod - Hot Dipped Galvanized ASTM A153 or F2329

Size	Threads per Inch	Weight per Piece	Pieces per Tube	Tubes per Pallet	Pallets per 20 ft. Container	SKU
3/8" x 6'	16	1.69 lb.	25	50	19	ATHG38072
3/8" x 10'	16	2.82 lb.	25	40	15	ATHG38120
3/8" x 12'	16	3.39 lb.	25	40	12	ATHG38144
1/2" x 6'	13	3.03 lb.	12	50	22	ATHG12072
1/2" x 10'	13	5.06 lb.	12	40	15	ATHG12120
1/2" x 12'	13	6.07 lb.	12	40	13	ATHG12144
5/8" x 6'	11	5.06 lb.	8	50	21	ATHG58072
5/8" x 10'	11	8.44 lb.	8	40	15	ATHG58120
5/8" x 12'	11	10.13 lb.	8	40	13	ATHG58144
3/4" x 6'	10	7.30 lb.	5	50	23	ATHG34072
3/4" x 10'	10	12.17 lb.	5	40	15	ATHG34120
3/4" x 12'	10	14.61 lb.	5	40	14	ATHG34144
7/8" x 6'	9	10.00 lb.	4	50	21	ATHG78072
7/8" x 10'	9	16.68 lb.	4	40	15	ATHG78120
7/8" x 12'	9	20.01 lb.	4	40	13	ATHG78144
1" x 6'	8	13.13 lb.	3	50	21	ATHG1072
1" x 10'	8	21.89 lb.	3	40	15	ATHG1120
1" x 12'	8	26.26 lb.	3	40	13	ATHG1144
1-1/8" x 6'	7	20.84 lb.	2	50	25	ATHG118072
1-1/8" x 10'	7	34.73 lb.	2	40	15	ATHG118120
1-1/8" x 12'	7	41.70 lb.	2	40	15	ATHG118144
1-1/4" x 6'	7	21.39 lb.	2	50	20	ATHG114072
1-1/4" x 10'	7	35.64 lb.	2	40	15	ATHG114120
1-1/4" x 12'	7	42.77 lb.	2	40	12	ATHG114144
1-1/2" x 6'	6	30.31 lb.	1	50	27	ATHG112072
1-1/2" x 10'	6	50.52 lb.	1	40	15	ATHG112120
1-1/2" x 12'	6	60.62 lb.	1	40	15	ATHG112144



# FASTENERS THREADED ROD

## Threaded Rod - Zinc Plated ASTM F1941 FeZn3A

Size	Threads per Inch	Weight per Piece	Pieces per Tube	Tubes per Pallet	Pallets per 20 ft. Container	SKU
1/4" x 6'	20	0.71 lb.	50	50	23	ATZ14072
1/4" x 10'	20	1.18 lb.	50	40	15	ATZ14120
1/4" x 12'	20	1.41 lb.	50	40	14	ATZ14144
5/16" x 6'	18	1.21 lb.	35	50	20	ATZ516072
5/16" x 10'	18	2.02 lb.	35	40	15	ATZ516120
5/16" x 12'	18	2.43 lb.	35	40	12	ATZ516144
3/8" x 6'	16	1.69 lb.	25	50	19	ATZ38072
3/8" x 10'	16	2.82 lb.	25	40	15	ATZ38120
3/8" x 12'	16	3.39 lb.	25	40	12	ATZ38144
1/2" x 6'	13	3.03 lb.	12	50	22	ATZ12072
1/2" x 10'	13	5.06 lb.	12	40	15	ATZ12120
1/2" x 12'	13	6.07 lb.	12	40	13	ATZ12144
5/8" x 6'	11	5.06 lb.	8	50	21	ATZ58072
5/8" x 10'	11	8.44 lb.	8	40	15	ATZ58120
5/8" x 12'	11	10.13 lb.	8	40	13	ATZ58144
3/4" x 6'	10	7.30 lb.	5	50	23	ATZ34072
3/4" x 10'	10	12.17 lb.	5	40	15	ATZ34120
3/4" x 12'	10	14.61 lb.	5	40	14	ATZ34144
7/8" x 6'	9	10.00 lb.	4	50	21	ATZ78072
7/8" x 10'	9	16.68 lb.	4	40	15	ATZ78120
7/8" x 12'	9	20.01 lb.	4	40	13	ATZ78144
1" x 6'	8	13.13 lb.	3	50	21	ATZ1072
1" x 10'	8	21.89 lb.	3	40	15	ATZ1120
1" x 12'	8	26.26 lb.	3	40	13	ATZ1144
1-1/8" x 6'	7	20.84 lb.	2	50	25	ATZ118072
1-1/8" x 10'	7	34.73 lb.	2	40	15	ATZ118120
1-1/8" x 12'	7	41.70 lb.	2	40	15	ATZ118144
1-1/4" x 6'	7	21.39 lb.	2	50	20	ATZ114072
1-1/4" x 10'	7	35.64 lb.	2	40	15	ATZ114120
1-1/4" x 12'	7	42.77 lb.	2	40	12	ATZ114144
1-1/2" x 6'	6	30.31 lb.	1	50	27	ATZ112072
1-1/2" x 10'	6	51.52 lb.	1	40	15	ATZ112120
1-1/2" x 12'	6	60.62 lb.	1	40	15	ATZ112144

## Threaded Rod - Stainless Steel

Size	Threads per Inch	Weight per Piece	Pieces per Tube	Tubes per Pallet	Pallets per 20 ft. Container	SKU
1/4" x 6'	20	0.78 lb.	50	50	23	ATSS14072
1/4" x 10'	20	1.30 lb.	50	40	15	ATSS14120
1/4" x 12'	20	1.56 lb.	50	40	14	ATSS14144
5/16" x 6'	18	1.28 lb.	35	50	20	ATSS516072
5/16" x 10'	18	2.13 lb.	35	40	15	ATSS516120
5/16" x 12'	18	2.56 lb.	35	40	12	ATSS516144
3/8" x 6'	16	1.86 lb.	25	50	19	ATSS38072
3/8" x 10'	16	3.10 lb.	25	40	15	ATSS38120
3/8" x 12'	16	3.73 lb.	25	40	12	ATSS38144
1/2" x 6'	13	3.34 lb.	12	50	21	ATSS12072
1/2" x 10'	13	5.56 lb.	12	40	15	ATSS12120
1/2" x 12'	13	6.67 lb.	12	40	13	ATSS12144
5/8" x 6'	11	5.57 lb.	8	50	20	ATSS58072
5/8" x 10'	11	9.28 lb.	8	40	15	ATSS58120
5/8" x 12'	11	11.14 lb.	8	40	12	ATSS58144
3/4" x 6'	10	8.04 lb.	5	50	22	ATSS34072
3/4" x 10'	10	13.39 lb.	5	40	15	ATSS34120
3/4" x 12'	10	16.07 lb.	5	40	14	ATSS34144

## Bent Threaded Rod

Size	Threads per Inch	Weight per Piece	Pieces per Tube	Tubes per Pallet	Pallets per 20 ft. Container	SKU
1/2" x 52"	8	2.74 lb.	15	50	21	BRTZ12528



**PRIME SOURCE**  
BUILDING PRODUCTS, INC.

© 2011 PrimeSource Building Products, Inc.

800-676-7777  
www.grip-rite.com  
www.primesourcecbp.com

Grip-Rite® threaded metal rods are distributed by PrimeSource Building Products, Inc.



**Vertigo™** Rod Hangers

**PRODUCT DESCRIPTION**

Vertigo is an all steel threaded fastening system for suspending steel threaded rod vertically overhead in pipe hanging, fire protection, electrical conduit and cable-tray applications. Vertigo are available in three versions which can be installed in a variety of base materials including steel purlins, bar joists and beams, wood frame columns and beams, as well as concrete ceilings, beams and columns.

Steel threaded rods in 1/4", 3/8" and 1/2" diameters can be vertically suspended with Vertigo. In wood and steel base materials, Vertigo is also offered in a side mount style for lateral installation of 1/4" and 3/8" diameter steel threaded rods onto joists, columns and overhead members. For all steel and wood Vertigo fasteners, a universal Vertigo Socket Driver is recommended to provide proper installation with a screw gun or hammer drill. Concrete Vertigo fasteners should be installed with the appropriate size standard drive sockets and adjustable torque, battery powered screw gun or hammer drill.

**GENERAL APPLICATIONS AND USES**

- Hanging Pipe and Sprinkler Systems
- Lighting Systems and Overhead Utilities
- Suspended Ceilings
- Suspending Conduit and Cable Trays
- HVAC Ductwork and Strut Channels
- Mounting Security Equipment

**FEATURES AND BENEFITS**

- + One system for all rod hanging applications in steel, wood and concrete
- + Ease and speed of overhead installation
- + Lower in-place cost, when compared to beam clamps, lag bolts and dropins
- + Steel and wood Vertigo can be installed with a screw gun or hammer drill
- + Concrete Vertigo can be installed with an adjustable torque, battery powered screw gun or hammer drill
- + Side mount versions available for steel and wood Vertigo
- + The universal socket can be used for the steel and wood Vertigo

**APPROVALS AND LISTINGS**

FM Approvals (FM) - (see listing for applicable sizes and types).

Pipe Hangers components for automatic sprinkler systems - File No. JI 3015153

Underwriters Laboratory (UL) - (see listing for applicable sizes and types).


Pipe Hangers - File No. EX 1289

Luminaire - File No. E362339

**GUIDE SPECIFICATIONS**

**CSI Divisions:** 03 16 00 - Concrete Anchors, 05 05 19 - Post-Installed Concrete Anchors, 05 05 23 - Metal Fastenings and 06 05 23 - Wood, Plastic, and Composite Fastenings. Rod Hangers shall be Vertigo anchors as supplied by Powers Fasteners, Inc., Brewster, NY.

<b>SECTION CONTENTS</b>	<b>Page No.</b>
General Information.....	1
Installation Specifications.....	2
Material Specifications .....	2
Performance Data .....	3
Ordering Information .....	7



**Steel Vertigo**



**Wood Vertigo**



**Concrete Vertigo  
(Wedge-Bolt OT)**

**ANCHOR MATERIALS**

Zinc Plated Carbon Steel

**ANCHOR SIZE RANGE (TYP.)**

1/4" to 1/2" for Steel  
1/4" to 1/2" for Wood  
1/4" to 1/2" for Concrete

**SUITABLE BASE MATERIALS**

Steel Purlins and Beams  
Wood and Timber  
Normal-Weight concrete  
Structural Lightweight concrete  
Hollow Core Concrete Plank

## INSTALLATION SPECIFICATIONS

### Steel Vertigo

Point Style	#3	#5
Self Drilling Range	0.036" (20 gauge) – 0.188" (3/16")	0.188" (3/16") – 0.500" (1/2")
Screw Size (UNC)	1/4-20 thread	1/4-20 thread
Root Diameter (in.)	13/64	13/64
Thread Length (in.)	1-3/16" (1-1/2" screw)	31/32" (1-1/2" screw)
Flange Thickness (in.)	1/16	1/16
Drill Speed (RPM)	500-1,500	500-1,500

Install with universal steel and wood socket.

### Wood Vertigo

Screw Size	1/4" Thread Forming	5/16" Thread Forming
Pre-drill Diameter (in.) (if required)	1/8	1/8
Point Style	Type 17	Type 17
Root Diameter (in.)	3/16	7/32
Thread Length (in.)	Screw length less 5/16	Screw length less 5/16
Flange Thickness (in.)	1/16	1/16

Install with universal steel and wood socket.

### Vertigo Couplings (Steel & Wood)

Screw Size	1/4"	3/8"	1/2"	1/4"	3/8"
Coupling Size and Type	Vertical	Vertical	Vertical	Side	Side
Thread Size (UNC)	1/4-20	3/8-16	1/2-13	1/4-20	3/8-16
Thread Depth (in.)	3/8	3/8	3/8	5/8 (through)	5/8 (through)
Width (flat to flat) (in.)	5/8	5/8	5/8	5/8	5/8
Height (in.)	13/16	13/16	13/16	13/16	13/16

### Concrete Vertigo (Wedge-Bolt OT)


Rod Diameter/Anchor Size	1/4"	3/8"	1/2"
ANSI Drill Bit (in.)	1/4	1/4	3/8
Overall Screw Shank Length	1-1/4	1-1/2	2-3/4
Anchor Thread Length (in.)	1-1/8	1-3/8	2-1/2
Root Diameter (in.)	15/64	15/64	23/64
Coupling / Washer Height (in.)	27/64	9/16	53/64
Integral Washer O.D. (in.)	31/64	39/64	31/32
Coupling Thread Size (UNC)	1/4-20	3/8-16	1/2-13
Coupling Thread Depth (in.)	3/8	1/2	3/4
Socket Driver Size (in.)	3/8	1/2	11/16

Install with universal steel and wood socket.

### Installation Guidelines


When installing Vertigo fasteners, eye protection should be worn as a safety precaution.

If pre-drilling is required (certain types of wood truss/wood joist and all concrete base materials), select the recommended drill bit type and diameter. For Concrete Vertigo only, drill to the appropriate embedment depth, adding at least one diameter (1/4" to 1/2") to the drilling depth to prevent the tip of the fastener from running into a dead end at the rear of the anchor hole.




#### Concrete

Select the appropriate socket driver for the anchor size and type to be installed and mount into chuck of installation tool. Insert the Vertigo fastener into the socket driver, and install perpendicular to the base material surface. Drive the fastener with a smooth steady motion until the coupling is firmly seated against the surface of the base material.




#### Steel

Thread the appropriate diameter steel threaded rod or threaded bolt into the coupling. The threaded rod or bolt should fully engage the thread length of the coupling on a vertical mount fastener. The threaded rod or threaded portion of the bolt can pass through coupling of a side mount fastener.



#### Wood

For UL and FM listings for Pipe Hangers, Steel Vertigo should be installed with a retaining nut.



## MATERIAL SPECIFICATIONS

### Steel and Wood Vertigo

Component	Component Material
Screw Body	AISI 1018-1022 (Case Hardened)
Coupling	AISI 1018-1022 (Case Hardened)
Zinc Plating	ASTM B633, SC1, Type III (Fe/Zn5)

### Concrete Vertigo (Wedge-Bolt OT)

Component	Component Material
Anchor Body	Case Hardened 10B21 Carbon Steel
Zinc Plating	ASTM B633, SC1, Type III (Fe/Zn 5)

**PERFORMANCE DATA**

**Steel Vertigo – Ultimate Tension Load Capacities when Installed in Minimum ASTM A 36 Steel (Beams) and ASTM A 572 Steel (Purlins)<sup>1,2</sup>**

Anchor Size / Rod Diameter in. (mm)	Mount Direction	Screw Shank Size and Length	Minimum Steel Gauge (Thickness)						
			20 0.036" lbs. (kN)	18 0.048" lbs. (kN)	16 0.060" lbs. (kN)	14 0.075" lbs. (kN)	12 0.105" lbs. (kN)	3/16" 0.187" lbs. (kN)	1/4" 0.250" lbs. (kN)
1/4 (6.4)	Vertical	1/4-20 x 1" (w/nut)	1,550 (7.0)	1,550 (7.0)	1,775 (8.0)	1,775 (8.0)	2,050 (9.2)	3,850 (17.3)	-
	Vertical	1/4-20 x 1"	405 (1.8)	620 (2.8)	985 (4.4)	1,160 (5.2)	1,560 (7.0)	3,205 (14.4)	5,040 (22.7)
	Side	1/4-20 x 1" (w/nut)	1,550 (7.0)	1,550 (7.0)	1,775 (8.0)	1,775 (8.0)	2,050 (9.2)	3,850 (17.3)	-
3/8 (9.5)	Vertical	1/4-20 x 1" (w/nut)	1,550 (7.0)	1,550 (7.0)	1,775 (8.0)	1,775 (8.0)	2,050 (9.2)	3,850 (17.3)	-
	Side	1/4-20 x 1-1/2" (w/nut)	1,550 (7.0)	1,550 (7.0)	1,775 (8.0)	1,775 (8.0)	2,050 (9.2)	3,850 (17.3)	-
	Vertical	1/4-20 x 1-1/2"	405 (1.8)	620 (2.8)	985 (4.4)	1,160 (5.2)	1,560 (7.0)	3,205 (14.4)	-
	Side	1/4-20 x 1-1/2"	405 (1.8)	620 (2.8)	985 (4.4)	1,160 (5.2)	1,560 (7.0)	1,965 (8.8)	-
	Vertical	1/4-20 x 2" (w/nut)	1,550 (7.0)	1,550 (7.0)	1,775 (8.0)	1,775 (8.0)	2,050 (9.2)	3,850 (17.3)	-
1/2 (12.7)	Vertical	12-20 x 1-1/2"	495 (2.20)	710 (3.2)	920 (4.1)	1,560 (7.0)	2,050 (9.2)	3,280 (14.8)	5,040 (22.7)
	Vertical	12-20 x 1-1/2" (w/nut)	1,550 (7.0)	1,550 (7.0)	1,775 (8.0)	1,775 (8.0)	2,050 (9.2)	3,850 (17.3)	-

1. For Steel Vertigo loaded perpendicular to threaded rod (shear) the ultimate load capacity for the anchor is 1,965 lbs in nominal 20 gage steel (0.036")

**Wood Vertigo – Ultimate Tension Load Capacities when Installed in Wood Base Materials (Structural Wood and Timber)<sup>1,2</sup>**

Anchor Size / Rod Diameter in. (mm)	Mount Direction	Screw Shank Size and Length	Embedment Depth in. (mm)	Wood Member (Type)		
				Fir lbs. (kN)	Pine lbs. (kN)	Spruce lbs. (kN)
1/4 (6.4)	Vertical	1/4 x 1"	1 (25.4)	685 (3.1)	650 (2.9)	650 (2.9)
	Side	1/4 x 2"	2 (50.8)	1,510 (6.8)	1,510 (6.8)	1,510 (6.8)
3/8 (9.5)	Vertical	1/4 x 1"	1 (25.4)	685 (3.1)	650 (2.9)	650 (2.9)
	Side	1/4 x 1"	1 (25.4)	685 (3.1)	650 (2.9)	650 (2.9)
	Vertical	1/4 x 2"	2 (50.8)	1,510 (6.8)	1,510 (6.8)	1,510 (6.8)
	Side	1/4 x 2"	2 (50.8)	1,800 (8.1)	1,800 (8.1)	1,800 (8.1)
	Vertical	1/4 x 3"	3 (76.2)	2,075 (9.3)	1,510 (6.8)	1,510 (6.8)
	Vertical	1/4 x 4"	4 (101.6)	2,075 (9.3)	1,510 (6.8)	1,510 (6.8)
	Vertical	5/16" x 2-1/2"	2-1/2 (63.5)	2,670 (12.0)	3,110 (14.0)	3,110 (14.0)
	Side	3/8" x 2-1/2"	2-1/2 (63.5)	1,450 (6.5)	1,530 (6.9)	1,380 (6.2)
1/2 (12.7)	Vertical	5/16" x 2-1/2"	2-1/2 (63.5)	2,670 (12.0)	3,110 (14.0)	3,110 (14.0)

1. Truss/joist manufacturers may require pre-drilled holes with wood depending on the location of the anchor installation. Consult with the truss/joist manufacturer for details.

2. Wood Vertigo are recommended to be installed with the Universal Steel & Wood Nut Driver.

## PERFORMANCE DATA

Concrete Vertigo – Ultimate Load Capacities when Installed in Normal-Weight Concrete<sup>1,2</sup>

Anchor Size / Rod Diameter in. (mm)	Mount Direction	Screw Shank Size and Length	ANSI Drill Bit Diameter dbit in.	Embed. Depth h <sub>v</sub> in. (mm)	Minimum Concrete Compressive Strength (f' c)					
					2,000 psi (13.8 MPa)		4,000 psi (20.7 MPa)		6,000 psi (41.4 MPa)	
					Tension lbs. (kN)	Shear lbs. (kN)	Tension lbs. (kN)	Shear lbs. (kN)	Tension lbs. (kN)	Shear lbs. (kN)
1/4 (6.4)	Vertical	1/4" x 1-1/4"	1/4"	1-1/4 (31.8)	1,390 (6.3)	1,810 (8.1)	1,950 (8.8)	2,440 (11.0)	2,070 (9.3)	2,570 (11.6)
3/8 (9.5)	Vertical	1/4" x 1-1/2"	1/4"	1-1/2 (38.1)	1,760 (7.9)	2,580 (11.6)	2,595 (11.7)	2,640 (11.9)	2,770 (12.5)	2,700 (12.2)
1/2 (12.7)	Vertical	3/8" x 2-3/4"	3/8"	2-3/4 (69.9)	5,320 (23.9)	5,250 (23.6)	6,050 (27.2)	6,330 (28.5)	8,620 (38.8)	7,410 (33.0)

1. The values listed above are ultimate load capacities which should be reduced by a minimum safety factor of 4.0 or greater to determine the allowable working load.

2. Linear interpolation may be used to determine ultimate loads for intermediate compressive strengths.

Concrete Vertigo – Ultimate Load Capacities when Installed Through Metal Deck into Structural Lightweight Concrete<sup>1,2,3,4</sup>

Anchor Size / Rod Diameter d in. (mm)	Embedment Depth h <sub>v</sub> in. (mm)	Lightweight Concrete Over Minimum 20 Ga. Metal Deck f'c ≥ 3,000 psi (20.7 MPa)	
		Minimum 4 1/2" Wide Deck	
		Tension lbs. (kN)	Load at 45° lbs. (kN)
1/4 (6.4)	1-1/4 (31.8)	800 (3.6)	1,140 (5.1)
3/8 (9.5)	1-1/2 (38.1)	1,780 (8.0)	1,500 (6.8)
1/2 (12.7)	2-3/4 (69.9)	3,880 (17.5)	2,920 (13.1)

1. The values listed above are ultimate and allowable load capacities for Vertigo rod hangers installed in sand-lightweight concrete.

2. The metal deck shall be minimum No. 20 gauge thick steel [0.035-inch base metal thickness (0.89 mm)] conforming to ASTM A 653/ A 653M.

3. The values listed above are ultimate load capacities which should be reduced by a minimum safety factor of 4.0 or greater to determine the allowable working load.

4. The tabulated load values are for anchors installed with a minimum flute edge distance of 1-1/2-inch.

Concrete Vertigo – Ultimate Tension Load Capacities when Installed in Hollow Core Concrete Plank<sup>1,2</sup>

Anchor Size / Rod Diameter in. (mm)	Mount Direction	Screw Shank Size and Length	ANSI Drill Bit Diameter dbit in.	Embedment Depth h <sub>v</sub> in. (mm)	Center of Web lbs. (kN)	Center of Core lbs. (kN)
1/4 (6.4)	Vertical	1/4" x 1-1/4"	1/4"	1-1/4 (31.8)	2,775 (12.3)	1,920 (8.5)
3/8 (9.5)	Vertical	1/4" x 1-1/2"	1/4"	1-1/2 (38.1)	3,700 (16.5)	2,570 (11.4)
1/2 (12.7)	Vertical	3/8" x 2-3/4"	3/8"	2-3/4 (69.9)	8,240 (36.7)	3,480 (15.5)

1. Tabulated load values are for anchors installed in 8-inch-thick hollow core plank with minimum compressive strength of 5,000 psi at the time of installation. The 4' x 6' normal-weight concrete members features include 1-1/2" cover above and below cores and a minimum web thickness of 1-1/2".

2. The values listed above are ultimate load capacities which should be reduced by a minimum safety factor of 4.0 or greater to determine the allowable working load.

**PERFORMANCE DATA**

**Steel Vertigo – Ultimate Load Capacities for Factory Mutual (FM Global) and Underwriter's Laboratories (UL) Listings for Pipe Hangers<sup>1</sup>**

Cat. No.	Anchor Size / Rod Diameter in. (mm)	Mount Direction	Screw Shank Size and Length	Point Style	Maximum Pipe Size in. (mm)	UL Minimum Steel Thickness in. (mm)	UL Test Load lbs. (kN)	FM Minimum Steel Thickness in. (mm)	FM Test Load lbs. (kN)
7158	3/8 (9.5)	Vertical	1/4-20 x 1"	#3	4 (101.6)	0.060 (1.5)	1,500 (6.8)	0.096 (2.4)	1,475 (6.6)
7184		Side	1/4-20 x 1"	#3	4 (101.6)	0.060 (1.5)	1,500 (6.8)	0.096 (2.4)	1,475 (6.6)
7160		Vertical	1/4-20 x 1-1/2"	#3	4 (101.6)	0.060 (1.5)	1,500 (6.8)	0.096 (2.4)	1,475 (6.6)
7186		Side	1/4-20 x 1-1/2"	#3	4 (101.6)	0.060 (1.5)	1,500 (6.8)	0.096 (2.4)	1,475 (6.6)
7154		Vertical	12-20 x 1-1/2"	#5	4 (101.6)	0.060 (1.5)	1,500 (6.8)	0.096 (2.4)	1,475 (6.6)
7188		Side	1/4-20 x 2"	#3	4 (101.6)	0.060 (1.5)	1,500 (6.8)	0.096 (2.4)	1,475 (6.6)
7201		Side	12-20 x 1-1/2"	#5	4 (101.6)	0.060 (1.5)	1,500 (6.8)	0.096 (2.4)	1,475 (6.6)
7161	1/2 (12.7)	Vertical	12-20 x 1-1/2"	#5	8 (203.2)	0.250 (6.4)	4,050 (18.2)	0.250 (6.4)	3,800 (17.1)

1. Steel Vertigo anchors are recommended to be installed with the Universal Steel & Wood Nut Driver. For UL and FM listings, Steel Vertigo must be installed with a retaining nut.

**Wood Vertigo – Ultimate Load Capacities for Factory Mutual (FM Global) and Underwriter's Laboratories (UL) Listings for Pipe Hangers<sup>1</sup>**

Cat. No.	Anchor Size / Rod Diameter in. (mm)	Mount Direction	Screw Shank Size and Length	Embedment Depth in. (mm)	UL Maximum Pipe Size in. (mm)	UL Test Load lbs. (kN)	FM Maximum Pipe Size in. (mm)	FM Test Load lbs. (kN)
7165	3/8 (9.5)	Vertical	1/4 x 2"	2 (50.8)	3 (76.2)	1,050 (4.7)	-	-
7170		Side	1/4 x 2"	2 (50.8)	3 (76.2)	1,050 (4.7)	-	-
7167		Vertical	1/4 x 3"	3 (76.2)	3 (76.2)	1,050 (4.7)	-	-
7169		Vertical	1/4 x 4"	4 (101.6)	3 (76.2)	1,050 (4.7)	-	-
7162		Vertical	5/16" x 2-1/2"	2-1/2 (63.5)	4 (101.6)	1,500 (6.8)	4 (101.6)	1,475 (6.6)
7156		Side	5/16" x 2-1/2"	2-1/2 (63.5)	4 (101.6)	1,500 (6.8)	-	-

1. Wood Vertigo anchors are recommended to be installed with the Universal Steel & Wood Nut Driver. No pre-drilling was done in the wood base materials.

**Concrete Vertigo – Ultimate Load Capacities for Factory Mutual (FM Global) Listings for Pipe Hangers<sup>1</sup>**

Cat. No.	Anchor Size / Rod Diameter in. (mm)	Mount Direction	Screw Shank Size and Length	ANSI Drill Bit Diameter d <sub>bit</sub> in.	Embedment Depth in. (mm)	FM Maximum Pipe Size in. (mm)	FM Test Load lbs. (kN)
7173	3/8 (9.5)	Vertical	1/4" x 1-1/2"	1/4"	1-1/2 (38.1)	4 (101.6)	1,475 (6.6)
7175	1/2 (12.7)	Vertical	3/8" x 2-3/4"	3/8"	2-3/4 (69.9)	4 (203.2)	3,800 (17.1)

1. Tabulated load values are for anchors installed in 8 inch thick hollow core plank with minimum compressive strength of 4,000 psi at the time of installation. The 4' x 6' normal-weight concrete

**PERFORMANCE DATA**
**Steel Vertigo - Ultimate Load Capacities for Underwriter's Laboratories (UL) Listings - Luminaire<sup>1</sup>**


Catalog Number	Anchor Size/Rod Dia. In. (mm)	Mount Direction	Screw Shank Size and Length	Point Style	Mounting Surface	UL Test Load (lb.)
7155	1/4	Vertical	1/4-20 x 1	#3	16 Gauge Steel	45
7157	3/8	Vertical	1/4-20 x 2	#3	16 Gauge Steel	45
7158	3/8	Vertical	1/4-20 x 1	#3	16 Gauge Steel	45
7159	3/8	Vertical	1/4-20 x 1-1/2	#3	16 Gauge Steel	45
7160	1/4	Vertical	1/4-20 x 1-1/2	#3	16 Gauge Steel	45
7183	1/4	Side	1/4-20 x 1	#3	16 Gauge Steel	75
7184	3/8	Side	1/4-20 x 1	#3	16 Gauge Steel	75
7186	3/8	Side	1/4-20 x 1-1/2	#3	16 Gauge Steel	75
7188	3/8	Side	1/4-20 x 2	#3	16 Gauge Steel	75
7155	1/4	Vertical	1/4-20 x 1	#3	22 Gauge Steel	25
7157	1/4	Vertical	1/4-20 x 2	#3	22 Gauge Steel	25
7158	3/8	Vertical	1/4-20 x 1	#3	22 Gauge Steel	25
7159	3/8	Vertical	1/4-20 x 1-1/2	#3	22 Gauge Steel	25
7160	3/8	Vertical	1/4-20 x 1-1/2	#3	22 Gauge Steel	25
7183	1/4	Side	1/4-20 x 1	#3	22 Gauge Steel	45
7184	3/8	Side	1/4-20 x 1	#3	22 Gauge Steel	45
7186	3/8	Side	1/4-20 x 1-1/2	#3	22 Gauge Steel	45
7188	3/8	Side	1/4-20 x 2	#3	22 Gauge Steel	45

1. Steel Vertigo anchors are recommended to be installed with the Universal Steel & Wood Nut Driver. For UL Luminaire listing, Steel Vertigo does not require a retaining nut.

**ORDERING INFORMATION**


**Steel Vertical Hanger (#3 for Purlins, #5 for Beams)**

Cat. No.	Rod Dia.	Screw Shank Size and Length	Point Style	Self Drilling Range	Std. Box	Std. Ctn.
7155	1/4"	1/4"-20 x 1"	#3	0.036" (20 gauge) to 0.188" (3/16")	100	500
7157	3/8"	1/4"-20 x 2"	#3		100	500
7158	3/8"	1/4"-20 x 1" (w/nut)	#3		100	500
7159	3/8"	1/4"-20 x 1-1/2" (w/nut)	#3		100	500
7160	3/8"	1/4"-20 x 1-1/2" (w/nut)	#3		100	500
7152	1/4"	12"-20 x 1-1/2"	#5	0.188" (3/16") to 0.500" (1/2")	100	500
7154	3/8"	12"-20 x 1-1/2" (w/nut)	#5		100	500
7161	1/2"	12"-20 x 1-1/2" (w/nut)	#5		100	500



**Steel Side Hanger (#3 for Purlins, #5 for Beams)**

Cat. No.	Rod Dia.	Screw Shank Size and Length	Point Style	Self Drilling Range	Std. Box	Std. Ctn.
7183	1/4"	1/4"-20 x 1"	#3	0.036" (20 gauge) to 0.188" (3/16")	100	500
7184	3/8"	1/4"-20 x 1" (w/nut)	#3		100	500
7186	3/8"	1/4"-20 x 1-1/2" (w/nut)	#3		100	500
7188	3/8"	1/4"-20 x 2" (w/nut)	#3		100	500
7200	1/4"	12"-20 x 1-1/2"	#5	0.188" (3/16") to 0.500" (1/2")	50	300
7201	3/8"	12"-20 x 1-1/2" (w/nut)	#5		100	600



**Wood Vertical Hanger**

Cat. No.	Rod Dia.	Screw Shank Size and Length	Point Style	Pre-Drill Diameter (If Required)	Std. Box	Std. Ctn.
7163	1/4"	1/4" x 2"	Type 17	1/8"	100	500
7203	3/8"	1/4" x 1"	Type 17		100	500
7165	3/8"	1/4" x 2"	Type 17		100	500
7167	3/8"	1/4" x 3"	Type 17		100	500
7169	3/8"	1/4" x 4"	Type 17		100	500
7162	3/8"	5/16" x 2-1/2"	Type 17		100	500
7164	1/2"	5/16" x 2-1/2"	Type 17		100	500



**Wood Side Hanger**

Cat. No.	Rod Dia.	Screw Shank Size and Length	Point Style	Pre-Drill Diameter (If Required)	Std. Box	Std. Ctn.
7185	1/4"	1/4" x 1"	Type 17	1/8"	100	500
7205	3/8"	1/4" x 1"	Type 17		100	500
7170	3/8"	1/4" x 2"	Type 17		100	500
7156	3/8"	5/16" x 2-1/2"	Type 17		100	500




**Concrete Vertical Hanger**

Cat. No.	Rod Dia.	Screw Shank Size and Length	Thread Style	Pre-Drill Diameter (If Required)	Std. Box	Std. Ctn.
7171	1/4"	1/4" x 1-1/4"	Wedge-Bolt OT	1/4" ANSI	100	500
7173	3/8"	1/4" x 1-1/2"	Wedge-Bolt OT	1/4" ANSI	100	500
7175	1/2"	1/4" x 2-3/4"	Wedge-Bolt OT	3/8" ANSI	50	250




**Drive Sockets and Pole Tool**

Cat. No.	Description	RPM	Std. Box	Std. Ctn.
7166	6'-12' Pole Tool (includes three Jaw Chuck)	N/A	1	1
7187	Universal Steel & Wood Socket (Red)	500 to 1500 RPM	5	25
7195	1/4" Concrete Socket (Blue)	-	5	25
7197	3/8" Concrete Socket (Blue)	-	5	25
7198	1/2" Concrete Socket (Blue)	-	5	25



**Concrete Vertigo Installation Accessories**

Cat. No.	Description	Maximum Bit Length	Std. Box	Std. Ctn.
5864	Vertigo Installation Kit: 1/4" and 3/8" Concrete Drive Sockets (Blue) Universal Steel & Wood Socket (Red) (Sleeve Assembly (same as Cat# 5874)	6"	1	3/4
5874	Sleeve Assembly (5-3/4")	6"	1	-
Cat. No.	Description	Usable Length	Std. Tube	Wt./10
5866	1/4" x 6" Hex Shank SDS Drill Bit	4"	1	1/2

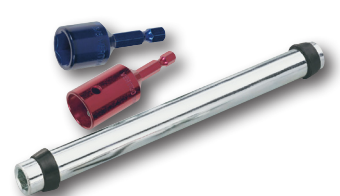



SUBMITTAL RECORD \_\_\_\_\_  
 JOB \_\_\_\_\_  
 LOCATION \_\_\_\_\_  
 SUBMITTED TO \_\_\_\_\_  
 SUBMITTAL PREPARED BY \_\_\_\_\_  
 APPROVED BY \_\_\_\_\_  
 DATE \_\_\_\_\_



# Submittal Form Hanging Strap

## Coiled Galvanized Duro Strap

- Coiled Duro Strap is manufactured from 16, 18, 22, 24, 26, 28 and 30 gauge steel
- Coiled straps make it convenient to carry and easy to cut without wasting material

Item #	Code	Description	Length
13250	GS161-200	Galvanized Duro Strap-1in. - 16ga.	200ft.
13251	GS181-200	Galvanized Duro Strap-1in. - 18ga.	200ft.
13252	GS221-200	Galvanized Duro Strap-1in. - 22ga.	200ft.
13253	GS241-200	Galvanized Duro Strap-1in. - 24ga.	200ft.
13254	GS261-200	Galvanized Duro Strap-1in. - 26ga.	200ft.
13285	GS221-100	Galvanized Duro Strap-1in. - 22ga.	100ft.
13291	GS241-100	Galvanized Duro Strap-1in. - 24ga.	100ft.
13292	GS261-100	Galvanized Duro Strap-1in. - 26ga.	100ft.
13281	GS281-100	Galvanized Duro Strap-1in. - 28ga.	100ft.
13166	GS301-100	Galvanized Duro Strap-1in. - 30ga.	100ft.
13286	GS2215-100	Galvanized Duro Strap-1-1/2in. - 22ga.	100ft.
13294	GS2415-100	Galvanized Duro Strap-1-1/2in. - 24ga.	100ft.
13295	GS2615-100	Galvanized Duro Strap-1-1/2in. - 26ga.	100ft.
13282	GS2815-100	Galvanized Duro Strap-1-1/2in. - 28ga.	100ft.
13167	GS3015-100	Galvanized Duro Strap-1-1/2in. - 30ga.	100ft.




**Coiled Duro Strap**

## Flat Galvanized Hanging Strap

- Flat Hanging Strap is manufactured from 14, 16, 18, 20, 22, and 24 gauge steel
- Flat Hanging Strap is sold in pre-cut lengths

Item #	Code	Description	Length
13269	HS1410	14ga. Galvanized Hanging Strap-1in.	10ft.
13270	HS1610	16ga. Galvanized Hanging Strap-1in.	10ft.
13271	HS1810	18ga. Galvanized Hanging Strap-1in.	10ft.
13274	HS2010	20ga. Galvanized Hanging Strap-1in.	10ft.
13272	HS2210	22ga. Galvanized Hanging Strap-1in.	10ft.
13273	HS2410	24ga. Galvanized Hanging Strap-1in.	10ft.

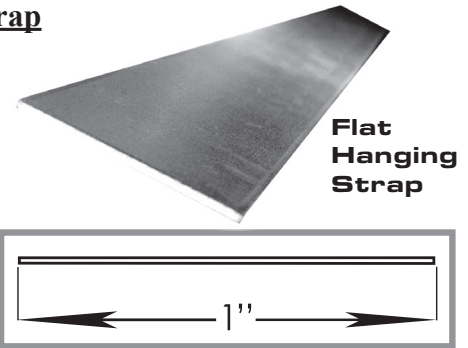

**Flat Hanging Strap**

## Perforated Scalloped Galvanized Hanging Strap

- For both HVAC and Plumbing markets.
- Manufactured from 24 gauge steel.
- Perforated with alternating different hole sizes to accommodate sheet metal screws as well as nut and bolt combinations.
- The strap has an hourglass shape with no sharp edges for the contractor to get cut or snagged on.

Item #	Code	Description	Length
13249	PGS24	Perforated Galvanized Strap - 3/4 in. - 24ga.	100ft.




**Perforated Scalloped Galvanized Strap**

## Perforated Galvanized Hanging Strap (Straight Edge)

- Manufactured from 26, 28 and 30 gauge steel.
- Perforated with a 3/16" size hole sizes - 3-7/8" spacing between holes.

Item #	Code	Description	Length
13339	PGS261	Perforated Galvanized Strap - 1in. - 26ga.	100ft.
13343	PGS281	Perforated Galvanized Strap - 1in. - 28ga.	100ft.
13168	PGS301-100	Perforated Galvanized Strap - 1in. - 30ga.	100ft.
13169	PGS3015-100	Perforated Galvanized Strap - 1-1/2in. - 30ga.	100ft.

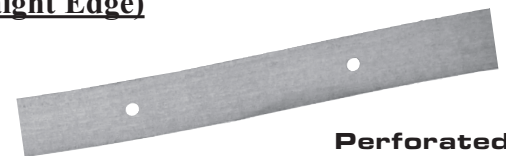

**Perforated Galvanized Strap (Straight Edge)**

Duro Dyne East Division, Bay Shore, NY  
 Duro Dyne Midwest Division, Hamilton, OH  
 Duro Dyne West Division, Fontana, CA  
 Duro Dyne Canada, Lachine, Quebec, Canada

631-249-9000 Fax: 631-249-8346  
 513-870-6000 Fax: 513-870-6005  
 562-926-1774 Fax: 562-926-5778  
 514-422-9760 Fax: 514-636-0328  
 www.durodyne.com E-mail: durodyne@durodyne.com




©2017 Duro Dyne Corporation  
 Printed in USA 3/22/17  
 B0050012



# HEX NUT & WASHER



## Product Data Sheet

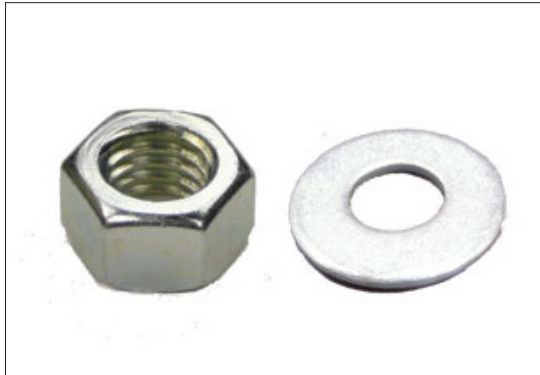

### Description

#### Hex Nut & Washer

### Standard Construction

#### Hex Nut:

Manufactured from Low Carbon Steel (1008 / 1010), meet ASTM A563 Grade A.  
Dimensions: ASME/ANSI B18.2.2  
Zinc Plating: Purchased to meet ASTM F1941 FeZn3A  
Hot-Dip Galvanized: Meet ASTM A153.  
HDG nuts are tapped oversize per ASTM A563.  
Hardness: HRB 68 – HRC 32  
Proof Load Strength: 90,000 PSI Minimum (68,000 PSI for HDG nuts)

Hex Nut Socket Sizes	
Bolt Size	Socket Size
1/4	7/16
5/16	1/2
3/8	9/16
3/8 Heavy Nut	11/16
1/2	3/4
5/8	15/16
3/4	1-1/8

#### Flat Washer:

Manufactured from Low Carbon Steel  
Dimensions: ASME/ANSI B18.2.2, Table 1A, Size "W"  
Zinc Plating: Purchased to meet ASTM F1941 FeZn3A  
Hot-Dip Galvanized: Meet ASTM A153.  
HDG nuts are tapped oversize per ASTM A563.

Flat Washer Dimensions			
Size	I.D	O.D.	Thickness
1/4	0.307-0.327	0.727-0.749	0.051-0.080
3/8	0.433-0.453	0.993-1.030	0.064-0.104
1/2	0.557-0.577	1.368-1.405	0.086-0.132
5/8	0.681-0.718	1.743-1.780	0.108-0.160
3/4	0.805-0.842	1.993-2.030	0.122-0.177

### Optional Construction

#### Hex Nut:

Heavy Nut  
Stainless Steel 304  
Stainless Steel 316  
Aluminum  
Nylon

#### Flat Washer:

Stainless Steel 304  
Stainless Steel 316  
Aluminum

### Packaging

Size (in)	Qty Per Box (each)
1/4 Hex Nut	9,000 or 100
5/16 Hex Nut	4,000 or 100
3/8 Hex Nut	4,000 or 100
3/8 Heavy Hex Nut	2,000 or 100
1/2 Hex Nut	1,800 or 100
5/8 Hex Nut	1,000 or 100
3/4 Hex Nut	1,000 or 100

Size	Qty Per Box (lbs)
1/4" Flat Washers	50 or 5
3/8" Flat Washers	50 or 5
1/2" Flat Washers	50 or 5
5/8" Flat Washers	50 or 5
3/4" Flat Washers	50 or 5

### Guarantee

All Elgen products are guaranteed by Elgen Manufacturing against defective material.

#### Elgen Manufacturing

10 Railroad Ave, Closter NJ 07624

Tel: 800.503.9805 :: Fax: 201.964.9030

info@elgenmfg.com :: www.elgenmfg.com




### P1000 T

Wt/100 Ft: 185 Lbs (275 kg/100 m)

Slots are

1 1/8" (29) x 9/16" (14)

2" (51) on Center

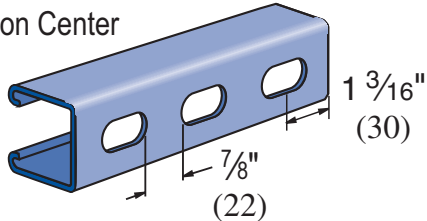

#### Notes:

\* Load limited by spot weld shear.

\*\*  $KL/r > 200$

NR = Not Recommended.

1. Above loads include the weight of the member. This weight must be deducted to arrive at the net allowable load the beam will support.
2. Long span beams should be supported in such a manner as to prevent rotation and twist.
3. Allowable uniformly distributed loads are listed for various simple spans, that is, a beam on two supports. If load is concentrated at the center of the span, multiply load from the table by 0.5 and corresponding deflection by 0.8.
4. For Pierced Channel, Beam Load Values in the tables are multiplied by the following factor:

**"T" Series      85%**

### MATERIAL

Unistrut channels are accurately and carefully cold formed to size from low-carbon strip steel. All spot-welded combination members, except P1001T, are welded 3" (76 mm) maximum on center.

#### STEEL: PLAIN

12 Ga. (2.7 mm), 14 Ga. (1.9 mm) and  
16 Ga. (1.5 mm) ASTM A1011 SS GR 33.

#### STEEL: PRE-GALVANIZED

12 Ga. (2.7 mm), 14 Ga. (1.9 mm) and  
16 Ga. (1.5 mm) ASTM A653 GR 33.

For other materials, see Special Metals or Fiberglass sections.

### FINISHES

All channels are available in:

- Perma Green III (GR).
- Pre-galvanized (PG), conforming to ASTM A653 G90.
- Hot-dipped galvanized (HG), conforming to ASTM A123.
- Plain (PL).

Project: \_\_\_\_\_

Architect / Engineer: \_\_\_\_\_

Date: \_\_\_\_\_ Phone: \_\_\_\_\_

Contractor: \_\_\_\_\_

Address: \_\_\_\_\_

Notes 1: \_\_\_\_\_

Notes 2: \_\_\_\_\_


Approval Stamp:



### P2000 T

Wt/100 Ft: 113 Lbs (168 kg/100 m)

Slots are  
1 1/8" (29) x 9/16" (14)  
2" (51) on Center

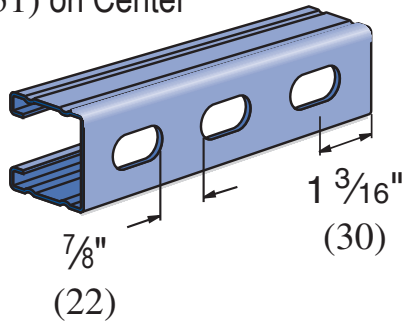

#### Notes:

\* Load limited by spot weld shear.

\*\*  $K_L/r > 200$

NR = Not Recommended.

1. Above loads include the weight of the member. This weight must be deducted to arrive at the net allowable load the beam will support.
2. Long span beams should be supported in such a manner as to prevent rotation and twist.
3. Allowable uniformly distributed loads are listed for various simple spans, that is, a beam on two supports. If load is concentrated at the center of the span, multiply load from the table by 0.5 and corresponding deflection by 0.8.
4. For Pierced Channel, Beam Load Values in the tables are multiplied by the following factor:

**"T" Series ... 85%**

### MATERIAL

Unistrut channels are accurately and carefully cold formed to size from low-carbon strip steel. All spot-welded combination members, except P1001T, are welded 3" (76 mm) maximum on center.

#### STEEL: PLAIN

12 Ga. (2.7 mm), 14 Ga. (1.9 mm) and  
16 Ga. (1.5 mm) ASTM A1011 SS GR 33.

#### STEEL: PRE-GALVANIZED

12 Ga. (2.7 mm), 14 Ga. (1.9 mm) and  
16 Ga. (1.5mm) ASTM A653 GR 33.

For other materials, see Special Metals or Fiberglass sections.

### FINISHES

All channels are available in:

- Perma Green III (GR).
- Pre-galvanized (PG), conforming to ASTM A653 G90.
- Hot-dipped galvanized (HG), conforming to ASTM A123.
- Plain (PL).

Project: \_\_\_\_\_

Architect / Engineer: \_\_\_\_\_

Date: \_\_\_\_\_ Phone: \_\_\_\_\_

Contractor: \_\_\_\_\_

Address: \_\_\_\_\_

Notes 1: \_\_\_\_\_

Notes 2: \_\_\_\_\_

Approval Stamp: \_\_\_\_\_




### P3000 T

Wt/100 Ft: 165 Lbs (246 kg/100 m)

Slots are

1 1/8" (29) x 9/16" (14)

2" (51) on Center

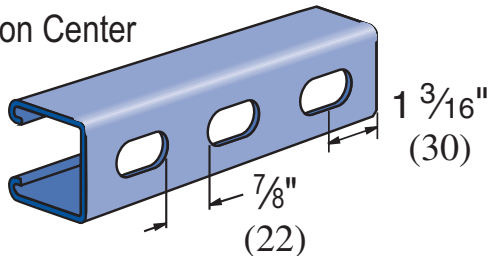

#### Notes:

\* Load limited by spot weld shear.

\*\*  $KL/r > 200$

NR = Not Recommended.

1. Above loads include the weight of the member. This weight must be deducted to arrive at the net allowable load the beam will support.
2. Long span beams should be supported in such a manner as to prevent rotation and twist.
3. Allowable uniformly distributed loads are listed for various simple spans, that is, a beam on two supports. If load is concentrated at the center of the span, multiply load from the table by 0.5 and corresponding deflection by 0.8.
4. For Pierced Channel, Beam Load Values in the tables are multiplied by the following factor:

"T" Series ... 85%

### MATERIAL

Unistrut channels are accurately and carefully cold formed to size from low-carbon strip steel. All spot-welded combination members, except P1001T, are welded 3" (76 mm) maximum on center.

#### STEEL: PLAIN

12 Ga. (2.7 mm), 14 Ga. (1.9 mm) and  
16 Ga. (1.5 mm) ASTM A1011 SS GR 33.

#### STEEL: PRE-GALVANIZED

**12 Ga.** (2.7 mm), 14 Ga. (1.9 mm) and  
16 Ga. (1.5 mm) ASTM A653 GR 33.

For other materials, see Special Metals or Fiberglass sections.

### FINISHES

All channels are available in:

- Perma Green III (GR).
- Pre-galvanized (PG), conforming to ASTM A653 G90.
- Hot-dipped galvanized (HG), conforming to ASTM A123.
- Plain (PL).

Project: \_\_\_\_\_

Architect / Engineer: \_\_\_\_\_

Date: \_\_\_\_\_ Phone: \_\_\_\_\_

Contractor: \_\_\_\_\_

Address: \_\_\_\_\_

Notes 1: \_\_\_\_\_

Notes 2: \_\_\_\_\_


Approval Stamp:



### P4000 T

Wt/100 Ft: 79 Lbs (118 kg/100 m)

Slots are  
1 1/8" (29) x 9/16" (14)  
2" (51) on Center

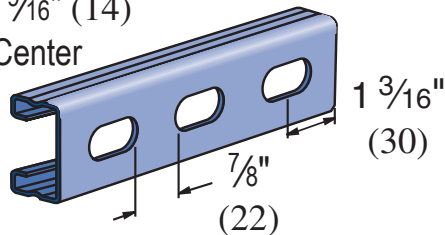

#### Notes:

\* Load limited by spot weld shear.

\*\*  $KL/r_t > 200$

1. Above loads include the weight of the member. This weight must be deducted to arrive at the net allowable load the beam will support.
2. Long span beams should be supported in such a manner as to prevent rotation and twist.
3. Allowable uniformly distributed loads are listed for various simple spans, that is, a beam on two supports. If load is concentrated at the center of the span, multiply load from the table by 0.5 and corresponding deflection by 0.8.
4. For Pierced Channel, Reduce Beam Load Values as Follows:  
"T" Series ... 85%

### MATERIAL

Unistrut channels are accurately and carefully cold formed to size from low-carbon strip steel. All spot-welded combination members, except P1001T, are welded 3" (76 mm) maximum on center.

#### STEEL: PLAIN

12 Ga. (2.7 mm), 14 Ga. (1.9 mm) and  
16 Ga. (1.5 mm) ASTM A1011 SS GR 33.

#### STEEL: PRE-GALVANIZED

**12 Ga.** (2.7 mm), 14 Ga. (1.9 mm) and  
16 Ga. (1.5 mm) ASTM A653 GR 33.

For other materials, see Special Metals or Fiberglass sections.

### FINISHES

All channels are available in:

- Perma Green III (GR).
- Pre-galvanized (PG), conforming to ASTM A653 G90.
- Hot-dipped galvanized (HG), conforming to ASTM A123.
- Plain (PL).

Project: \_\_\_\_\_

Approval Stamp:

Architect / Engineer: \_\_\_\_\_

Date: \_\_\_\_\_ Phone: \_\_\_\_\_

Contractor: \_\_\_\_\_

Address: \_\_\_\_\_

Notes 1: \_\_\_\_\_


Notes 2: \_\_\_\_\_



### P5000 T

Wt/100 Ft: 300 Lbs (446 kg/100 m)

Slots are  
1 1/8" (29) x 9/16" (14)  
2" (51) on Center

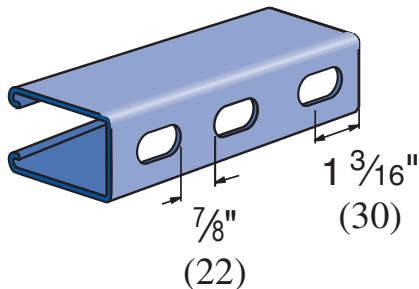

#### Notes:

\* Load limited by spot weld shear.

\*\*  $KL/r_t > 200$

1. Above loads include the weight of the member. This weight must be deducted to arrive at the net allowable load the beam will support.
2. Long span beams should be supported in such a manner as to prevent rotation and twist.
3. Allowable uniformly distributed loads are listed for various simple spans, that is, a beam on two supports. If load is concentrated at the center of the span, multiply load from the table by 0.5 and corresponding deflection by 0.8.
4. For Pierced Channel, Beam Load Values in the tables are multiplied by the following factor:

"T" Series ... 85%

### MATERIAL

Unistrut channels are accurately and carefully cold formed to size from low-carbon strip steel. All spot-welded combination members, except P1001T, are welded 3" (76 mm) maximum on center.

#### STEEL: PLAIN

12 Ga. (2.7 mm), 14 Ga. (1.9 mm) and  
16 Ga. (1.5 mm) ASTM A1011 SS GR 33.

#### STEEL: PRE-GALVANIZED

12 Ga. (2.7 mm), 14 Ga. (1.9 mm) and  
16 Ga. (1.5 mm) ASTM A653 GR 33.

For other materials, see Special Metals or Fiberglass sections.

### FINISHES

All channels are available in:

- Perma Green III (GR).
- Pre-galvanized (PG), conforming to ASTM A653 G90.
- Hot-dipped galvanized (HG), conforming to ASTM A123.
- Plain (PL).

Project: \_\_\_\_\_

Architect / Engineer: \_\_\_\_\_

Date: \_\_\_\_\_ Phone: \_\_\_\_\_

Contractor: \_\_\_\_\_

Address: \_\_\_\_\_


Notes 1: \_\_\_\_\_

Notes 2: \_\_\_\_\_

Approval Stamp:

## LOOP

### Wire rope with crimped loop



### Gripple



### Sizes

Gripple No.1-No.5

### Safe Working Loads:

No.1	0 - 10kg
No.2	10 - 45kg
No.3	45 - 90kg
No.4	90 - 225kg
No.5	225 - 325kg

### Function:

Recommended for the suspension of HVAC, electrical and mechanical services in an indoor, stationary setting.

### Applications:

Purlins, beams, roof trusses and other accessible building features.

### Technical Data:

- All products carry a 5:1 safety factor
- SMACNA compliance - Tested and verified to be an acceptable hanger per the SMACNA, HVAC DUCT CONSTRUCTION STANDARDS MANUAL (1995). Full report available on request, or visit [www.smacnatri.org](http://www.smacnatri.org), click on Testing Program.
- UL Listing - UL 1598 luminaire fitting sizes 1 - 5, UL 2289 Conduit and Cable Hardware sizes 2, 3 and 4.
- CSA - Class 3426-01 luminaire fittings.
- Other approvals include Lloyds Register, Apave, Tüv and Csir.

### Material Specification

<b>Gripple</b>	Housing	Type ZA2 Zinc
	Wedge	Sintered steel hardened to min. 56 Rockwell C
	Spring	Stainless Steel (Type 302)
	End Cap	UV stabilised homopolymer propylene

### Wire Rope


Grade galvanised high tensile steel wire rope to EN12385  
Standard lengths from 1m - 10m, other lengths can be made to order.

Wire Rope Specification	No.1	No.2	No.3	No.4	No.5
Diameter (mm)	1.5mm	2mm	3mm	4.75mm	6mm
Strand configuration	7 x 7	7 x 7	7 x 7	7 x 19	7 x 19
Min breaking load (kg)	180	260	580	1500	2160
Max. working load (kg)	10	45	90	225	325
Tensile strength (Nmm <sup>2</sup> )	1770	1770	1770	1770	1770

**Crimp/ferrule:** Aluminium

## STUD

### Wire rope with crimped M6, M8 or M10 stud

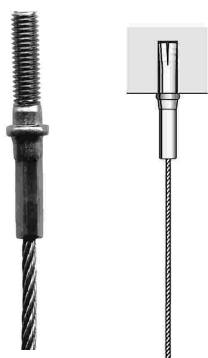

### Gripple



### Sizes

M6 Gripple No.1-No.3  
M8 Gripple No.2-No.3  
M10 Gripple No.2-No.4

### Safe Working Loads:

No.1	0 - 10kg
No.2	10 - 45kg
No.3	45 - 90kg
No.4	90 - 225kg

### Function:

Recommended for the suspension of HVAC, electrical and mechanical services in an indoor, stationary setting.

### Applications:

Concrete ceilings, metal decking and pressed metal brackets (with nuts).

### Technical Data:

- All products carry a 5:1 safety factor
- UL Listing - UL 1598 luminaire fitting sizes 1 - 5, UL 2289 Conduit and Cable Hardware sizes 2, 3 and 4.
- CSA - Class 3426-01 luminaire fittings.
- Other approvals include Lloyds Register, Apave and Tüv.

### Material Specification

<b>Gripple</b>	Housing	Type ZA2 Zinc
	Wedge	Sintered steel hardened to min. 56 Rockwell C
	Spring	Stainless Steel (Type 302)
	End Cap	UV stabilised homopolymer propylene

### Wire Rope

Grade galvanised high tensile steel wire rope to EN12385  
Standard lengths from 1m - 10m, other lengths can be made to order.


Wire Rope Specification	No.1	No.2	No.3	No. 4
Diameter (mm)	1.5mm	2mm	3mm	4.75mm
Strand configuration	7 x 7	7 x 7	7 x 7	7 x 19
Min breaking load (kg)	180	260	580	1500
Max. working load (kg)	10	45	90	225
Tensile strength (Nmm <sup>2</sup> )	1770	1770	1770	1770

### Stud end:

M6 diameter zinc plated steel 20mm or 45mm thread length.  
M8 diameter zinc plated steel 45mm thread length.  
M10 diameter zinc plated steel 45mm thread length.

## TOGGLE

### Wire rope crimped end stop with toggle plate



### Gripple



### Sizes

Gripple No.1-No.3

### Safe Working Loads:

No.1	0 - 10kg
No.2	10 - 45kg
No.3	45 - 90kg

### Function:

Recommended for the suspension of HVAC, electrical and mechanical services in an indoor, stationary setting.

### Applications:

Suitable for profile roof cladding, light fittings, luminaires and other cavities.

### Technical Data:

- All products carry a 5:1 safety factor
- SMACNA compliance - Tested and verified to be an acceptable hanger per the SMACNA, HVAC DUCT CONSTRUCTION STANDARDS MANUAL (1995). Full report available on request, or visit [www.smacnatri.org](http://www.smacnatri.org), click on Testing Program.
- UL Listing - UL 1598 luminaire fitting sizes 1 - 5, UL 2289 Conduit and Cable Hardware sizes 2, 3 and 4.
- CSA - Class 3426-01 luminaire fittings.
- Other approvals include Lloyds Register, Apave and Tüv.

### Material Specification

<b>Gripple</b>	Housing	Type ZA2 Zinc
	Wedge	Sintered steel hardened to min. 56 Rockwell C
	Spring	Stainless Steel (Type 302)
	End Cap	UV stabilised homopolymer propylene

### Wire Rope

Grade	galvanised high tensile steel wire rope to EN12385
Standard lengths	from 1m - 10m, other lengths can be made to order.

Wire Rope Specification	No.1	No.2	No.3
Diameter (mm)	1.5mm	2mm	3mm
Strand configuration	7 x 7	7 x 7	7 x 7
Min breaking load (kg)	180	260	580
Max. working load (kg)	10	45	90
Tensile strength (Nmm <sup>2</sup> )	1770	1770	1770

### Toggle plate and end stop:

Zinc plated steel

## END STOP

### Wire rope with crimped end stop



### Gripple



### Sizes

Gripple No.1-No.3

### Safe Working Loads:

No.1	0 - 10kg
No.2	10 - 45kg
No.3	45 - 90kg

### Minimum channel width:

No.1	6mm
No.2	8mm
No.3	10mm

### Function:

Recommended for the suspension of HVAC, electrical and mechanical services in an indoor, stationary setting.

### Applications:

Suitable for suspending from lighting channels, track and other channel fixtures.

### Technical Data:

- All products carry a minimum 5:1 safety factor
- Tested and certified under Lloyds Register.

### Material Specification

<b>Gripple</b>	Housing	Type ZA2 Zinc
	Wedge	Sintered steel hardened to min. 56 Rockwell C
	Spring	Stainless Steel (Type 302)
	End Cap	UV stabilised homopolymer propylene

### Wire Rope

Grade	galvanised high tensile steel wire rope to EN12385
Standard lengths	from 1m - 10m, other lengths can be made to order.

Wire Rope Specification	No.1	No.2	No.3
Diameter (mm)	1.5mm	2mm	3mm
Strand configuration	7 x 7	7 x 7	7 x 7
Min breaking load (kg)	180	260	580
Max. working load (kg)	10	45	90
Tensile strength (Nmm <sup>2</sup> )	1770	1770	1770


### End Stop:

Zinc plated steel



## EYELET

### Wire rope with crimped eyelet



### Gripple



### Sizes

Gripple No.2-No.3

### Safe Working Loads:

No.2	0 - 45kg
No.3	45 - 90kg

### Hole size:

No.2	6.5mm
No.3	6.5mm

### Function:

Recommended for the suspension of HVAC, electrical and mechanical services in an indoor, stationary setting.

### Applications:

Suitable for a variety of applications that require bolting to brackets or fixtures.

### Technical Data:

- All products carry a 5:1 safety factor
- Tested and certified under Lloyds Register.

### Material Specification

<b>Gripple</b>	Housing	Type ZA2 Zinc
	Wedge	Sintered steel hardened to min. 56 Rockwell C
	Spring	Stainless Steel (Type 302)
	End Cap	UV stabilised homopolymer propylene

### Wire Rope

Grade	galvanised high tensile steel wire rope to EN12385
	Standard lengths from 1m - 10m, other lengths can be made to order.


Wire Rope Specification	No.2	No.3
Diameter (mm)	2mm	3mm
Strand configuration	7 x 7	7 x 7
Min breaking load (kg)	260	580
Max working load (kg)	45	90
Tensile strength (Nmm <sup>2</sup> )	1770	1770

### Stud eyelet:

Zinc plated steel

## 45° EYELET

### Wire rope with crimped eyelet



### Gripple



### Sizes

Gripple No.2-No.3

### Safe Working Loads:

No.2	0 - 45kg
No.3	45 - 90kg

### Hole size:

No.2	11.2mm
No.3	11.2mm

### Function:

Recommended for the suspension of HVAC, electrical and mechanical services in an indoor, stationary setting.

### Applications:

Suitable for a variety of applications that require bolting to brackets or fixtures.

### Technical Data:

- All products carry a 5:1 safety factor
- Tested and certified under Lloyds Register.

### Material Specification

<b>Gripple</b>	Housing	Type ZA2 Zinc
	Wedge	Sintered steel hardened to min. 56 Rockwell C
	Spring	Stainless Steel (Type 302)
	End Cap	UV stabilised homopolymer propylene

### Wire Rope

Grade	galvanised high tensile steel wire rope to EN12385
	Standard lengths from 1m - 10m, other lengths can be made to order.


Wire Rope Specification	No.2	No.3
Diameter (mm)	2mm	3mm
Strand configuration	7 x 7	7 x 7
Min breaking load (kg)	260	580
Max. working load (kg)	45	90
Tensile strength (Nmm <sup>2</sup> )	1770	1770

### Eyelet:

Zinc plated steel

## 90° EYELET

Wire rope with crimped eyelet



Gripple



Sizes

Gripple No.1-No.3

**Safe Working Loads:**

No.1 0 - 10kg  
No.2 10 - 45kg  
No.3 45 - 90kg

**Hole size:**

No.1 7.3mm  
No.2 7.3mm  
No.3 7.3mm

### Function:

Recommended for the suspension of HVAC, electrical and mechanical services in an indoor, stationary setting.

### Applications:

Designed for shot firing into concrete, steel and wood using gas or powder actuated tools.

### Technical Data:

- All products carry a 5:1 safety factor
- Tested and certified under Lloyds Register.

### Material Specification

**Gripple**  
Housing Type ZA2 Zinc  
Wedge Sintered steel hardened to min. 56 Rockwell C  
Spring Stainless Steel (Type 302)  
End Cap UV stabilised homopolymer propylene

### Wire Rope

Grade galvanised high tensile steel wire rope to EN12385  
Standard lengths from 1m - 10m, other lengths can be made to order.

Wire Rope Specification	No.1	No.2	No.3
Diameter (mm)	1.5mm	2mm	3mm
Strand configuration	7 x 7	7 x 7	7 x 7
Min breaking load (kg)	180	260	580
Max. working load (kg)	10	45	90
Tensile strength (Nmm <sup>2</sup> )	1770	1770	1770

**Eyelet:** Zinc plated steel

## LARGE 90° EYELET

Wire rope with crimped eyelet



Gripple



Sizes

Gripple No.3

**Safe Working Loads:**

No.3 0 - 90kg

**Hole size:**

No.3 11mm

### Function:

Recommended for the suspension of HVAC, electrical and mechanical services in an indoor, stationary setting.

### Applications:

Suitable for a variety of applications that require bolting to brackets or fixtures.

### Technical Data:

- All products carry a 5:1 safety factor
- Tested and certified under Lloyds Register.

### Material Specification

**Gripple**  
Housing Type ZA2 Zinc  
Wedge Sintered steel hardened to min. 56 Rockwell C  
Spring Stainless Steel (Type 302)  
End Cap UV stabilised homopolymer propylene

### Wire Rope


Grade galvanised high tensile steel wire rope to EN12385  
Standard lengths from 1m - 10m, other lengths can be made to order.

Wire Rope Specification	No.3
Diameter (mm)	3mm
Strand configuration	7 x 7
Min breaking load (kg)	580
Max. safe working load (kg)	90
Tensile strength (Nmm <sup>2</sup> )	1770

**Eyelet:** Zinc plated steel

## BARREL

### Wire rope with crimped barrel



### Gripple



### Sizes

M6 Gripple No.1-No.2

M8 Gripple No.2-No.3

### Safe Working Loads:

No.1 0 - 10kg

No.2 10 - 45kg

No.3 45 - 90kg

### Barrel internal thread lengths:

M6 25mm

M8 25mm

### Function:

Recommended for the suspension of HVAC, electrical and mechanical services in an indoor, stationary setting.

### Applications:

Fits onto any 6mm or 8mm male thread to give an aesthetically pleasing fixing method.

### Technical Data:

- All products carry a 5:1 safety factor

### Material Specification

Gripple	Housing	Type ZA2 Zinc
	Wedge	Sintered steel hardened to min. 56 Rockwell C
	Spring	Stainless Steel (Type 302)
	End Cap	UV stabilised homopolymer propylene

### Wire Rope


Grade galvanised high tensile steel wire rope to EN12385  
Standard lengths from 1m - 10m, other lengths can be made to order.

Wire Rope Specification	No.1	No.2	No.3
Diameter (mm)	1.5mm	2mm	3mm
Strand configuration	7 x 7	7 x 7	7 x 7
Min breaking load (kg)	180	260	580
Max. working load (kg)	10	45	90
Tensile strength (Nmm <sup>2</sup> )	1770	1770	1170

**Barrel end:** Zinc plated steel

## MAGNETIC BARREL

### Wire rope with crimped magnetic barrel



### Gripple



### Sizes

M6 Gripple No.1

### Safe Working Loads:

No.1 0 - 8kg  
2:1 safety factor

### Function:

Recommended for the suspension of HVAC, electrical and mechanical services in an indoor, stationary setting.

### Applications:

Quick and easy suspension of lightweight services from metal surfaces.

### Technical Data:

- All products carry a 2:1 safety factor at 2mm metal thickness.

### Material Specification

Gripple	Housing	Type ZA2 Zinc
	Wedge	Sintered steel hardened to min. 56 Rockwell C
	Spring	Stainless Steel (Type 302)
	End Cap	UV stabilised homopolymer propylene

### Wire Rope


Grade galvanised high tensile steel wire rope to EN12385  
Standard lengths from 1m - 10m, other lengths can be made to order.

Wire Rope Specification	No.1
Diameter (mm)	1.5mm
Strand configuration	7 x 7
Min breaking load (kg)	180
Max. working load (kg)	8
Tensile strength (Nmm <sup>2</sup> )	1770

**Barrel end:** Zinc plated steel  
**Magnetic pad:** Strontium Magnetic Sheet and Extrusion  
Neodymium Iron Baron magnet material

## SNAP HOOK

Wire rope with crimped snap-on hook



Gripple



Sizes

Gripple sizes No.1-No.3

**Safe Working Loads:**

No.1	0 - 10kg
No.2	10 - 45kg
No.3	45 - 90kg

### Function:

Recommended for the suspension of HVAC, electrical and mechanical services in an indoor, stationary setting.

### Applications:

Suitable for use on cable basket and ladder.

### Technical Data:

- All products carry a 5:1 safety factor
- Tested and certified under Lloyds Register.

### Material Specification

<b>Gripple</b>	Housing	Type ZA2 Zinc
	Wedge	Sintered steel hardened to min. 56 Rockwell C
	Spring	Stainless Steel (Type 302)
	End Cap	UV stabilised homopolymer propylene

### Wire Rope


Grade galvanised high tensile steel wire rope to EN12385  
Standard lengths from 1m - 10m, other lengths can be made to order.

Wire Rope Specification	No.1	No.2	No.3
Diameter (mm)	1.5mm	2mm	3mm
Strand configuration	7 x 7	7 x 7	7 x 7
Min breaking load (kg)	180	260	580
Max. working load (kg)	10	45	90
Tensile strength (Nmm <sup>2</sup> )	1770	1770	1770

**Hook:** Zinc plated steel

## LINK HOOK

Wire rope with crimped loop and link hook



Gripple



Sizes

Gripple No.1-No.3

**Safe Working Loads:**

No.1	0 - 10kg
No.2	10 - 45kg
No.3	45 - 90kg

### Function:

Recommended for the suspension of HVAC, electrical and mechanical services in an indoor, stationary setting.

### Applications:

Suitable for use on cable tray, basket and ladder.

### Technical Data:

- All products carry a 3:1 safety factor.

### Material Specification

<b>Gripple</b>	Housing	Type ZA2 Zinc
	Wedge	Sintered steel hardened to min. 56 Rockwell C
	Spring	Stainless Steel (Type 302)
	End Cap	UV stabilised homopolymer propylene

### Wire Rope

Grade galvanised high tensile steel wire rope to EN12385  
Standard lengths from 1m - 10m, other lengths can be made to order.

Wire Rope Specification	No.1	No.2	No.3
Diameter (mm)	1.5mm	2mm	3mm
Strand configuration	7 x 7	7 x 7	7 x 7
Min breaking load (kg)	180	260	580
Max. working load (kg)	10	45	90
Tensile strength (Nmm <sup>2</sup> )	1770	1770	1770

**Link Hook and Ferrule:** Zinc plated steel

## Y-FIT STUD

### Y-fit with crimped M6 or M8 Studs



#### Grippler



#### Sizes

M6 Grippler No.1-No.3  
M8 Grippler No.2-No.3

#### Safe Working Loads:

No.1	0 - 10kg
No.2	10 - 45kg
No.3	45 - 90kg

#### Function:

Recommended for the suspension of HVAC, electrical and mechanical services in an indoor, stationary setting.

#### Applications:

Suitable for use on existing metal brackets.

#### Technical Data:

- All products carry a minimum 5:1 safety factor

#### Material Specification

Grippler	Housing	Type ZA2 Zinc
	Wedge	Sintered steel hardened to min. 56 Rockwell C
	Spring	Stainless Steel (Type 302)
	End Cap	UV stabilised homopolymer propylene

#### Wire Rope

Grade galvanised high tensile steel wire rope to EN12385  
Standard lengths from 1m - 3m, other lengths can be made to order.


Wire Rope Specification	No.1	No.2	No. 3
Diameter (mm)	1.5mm	2mm	3mm
Strand configuration	7 x 7	7 x 7	7 x 7
Min breaking load (kg)	180	260	580
Max. working load (kg)	10	45	90
Tensile strength (Nmm <sup>2</sup> )	1770	1770	1770

#### Stud ends:

M6 diameter zinc plated steel 20mm or 45mm thread length.  
M8 diameter zinc plated steel 45mm thread length.

## Y-FIT TOGGLE

### Y-fit crimped with end stops and toggle plates

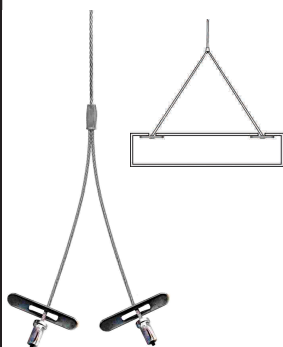

#### Grippler



#### Sizes

Grippler No.1-No.3

#### Safe Working Loads:

No.1	0 - 10kg
No.2	10 - 45kg
No.3	45 - 90kg

#### Function:

Recommended for the suspension of HVAC, electrical and mechanical services in an indoor, stationary setting.

#### Applications:

Suitable for light fittings, luminaires and other cavities.

#### Technical Data:

- All products carry a minimum 5:1 safety factor.

#### Material Specification

Grippler	Housing	Type ZA2 Zinc
	Wedge	Sintered steel hardened to min. 56 Rockwell C
	Spring	Stainless Steel (Type 302)
	End Cap	UV stabilised homopolymer propylene

#### Wire Rope

Grade galvanised high tensile steel wire rope to EN12385  
Standard lengths from 1m - 3m, other lengths can be made to order.

Wire Rope Specification	No.1	No.2	No.3
Diameter (mm)	1.5mm	2mm	3mm
Strand configuration	7 x 7	7 x 7	7 x 7
Min breaking load (kg)	180	260	580
Max. working load (kg)	10	45	90
Tensile strength (Nmm <sup>2</sup> )	1770	1770	1770


#### Toggle plates and end stops:

Zinc plated steel

# Submittal Data

## Y-FIT SNAP HOOK

### Y-fit with crimped Snap Hooks



### Gripple



### Sizes

Gripple No.1-No.3

### Safe Working Loads:

No.1	0 - 10kg
No.2	10 - 45kg
No.3	45 - 90kg

### Function:

Recommended for the suspension of HVAC, electrical and mechanical services in an indoor, stationary setting.

### Applications:

Suitable for use on cable basket or ladder. Ideal for services that require maintenance.

### Technical Data:

- All products carry a minimum 5:1 safety factor

### Material Specification

<b>Gripple</b>	Housing	Type ZA2 Zinc
	Wedge	Sintered steel hardened to min. 56 Rockwell C
	Spring	Stainless Steel (Type 302)
	End Cap	UV stabilised homopolymer propylene

### Wire Rope


Grade galvanised high tensile steel wire rope to EN12385  
Standard lengths from 1m - 3m, other lengths can be made to order.

Wire Rope Specification	No.1	No.2	No.3
Diameter (mm)	1.5mm	2mm	3mm
Strand configuration	7 x 7	7 x 7	7 x 7
Min breaking load (kg)	180	260	580
Max. working load (kg)	10	45	90
Tensile strength (Nmm <sup>2</sup> )	1770	1770	1770

**Hooks:** zinc plated steel

## Y-FIT LINK HOOK

### Y-fit with crimped loops and link hooks

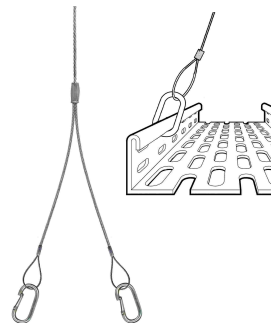

### Gripple



### Sizes

Gripple No.1-No.3

### Safe Working Loads:

No.1	0 - 10kg
No.2	10 - 45kg
No.3	45 - 90kg

### Function:

Recommended for the suspension of HVAC, electrical and mechanical services in an indoor, stationary setting.

### Applications:

Suitable for light cable tray, basket or ladder. Ideal for services that require maintenance.

### Technical Data:

- All products carry a minimum 5:1 safety factor.

### Material Specification

<b>Gripple</b>	Housing	Type ZA2 Zinc
	Wedge	Sintered steel hardened to min. 56 Rockwell C
	Spring	Stainless Steel (Type 302)
	End Cap	UV stabilised homopolymer propylene

### Wire Rope

Grade galvanised high tensile steel wire rope to EN12385  
Standard lengths from 1m - 3m, other lengths can be made to order.


Wire Rope Specification	No.1	No.2	No.3
Diameter (mm)	1.5mm	2mm	3mm
Strand configuration	7 x 7	7 x 7	7 x 7
Min breaking load (kg)	180	260	580
Max. working load (kg)	10	45	90
Tensile strength (Nmm <sup>2</sup> )	1770	1770	1770

**Link Hooks and Ferrules:** Zinc plated steel

# Submittal Data

## STAINLESS STEEL LOOP

Wire rope with crimped loop



Gripple



### Sizes

Gripple No.2-No.3

### Safe Working Loads:

No.2 0 - 45kg  
No.3 45 - 90kg

### Function:

Recommended for the suspension of HVAC, electrical and mechanical services in an indoor, stationary setting.

### Applications:

Purlins, beams, roof trusses and other accessible building features.

### Technical Data:

- All products carry a 5:1 safety factor.

### Material Specification

**Gripple** Housing Type 316/A4 Stainless Steel  
Wedge Ceramic  
Spring Type 302 Stainless Steel  
End Cap Type 316/A4 Stainless Steel

### Wire Rope


Type 316/A4 Stainless Steel  
Standard lengths from 1m - 10m, other lengths can be made to order.

Wire Rope Specification	No.2	No.3
Diameter (mm)	2mm	3mm
Strand configuration	7 x 7	7 x 7
Min breaking load (kg)	242	545
Max. safe working load (kg)	45	90
Tensile strength (Nm2)	1570	1570

**Crimp/ferrule:** 316/A4 Stainless Steel

## STAINLESS STEEL STUD

Wire Rope with crimped M6 or M8 stud

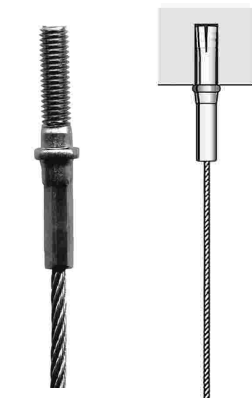

Gripple



### Sizes

M6 Gripple No.2-No.3  
M8 Gripple No.2-No.3

### Safe Working Loads:

No.2 0 - 45kg  
No.3 45 - 90kg

### Function:

Recommended for the suspension of HVAC, electrical and mechanical services in an indoor, stationary setting.

### Applications:

Concrete ceilings, metal decking and pressed metal brackets (with nuts).

### Technical Data:

- All products carry a 5:1 safety factor
- SMACNA compliance - Tested and verified to be an acceptable hanger per the SMACNA, HVAC DUCT CONSTRUCTION STANDARDS MANUAL (1995). Full report available on request, or visit [www.smacnatri.org](http://www.smacnatri.org), click on Testing Program.
- UL Listing - UL 1598 luminaire fitting sizes 1 - 5, UL 2289 Conduit and Cable Hardware sizes 2, 3 and 4.
- CSA - Class 3426-01 luminaire fittings.
- Other approvals include Lloyds Register, Apave, Tüv and DW144.

### Material Specification

**Gripple** Housing Type 316/A4 Stainless Steel  
Wedge Ceramic  
Spring Type 302 Stainless Steel  
End Cap Type 316/A4 Stainless Steel

### Wire Rope

Type 316/A4 Stainless Steel  
Standard lengths from 1m - 10m, other lengths can be made to order.

Wire Rope Specification	No.2	No.3
Diameter (mm)	2mm	3mm
Strand configuration	7 x 7	7 x 7
Min breaking load (kg)	242	545
Max. safe working load (kg)	45	90
Tensile strength (Nmm2)	1570	1570


**Stud end:** M6 diameter type 304/A2 stainless steel 20mm thread length  
M8 diameter type 304/A2 stainless steel 45mm thread length



# Submittal Data

## STAINLESS STEEL TOGGLE

Wire rope with crimped  
end stop and toggle plate



### Gripple



### Sizes

Gripple No.2

### Safe Working Loads:

No.2 0 - 45kg  
5:1 safety factor

### Function:

Recommended for the suspension of HVAC, electrical and mechanical services in an indoor, stationary setting.

### Applications:

Suitable for profile roof cladding, light fittings, luminaires and other cavities.

### Technical Data:

5:1 safety factor.

### Material Specification

<b>Gripple</b>	Housing	Type 316/A4 Stainless Steel
	Wedge	Ceramic
	Spring	Type 302 Stainless Steel
	End Cap	Type 316/A4 Stainless Steel

### Wire Rope


Type 304/A2 Stainless Steel  
Standard lengths from 1m - 10m, other lengths can be made to order.

Wire Rope Specification	No.2
Diameter (mm)	2mm
Strand configuration	7 x 7
Min breaking load (kg)	242
Max. safe working load (kg)	45
Tensile strength (Nmm <sup>2</sup> )	1570

**Crimp/ferrule:** 304L/A2 Stainless Steel

## STAINLESS STEEL SNAP HOOK

Wire rope with crimped  
snap-on hook



### Gripple



### Sizes

Gripple sizes No.2

### Safe Working Loads:

No.2 0 - 45kg  
3:1 safety factor

### Function:

Recommended for the suspension of HVAC, electrical and mechanical services in an indoor, stationary setting.

### Applications:

Suitable for use on cable basket and ladder.

### Technical Data:

3:1 safety factor

### Material Specification

<b>Gripple</b>	Housing	Type 316/A4 Stainless Steel
	Wedge	Ceramic
	Spring	Type 302 Stainless Steel
	End Cap	Type 316/A4 Stainless Steel

### Wire Rope

Type 304/A2 Stainless Steel  
Standard lengths from 1m - 10m, other lengths can be made to order.


Wire Rope Specification	No.2
Diameter (mm)	2mm
Strand configuration	7 x 7
Min breaking load (kg)	242
Max. working load (kg)	45
Tensile strength (Nmm <sup>2</sup> )	1570

**Hook:** 304/A2 Stainless Steel





## CHANNEL NUT WITHOUT SPRINGS



Part Number	Nut Size Thread	Wt/100 pcs Lbs (kg)	Use With
A3006-1420	1/4" -20	5 (2.3)	A1000, A3300, A4000, & A5000
A3007	5/16" -18	5 (2.3)	
A3008	3/8" -16	5 (2.3)	

**MATERIAL**

Unistrut channels are accurately and carefully cold formed to size from low-carbon strip steel.

**STEEL: PLAIN**

- 14 Gauge (1.9 mm), ASTM A1011 SS GR 33
- 19 Gauge (1.0 mm) ASTM A1008

**STEEL: PRE-GALVANIZED**

- 14 Gauge (1.9 mm) ASTM A653 GR 33,
- 19 Gauge (1.0 mm) ASTM A653 GR 33

Channel nuts are manufactured from mild steel bars conforming to ASTM A576, GR 1015, and are case hardened.

Fittings are made from hot rolled, pickled and oiled steel plate or strip and conform to ASTM A1011 SS GR 33.

Many framing channels are available in special metal on request. Consult factory for ordering information.

**FINISHES**

All channels and fittings are available in: Perma-Green III (GR), Pre-galvanized (PG), conforming to ASTM A653 GR 33 and plain (PL).

Nuts are available in plain or electro-galvanized (EG) finish.

Fittings are available in Perma-Green III (GR) or plain (PL).

Project: \_\_\_\_\_

Approval Stamp: \_\_\_\_\_

Architect / Engineer: \_\_\_\_\_

Date: \_\_\_\_\_ Phone: \_\_\_\_\_

Contractor: \_\_\_\_\_


Address: \_\_\_\_\_

Notes 1: \_\_\_\_\_

Notes 2: \_\_\_\_\_



## CHANNEL NUT WITH SPRING



Part Number	Nut Size Thread	Wt/100 pcs Lbs (kg)	Use With
A1006-1420	1/4" -20	6 (2.7)	A1000
A1007	5/16" -18	6 (2.7)	
A1008	3/8" -16	6 (2.7)	

## MATERIAL

Unistrut channels are accurately and carefully cold formed to size from low-carbon strip steel.

## STEEL: PLAIN

- 14 Gauge (1.9 mm), ASTM A1011 SS GR 33
- 19 Gauge (1.0 mm) ASTM A1008

## STEEL: PRE-GALVANIZED

- 14 Gauge (1.9 mm) ASTM A653 GR 33,
- 19 Gauge (1.0 mm) ASTM A653 GR 33

Channel nuts are manufactured from mild steel bars conforming to ASTM A576, GR 1015, and are case hardened.

Fittings are made from hot rolled, pickled and oiled steel plate or strip and conform to ASTM A1011 SS GR 33.

Many framing channels are available in special metal on request. Consult factory for ordering information.

## FINISHES

All channels and fittings are available in: Perma-Green III (GR), Pre-galvanized (PG), conforming to ASTM A653 GR 33 and plain (PL).

Nuts are available in plain or electro-galvanized (EG) finish.

Fittings are available in Perma-Green III (GR) or plain (PL).

Project: \_\_\_\_\_

Approval Stamp:

Architect / Engineer: \_\_\_\_\_

Date: \_\_\_\_\_ Phone: \_\_\_\_\_

Contractor: \_\_\_\_\_

Address: \_\_\_\_\_

Notes 1: \_\_\_\_\_


Notes 2: \_\_\_\_\_

**METAL PIPE THROUGH WOOD FLOOR/CEILING ASSEMBLY**

F-RATING = 1-HR. OR 2-HR.

T-RATING = 0-HR. OR 1/2-HR.

FC1059g.081108

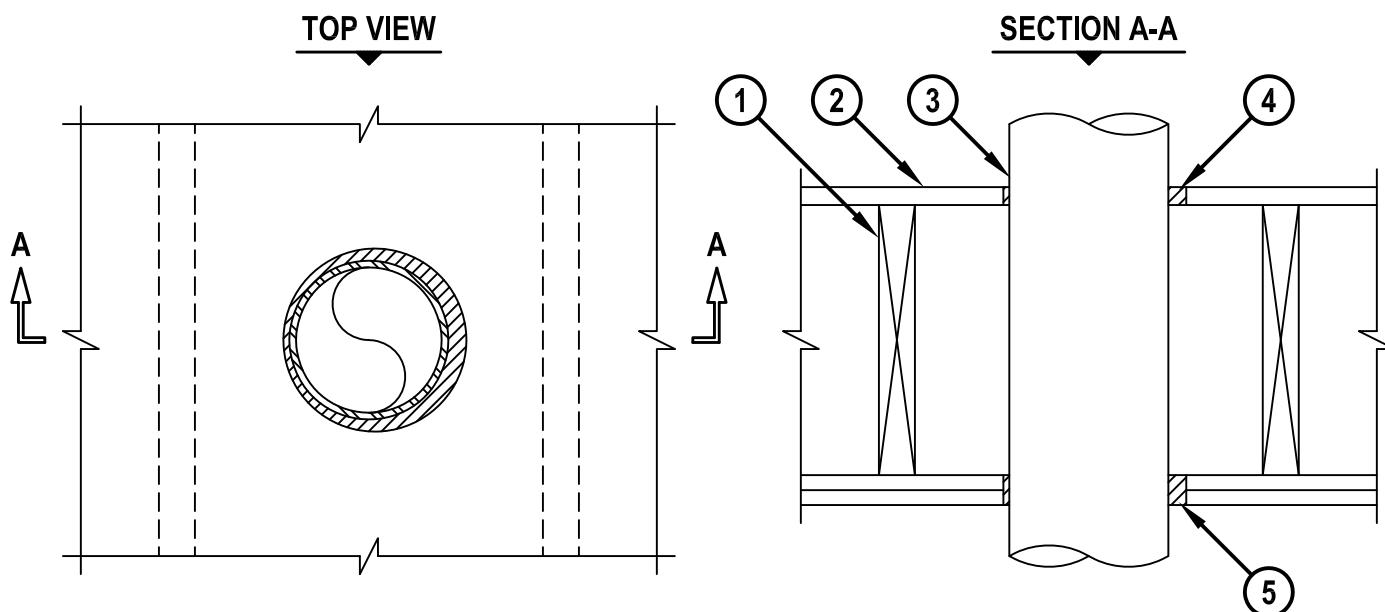


1. WOOD FLOOR/CEILING ASSEMBLY (UL/cUL CLASSIFIED L500 SERIES) (1-HR. OR 2-HR. FIRE-RATING) (2-HR. SHOWN).
2. LUMBER OR PLYWOOD SUBFLOOR WITH FINISH FLOOR OF LUMBER, PLYWOOD, OR FLOOR TOPPING MIXTURE.
3. PENETRATING ITEM TO BE ONE OF THE FOLLOWING:
  - A. MAXIMUM 6" NOMINAL DIAMETER STEEL PIPE (SCHEDULE 40 OR HEAVIER).
  - B. MAXIMUM 6" NOMINAL DIAMETER CAST IRON PIPE.
  - C. MAXIMUM 6" NOMINAL DIAMETER STEEL CONDUIT.
  - D. MAXIMUM 4" NOMINAL DIAMETER EMT.
  - E. MAXIMUM 2" NOMINAL DIAMETER FLEXIBLE STEEL CONDUIT.
4. MINIMUM 3/4" DEPTH HILTI FS-ONE INTUMESCENT FIRESTOP SEALANT FLUSH WITH TOP SURFACE OF SUBFLOOR OR SOLE PLATE.
5. HILTI FS-ONE INTUMESCENT FIRESTOP SEALANT FLUSH WITH BOTTOM SURFACE OF CEILING OR LOWER TOP PLATE :
  - A. MINIMUM 5/8" DEPTH OF SEALANT FOR A 1-HR. FIRE-RATING.
  - B. MINIMUM 1-1/4" DEPTH OF SEALANT FOR A 2-HR. FIRE-RATING.

NOTES : 1. MAXIMUM DIAMETER OF OPENING = 7-5/8".

2. ANNULAR SPACE = MINIMUM 1/4", MAXIMUM 3/4".

3. CHASE WALL (NOT SHOWN, OPTIONAL) - THE THROUGH PENETRANT MAY BE ROUTED THROUGH A 1-HR. OR 2-HR. FIRE-RATED GYPSUM CHASE WALL ASSEMBLY.

**Hilti Firestop Systems**

HILTI, Inc.  
Tulsa, Oklahoma USA (800) 879-8000

Sheet	1 of 1
Scale	1/8" = 1"
Date	Aug. 11, 2008

Drawing No.


**FC**  
**1059h**

*Saving Lives through Innovation and Education*

**METAL PIPE THROUGH WOOD FLOOR ASSEMBLY**

F-RATING = 1-HR.  
T-RATING = 1/4-HR.

FC1106b.071204

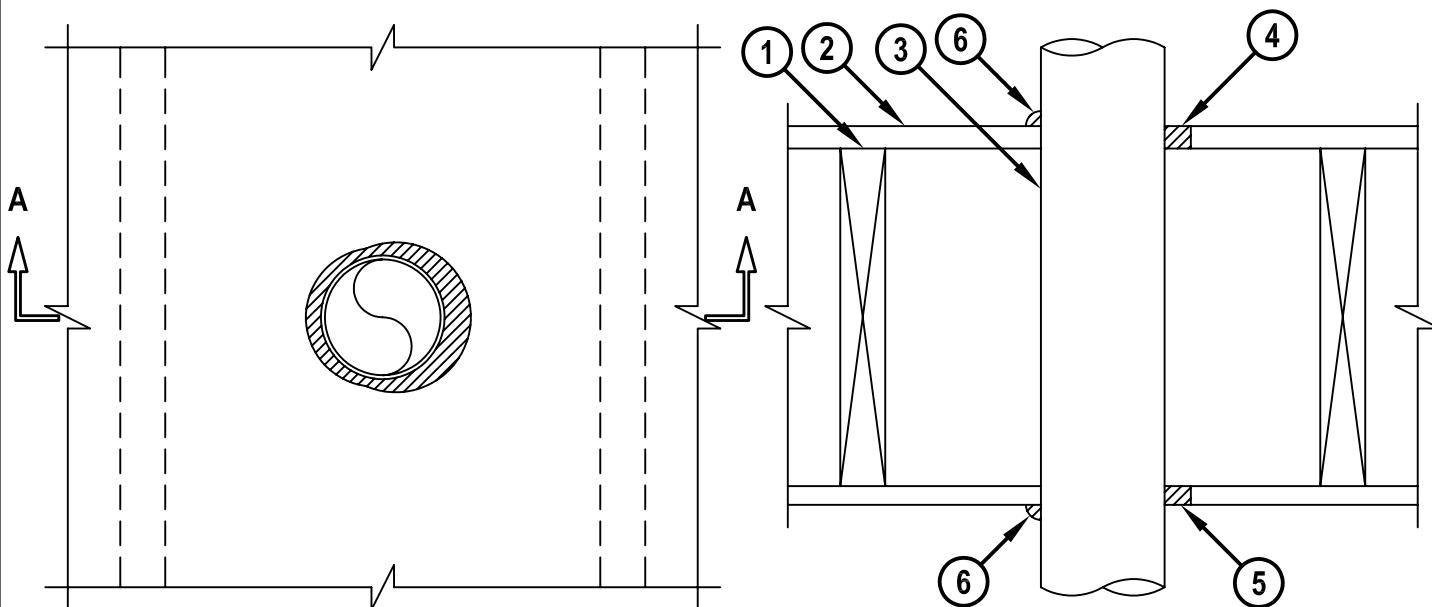**TOP VIEW****SECTION A-A**

1. WOOD FLOOR/CEILING ASSEMBLY (UL/cUL CLASSIFIED L500 SERIES) (1-HR. FIRE-RATING).
2. LUMBER OR PLYWOOD SUBFLOOR WITH FINISH FLOOR OF LUMBER, PLYWOOD, OR FLOOR TOPPING MIXTURE.
3. PENETRATING ITEM TO BE ONE OF THE FOLLOWING :
  - A. MAXIMUM 4" NOMINAL DIAMETER STEEL PIPE (SCHEDULE 10 OR HEAVIER).
  - B. MAXIMUM 4" NOMINAL DIAMETER CAST IRON OR DUCTILE IRON PIPE.
  - C. MAXIMUM 4" NOMINAL DIAMETER COPPER PIPE OR COPPER TUBING.
  - D. MAXIMUM 4" NOMINAL DIAMETER STEEL CONDUIT.
  - E. MAXIMUM 4" NOMINAL DIAMETER EMT.
4. MINIMUM 3/4" DEPTH HILTI CP 606 FLEXIBLE FIRESTOP SEALANT.
5. MINIMUM 5/8" DEPTH HILTI CP 606 FLEXIBLE FIRESTOP SEALANT.
6. MINIMUM 1/2" BEAD HILTI CP 606 FLEXIBLE FIRESTOP SEALANT AT POINT OF CONTACT.

**NOTES :** 1. MAXIMUM DIAMETER OF OPENING = 5".  
 2. ANNULAR SPACE = MINIMUM 0", MAXIMUM 7/8".  
 3. CHASE WALL (NOT SHOWN, OPTIONAL) - THE THROUGH PENETRANT MAY ROUTED THROUGH A 1-HR. FIRE-RATED GYPSUM CHASE WALL.

**HILTI®**  
**FIRESTOP SYSTEMS**

HILTI, Inc.  
 Tulsa, Oklahoma USA (918) 252-6000

Sheet	1 of 1
Scale	5/32" = 1"
Date	July 12, 2004

Drawing No.

**FC**  
**1106b**

*Saving Lives through Innovation and Education*

Table Of Contents

UL Listings

F-C-7013..... 1

F-C-8026 (US Only)..... 3

W-L-1054..... 5

W-L-7042..... 7

W-L-7155..... 8

CFS-S SIL GG

Product Data Sheet for CFS-S SIL GG Firestop Silicone Sealant..... 10

UL Certificate of Compliance for CFS-S SIL SL and CFS-S SIL GG Firestop Silicone Sealant..... 11

LEED Information for CFS-S SIL GG Firestop Silicone Sealant..... 12

CP 606

Product Data Sheet for CP 606 Flexible Firestop Sealant..... 13

UL Certificate of Compliance for CP 606 Flexible Firestop Sealant..... 14

LEED Information for CP 606 Flexible Firestop Sealant..... 15

FS-ONE MAX

Product Data Sheet for FS-ONE MAX Intumescent Firestop Sealant..... 16

Buy American Certification for FS-ONE MAX Intumescent Firestop Sealant..... 17

LEED Information for FS-ONE MAX Intumescent Firestop Sealant..... 18

Mineral wool

Product Data Sheet for Mineral Wool..... 19


UL Certificate of Compliance for Mineral Wool..... 21

LEED Information for Mineral Wool..... 22

# System No. F-C-7013

FC 7013

ANSI/UL1479 (ASTM E814)	CAN/ULC S115
F Rating — 1 Hr	F Rating — 1 Hr
T Rating — 0 Hr	FT Rating — 0 Hr
	FH Rating — 1 Hr
	FTH Rating — 0 Hr

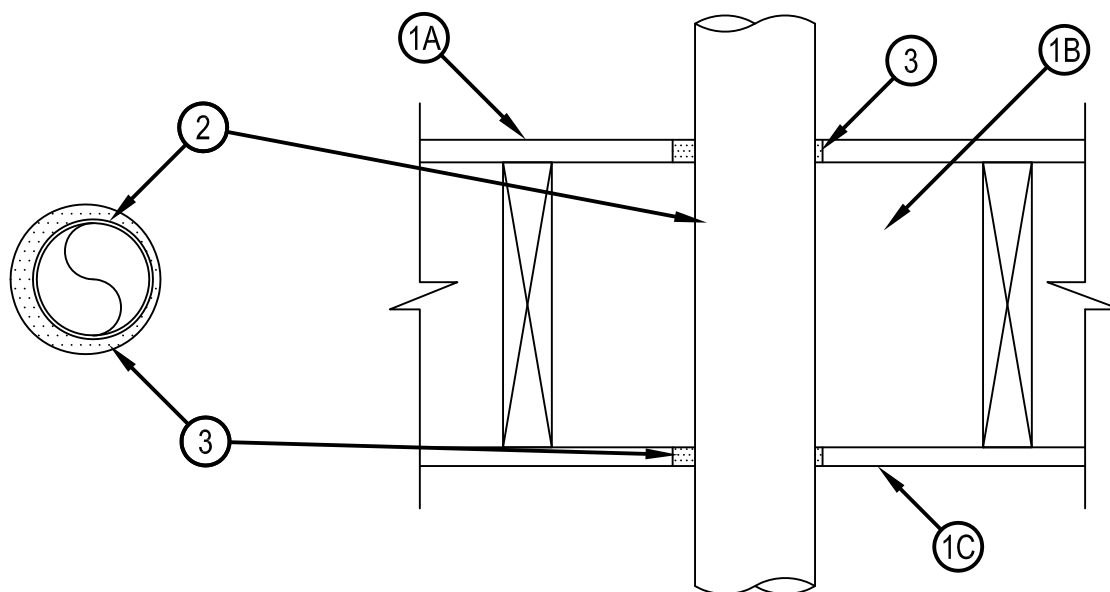

**SECTION A-A**

1. Floor-Ceiling Assembly — The 1 hr fire-rated solid or trussed lumber joist floor-ceiling assembly shall be constructed of the materials and in the manner specified in the individual L500 Series Floor-Ceiling Designs in the UL Fire Resistance Directory. The general construction features of the floor-ceiling assembly are summarized below:
  - A. Flooring System — Lumber or plywood subfloor with finish floor of lumber, plywood or Floor Topping Mixture\* as specified in the individual Floor-Ceiling Design. Max diam of opening shall be 5-1/4 in. (133 mm).
  - B. Wood Joist\* — Nom 10 in. (254 mm) deep (or deeper) lumber, steel or combination lumber and steel joists, trusses or Structural Wood Members\* with bridging as required and with ends firestopped.
  - C. Gypsum Board\* — Nom 4 ft (1.2 m) wide by 5/8 in. (16 mm) thick as specified in the individual Floor-Ceiling Design. Max diam of opening shall be 5-1/4 in. (133 mm).
- 1.1 Chase Wall — (Not shown, Optional) The through penetrants (Item 2) may be routed through a 1 hr fire-rated single, double or staggered wood stud/gypsum wallboard chase wall having a fire rating consistent with that of the floor-ceiling assembly. The chase wall shall be constructed of the materials and in the manner specified in the individual U300 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall include the following construction features:
  - A. Studs — Nom 2 by 6 in. (51 by 152 mm) lumber or double nom 2 by 4 in. (51 by 102 mm) lumber studs.
  - B. Sole Plate — Nom 2 by 6 in. (51 by 152 mm) lumber or parallel 2 by 4 in. (51 by 102 mm) lumber plates, tightly butted. Max diam of opening shall be 5-1/4 in.
  - C. Top Plate — The double top plate shall consist of two nom 2 by 6 in. (51 by 152 mm) lumber plates or two sets of nom 2 by 4 in. (51 by 102 mm) lumber plates tightly butted. Max diam of opening is 5-1/4 in. (133 mm).
  - D. Gypsum Board\* — Thickness, type, number of layers and fasteners shall be as specified in individual Wall and Partition Design.



**Hilti Firestop Systems**

Reproduced by HILTI, Inc. Courtesy of  
 Underwriters Laboratories, Inc.  
 January 20, 2015

2. Steel Duct — Nom 4 in. (102 mm) diam (or smaller) No. 28 gauge (or heavier) steel duct to be installed either concentrically or eccentrically within the firestop system. The annular space between duct and periphery of opening shall be min of 1/4 in. (6 mm) to max 3/4 in. (19 mm). Steel duct to be rigidly supported on both sides of floor-ceiling assembly.
3. Fill, Void or Cavity Materials\*-Sealant — Min 3/4 in. (19 mm) thickness of sealant applied within the annular space, flush with top surface of floor or sole plate. Min 5/8 in. (16 mm) thickness of sealant applied within annular space, flush with bottom surface of gypsum board or lower top plate.  
HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — FS-ONE Sealant or FS-ONE MAX Intumescent Sealant

\* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.







Classified by  
Underwriters Laboratories, Inc.  
to UL 1479 and CAN/ULC-S115

## System No. F-C-8026

ANSI/UL1479 (ASTM E814)	CAN/ULC S115
F Rating — 1 Hr	F Rating — 1 Hr
T Rating — 1 Hr	FT Rating — 1 Hr
	FH Rating — 1 Hr
	FTH Rating — 1 Hr

FC 8026

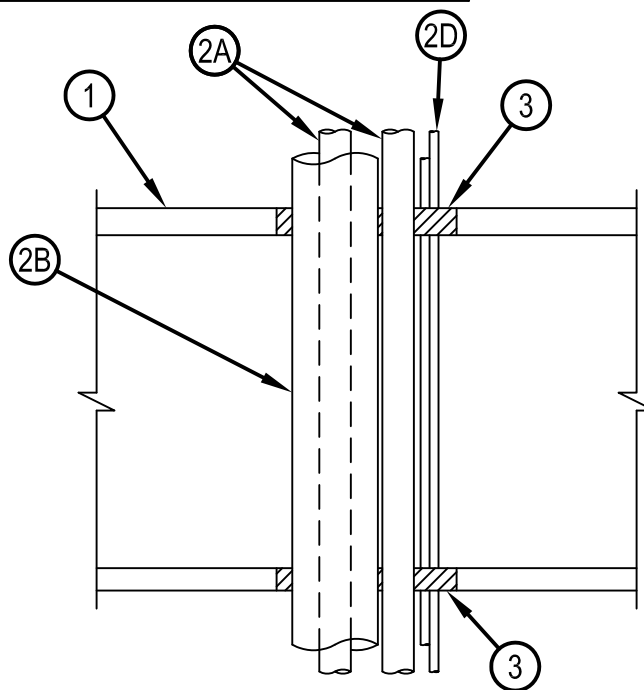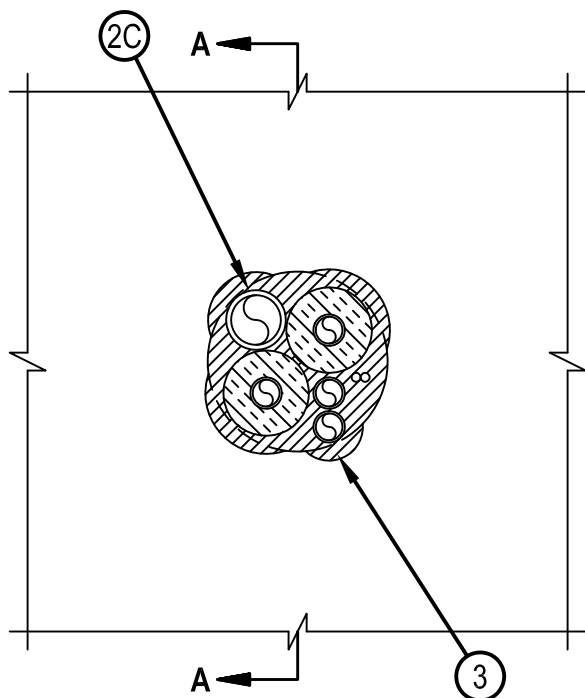

### SECTION A-A

System tested with a pressure differential of 2.5 Pa between the exposed and the unexposed surfaces with the higher pressure on the exposed side.

1. Floor-Ceiling Assembly — The 1 hr fire-rated solid or trussed lumber joist floor-ceiling assembly shall be constructed of the materials and in the manner specified in the individual L500 Series Floor-Ceiling Designs in the UL Fire Resistance Directory. The general construction features of the floor-ceiling assembly are summarized below:

- A. Flooring System — Lumber or plywood subfloor with finish floor of lumber, plywood or Floor Topping Mixture\* as specified in the individual Floor-Ceiling Design. Max diam of opening shall be 5 in. (127 mm).
- B. Wood Joists\* — Nom 10 in. (254 mm) deep (or deeper) lumber, steel or combination lumber and steel joists, trusses or Structural Wood Members\* with bridging as required and with ends firestopped.
- C. Gypsum Board\* — Nom 4 ft (122 cm) wide by 5/8 in. (16 mm) thick as specified in the individual Floor-Ceiling Design. Gypsum board secured to wood joists or furring channels as specified in the individual Floor-Ceiling Design.

1A. Chase Wall — (Optional, Not Shown) - The through penetrants (Item 2) may be routed through a 1 hr fire rated single, double or staggered wood stud/gypsum board chase wall. Depth of chase wall stud cavity to be min 1/2 in. (13 mm) greater than diameter of opening cut in sole and top plates to accommodate the through penetrant (Item 2). The chase wall shall be constructed of the materials and in the manner specified in the individual U300 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall include the following construction features:

- A. Studs — Nom 2 by 4 in. (51 by 102 mm), 2 by 6 in. (51 by 152 mm) or double nom 2 by 4 in. (51 by 102 mm) lumber studs.
- B. Sole Plate — Nom 2 by 4 in. (51 by 102 mm), 2 by 6 in. (51 by 152 mm) or parallel 2 by 4 in.. (51 by 102 mm) lumber plates, tightly butted. Max diam of opening is 5 in. (127 mm).
- C. Top Plate — The double top plate shall consist of two nom 2 by 4 in. (51 by 102 mm), two nom 2 by 6 in., (51 by 102 mm) or two sets of parallel 2 by 4 in.. (51 by 102 mm) lumber plates, tightly butted. Max diam of opening is 5 in. (127 mm).
- D. Gypsum Board\* — Thickness, type, number of layers and fasteners shall be as specified in the individual Wall and Partition Design.



**Hilti Firestop Systems**

Reproduced by HILTI, Inc. Courtesy of  
Underwriters Laboratories, Inc.  
January 21, 2015



2. Through Penetrants — One or more pipes, conduits, tubing and cables to be installed concentrically or eccentrically within the opening. The space between any penetrant, except nonmetallic pipes and uninsulated metallic pipes to be min 0 in. (point contact) to max 1 in. (25 mm). The space between any penetrants and the periphery of the opening shall be min 0 in. (point contact) to max 1 in. (25 mm). Pipes, conduits, tubing and cables to be rigidly supported on both sides of floor-ceiling assembly.

A. Metallic Penetrants — One or more metallic pipes, conduits or tubing to be installed within the firestop system. The following types and sizes of metallic pipes, conduits or tubing may be used:

A1. Steel Pipe — Nom 3/4 in. (19 mm) diam (or smaller) Schedule 10 (or heavier) steel pipe.

A2. Conduit — Nom 3/4 in. (19 mm) diam (or smaller) steel electrical metallic tubing (EMT) or 3/4 in. (19 mm) diam galv steel conduit.

A3. Copper Tube — Nom 3/4 in. (19 mm) diam (or smaller) Type L (or heavier) copper tube.

A4. Copper Pipe — Nom 3/4 in. (19 mm) diam (or smaller) Regular (or heavier) copper pipe.

B. Tube Insulation - Plastics+ — Nom 3/4 in. (19 mm) thick acrylonitrile butadiene/polyvinyl chloride (AB/PVC) flexible foam furnished in the form of tubing. Tube insulation to be installed on one or more of the metallic pipes or tubes (Item 2A).

See Plastics+ (QMFZ2) category in the Plastics Recognized Component Directory for names of manufacturers. Any Recognized Component tube insulation material meeting the above specifications and having a UL 94 Flammability Classification of 94-5VA may be used.

C. Nonmetallic Through Penetrants — One nonmetallic pipe to be installed within the firestop system. Pipe shall be spaced a min 1-1/2 in. (38 mm) from non-uninsulated metallic through penetrants. The following types and sizes of metallic pipes may be used:

C1. Polyvinyl Chloride (PVC) Pipe — Nom 1-1/4 in. (32 mm) diam (or smaller) Schedule 40 solid core PVC pipe for use in closed (process or supply) or vented (drain, waste or vent) piping system.

C2. Chlorinated Polyvinyl Chloride (CPVC) Pipe — Nom 1-1/4 in. (32 mm) diam (or smaller) SDR13.5 CPVC pipe for use in closed (process or supply) piping systems.

D. Cables — Max of two 4 pair No. 18 AWG (or smaller) cable with PVC insulation and jacket materials.

3. Fill, Void or Cavity Materials\* - Sealant — Min 3/4 in. (19 mm) thickness of sealant applied within the annulus flush with the top surface of the floor or sole plate and min 5/8 in. (16 mm) thickness of sealant applied within the annulus flush with the bottom surface of gypsum board or top plate. A min 1/4 in. (6 mm) diameter bead of sealant applied at the bundle/subflooring or sole plate interface and the bundle/gypsum board or top plate interface at point contact locations.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — FS-ONE Sealant or FS-ONE\_MAX Intumescent Sealant

\* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

+Bearing the UL Recognized Component Mark






Classified by  
Underwriters Laboratories, Inc.  
to UL 1479 and CAN/ULC-S115

## System No. W-L-1054

WL 1054

ANSI/UL1479 (ASTM E814)	CAN/ULC S115
F Ratings — 1 and 2 Hr (See Items 1 and 3)	F Ratings — 1 and 2 Hr (See Items 1 and 3)
T Rating — 0 Hr	FT Rating — 0 Hr
L Rating at Ambient — Less Than 1 CFM/sq ft	FH Ratings — 1 and 2 Hr (See Items 1 and 3)
L Rating at 400 F — Less Than 1 CFM/sq ft	FTH Rating — 0 Hr
	L Rating at Ambient — Less Than 1 CFM/sq ft
	L Rating at 400 F — Less Than 1 CFM/sq ft

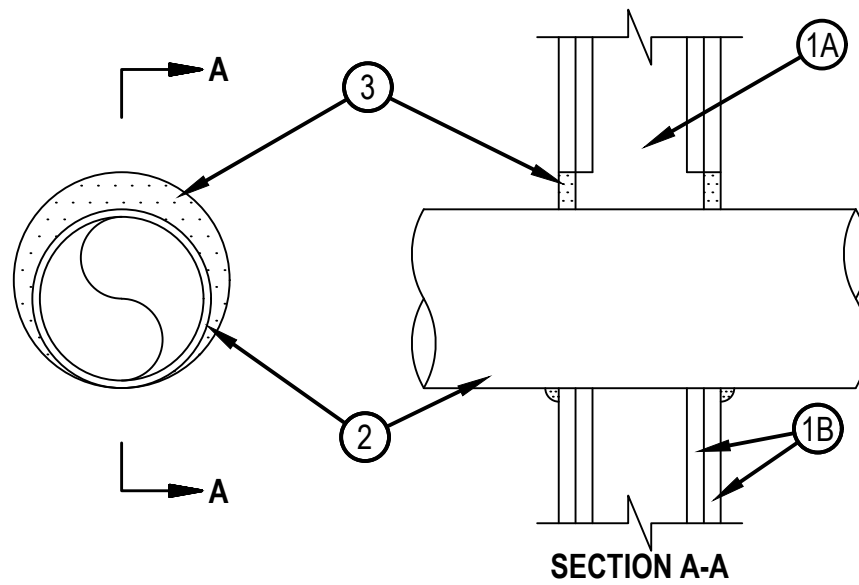

1. Wall Assembly — The 1 or 2 hr fire-rated gypsum wallboard/stud wall assembly shall be constructed of the materials and in the manner specified in the individual U300 or U400 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall include the following construction features:

A. Studs — Wall framing may consist of either wood studs or steel channel studs. Wood studs to consist of nom 2 by 4 in. (51 by 102 mm) lumber spaced 16 in. (406 mm) OC. Steel studs to be min 2-1/2 in. (64 mm) wide and spaced max 24 in. (610 mm) OC. When steel studs are used and the diam of opening exceeds the width of stud cavity, the opening shall be framed on all sides using lengths of steel stud installed between the vertical studs and screw-attached to the steel studs at each end. The framed opening in the wall shall be 4 to 6 in. (102 to 152 mm) wider and 4 to 6 in. (102 to 152 mm) higher than the diam of the penetrating item such that, when the penetrating item is installed in the opening, a 2 to 3 in. (51 to 76 mm) clearance is present between the penetrating item and the framing on all four sides.

B. Gypsum Board\* — 5/8 in. (16 mm) thick, 4 ft (122 cm) wide with square or tapered edges. The gypsum board type, thickness, number of layers, fastener type and sheet orientation shall be as specified in the individual U300 or U400 Series Design in the UL Fire Resistance Directory. Max diam of opening is 32-1/4 in. (819 mm) for steel stud walls. Max diam of opening is 14-1/2 in. (368 mm) for wood stud walls.

The F and FH Ratings of the firestop system are equal to the fire rating of the wall assembly.



**Hilti Firestop Systems**

Reproduced by HILTI, Inc. Courtesy of  
Underwriters Laboratories, Inc.  
October 14, 2015

2. Through-Penetrants — One metallic pipe, conduit or tubing to be installed either concentrically or eccentrically within the firestop system. The annular space shall be min 0 in. to max 2-1/4 in. (57 mm). Pipe may be installed with continuous point contact. Pipe, conduit or tubing to be rigidly supported on both sides of wall assembly. The following types and sizes of metallic pipes, conduits or tubing may be used:
- A. Steel Pipe — Nom 30 in. (762 mm) diam (or smaller) Schedule 10 (or heavier) steel pipe.
  - B. Iron Pipe — Nom 30 in. (762 mm) diam (or smaller) cast or ductile iron pipe.
  - C. Conduit — Nom 4 in. (102 mm) diam (or smaller) steel electrical metallic tubing or 6 in. (152 mm) . diam steel conduit.
  - D. Copper Tubing — Nom 6 in. (152 mm) diam (or smaller) Type L (or heavier) copper tubing.
  - E. Copper Pipe — Nom 6 in. (152 mm) diam (or smaller) regular (or heavier) copper pipe.
3. Fill, Void or Cavity Material\* — Sealant — Min 5/8 in. (16 mm) thickness of fill material applied within the annulus, flush with both surfaces of wall. At the point or continuous contact locations between pipe and wall, a min 1/2 in. (13 mm) diam bead of fill material shall be applied at the pipe wall interface on both surfaces of wall.
- HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — FS-One Sealant or FS-ONE MAX Intumescent Sealant


\* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.



## System No. W-L-7042

WL 7042

ANSI/UL1479 (ASTM E814)	CAN/ULC S115
F Ratings - 1 and 2 Hr (See Items 1 and 3)	F Ratings - 1 and 2 Hr (See Items 1 and 3)
T Rating - 0 Hr	FT Rating - 0 Hr
	FH Ratings - 1 and 2 Hr (See Items 1 and 3)
	FTH Rating - 0 Hr

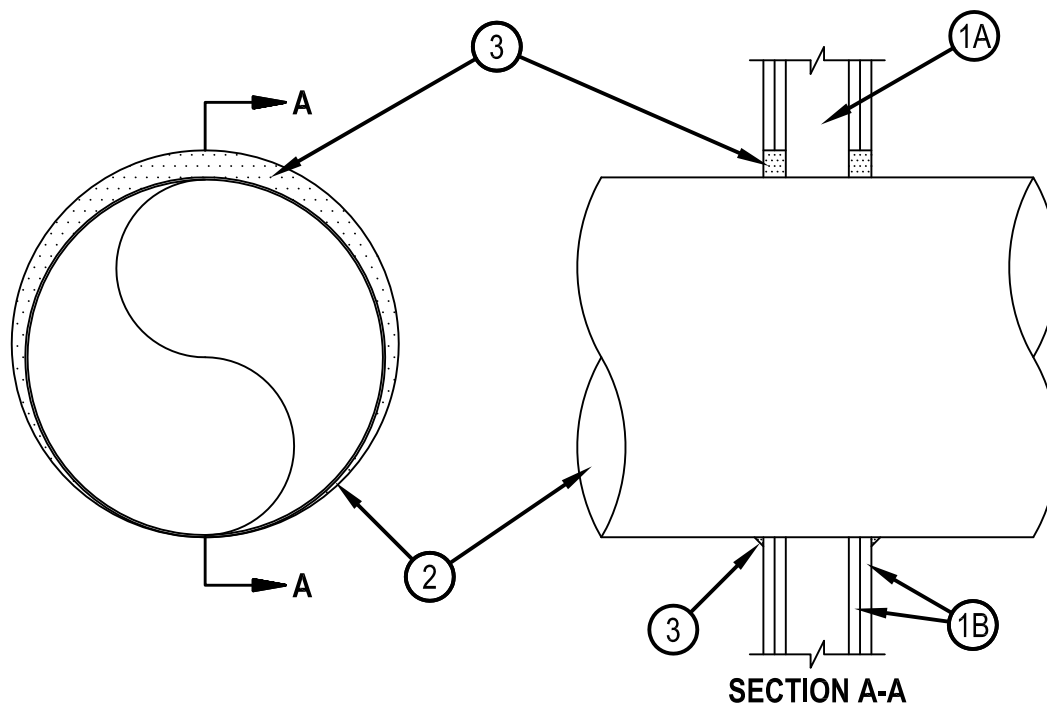

- Wall Assembly — The 1 or 2 hr fire rated wallboard/stud wall assembly shall be constructed of the materials and in the manner specified in the individual U300, U400, V400 or W400 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall include the following construction features.
  - Studs — Wall framing may consist of either wood studs or steel channel studs. Wood studs to consist of nom 2 by 4 in. (51 by 102 mm) lumber spaced 16 in. (406 mm) OC. Steel studs to be min 2-1/2 in. (64 mm) wide and spaced 24 in. (610 mm) OC.
  - Gypsum Board\* — For 1 hr assembly, one layer of min 5/8 in. (16 mm) thick wallboard as required in the individual Wall and Partition Design. For 2 hr assembly, two layers of min 5/8 in. (16 mm) thick wallboard as required in the individual Wall and Partition Design. Max diam of opening is 14-1/2 in. (368 mm) for wood stud walls and 21-3/4 in. (552 mm) for steel stud walls.


The hourly F and FH Ratings of the firestop system are equal to the hourly fire rating of the wall assembly in which it is installed.
- Through Penetrant — Galv steel duct to be installed concentrically or eccentrically within the firestop system. The annular space between the duct and periphery of opening shall be 0 in. (0 mm, point contact) and max 1-1/2 in. (64 mm) Duct to be rigidly supported on both sides of wall assembly.
  - Spiral Wound HVAC Duct — Nom 20 in. (502 mm) diam (or smaller) No. 24 MSG (or heavier) galv steel spiral wound duct.
  - Sheet Metal Duct — Nom 12 in. (305 mm) diam (or smaller) No. 28 MSG (or heavier) galv sheet steel duct.
- Fill, Void or Cavity Material\*—Sealant — Min 5/8 in. (16 mm) and 1-1/4 in. (32 mm) thickness of fill material applied within annulus, flush with both surfaces of wall assembly for 1 or 2 hr rated walls, respectively. At the point contact location between duct and wallboard, a min 1/2 in. (13 mm) diam bead of sealant shall be applied at the wallboard/duct interface on both surfaces of wall assembly.  
 HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CP601S Elastomeric Firestop Sealant, FS-ONE Sealant, FS-ONE MAX Intumescent Sealant or CP606 Flexible Firestop Sealant

\* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

## System No. W-L-7155

WL 7155

ANSI/UL1479 (ASTM E814)	CAN/ULC S115
F Ratings — 1 and 2 Hr (See Item 1)	F Ratings — 1 and 2 Hr (See Item 1)
T Ratings — 0 Hr	FT Ratings — 0 Hr
L Rating at Ambient — Less Than 1 CFM/sq ft	FH Ratings — 1 and 2 Hr (See Item 1)
L Rating at 400 F — Less Than 1 CFM/sq ft	FTH Ratings — 0 Hr
	L Rating at Ambient — Less Than 1 CFM/sq ft
	L Rating at 400 F — Less Than 1 CFM/sq ft

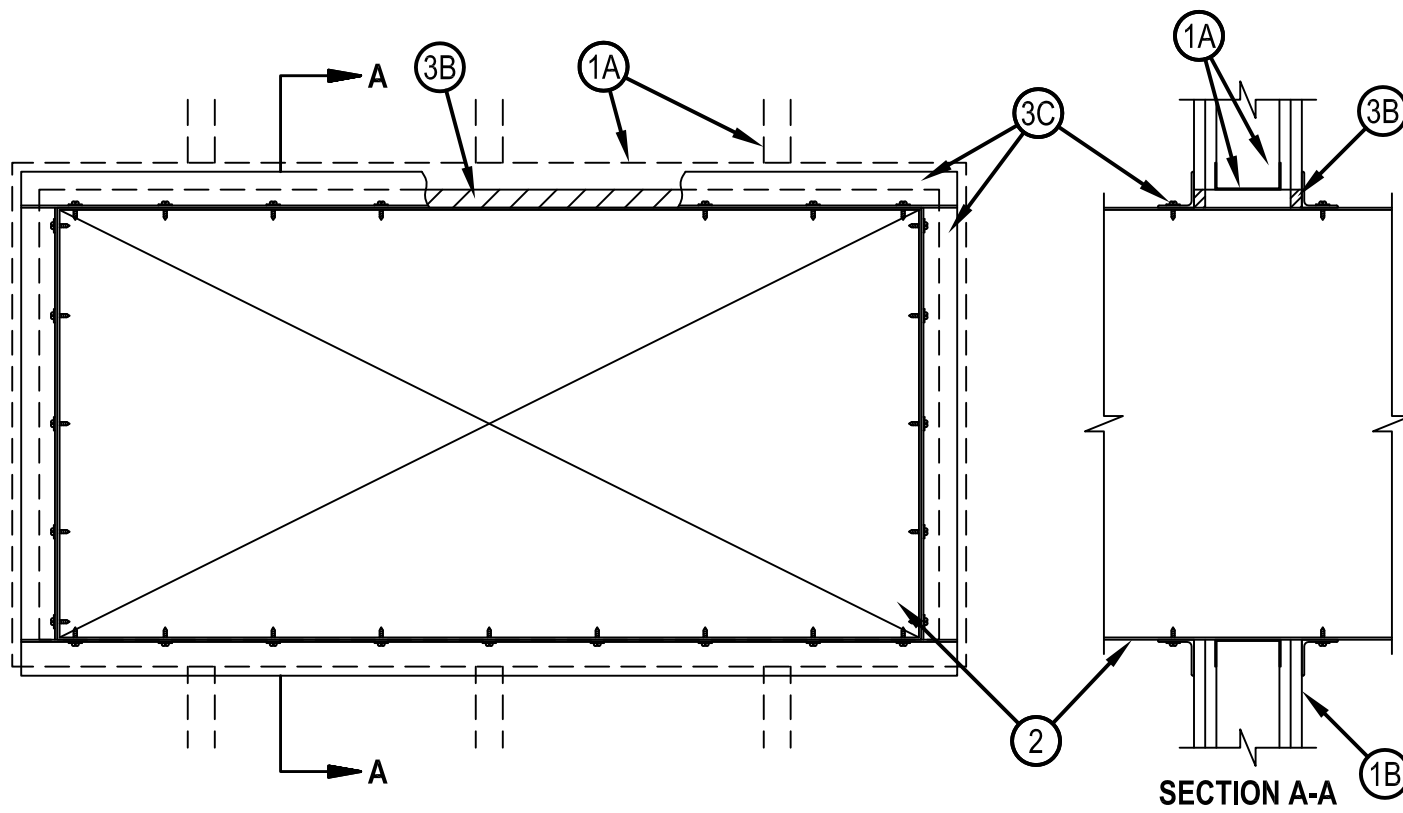

1. Wall Assembly — The 1 or 2 hr fire-rated gypsum wallboard/stud wall assembly shall be constructed of the materials and in the manner described in the individual U400, V400 or W400 Series Wall or Partition Design in the UL Fire Resistance Directory and shall include the following construction features:

A. Studs — Wall framing shall consist of min 3-1/2 in. (89 mm) wide steel channel studs spaced max 24 in. (610 mm) OC. Additional steel studs shall be used to completely frame the opening.

B. Gypsum Board\* — 5/8 in. (16 mm) thick, 4 ft (1.22 m) wide with square or tapered edges. The gypsum board type, thickness, number of layers, fastener type and sheet orientation shall be as specified in the individual Wall and Partition Design in the UL Fire Resistance Directory. Max area of opening is 73.7 sq ft (6.85 m<sup>2</sup>) with a max dimension of 104 in. (2.64 m).

The hourly F and FH Ratings of the firestop system are equal to the hourly fire rating of the wall assembly in which it is installed.

2. Steel Duct — Max 100 in. by 100 in. (2.5 by 2.5 m) galv steel duct to be installed either concentrically or eccentrically within the firestop system. The duct shall be constructed and reinforced in accordance with SMACNA construction standards. The space between the steel duct and periphery of opening shall be min 0 in. (point contact) to max 2 in. (51 mm). Steel duct to be rigidly supported on both sides of the wall assembly.



**Hilti Firestop Systems**

Reproduced by HILTI, Inc. Courtesy of  
Underwriters Laboratories, Inc.  
January 27, 2015

2A1. Through-Penetrating Product\* — As an alternate to Item 2. Fiber cement with galvanized steel facing, 3/8 in. (10 mm) thick composite metallic duct, with a max cross-sectional area of 43.0 sq ft, (4 m<sup>2</sup>) and a max individual dimension of 78 3/4 in. (2 m). Duct to be installed either concentrically or eccentrically within the firestop system such that the annular space is min 0 in. (point contact) to max 2 in. (51 mm). Duct to be rigidly supported on both sides of wall assembly. Refer to Ventilation Duct Assemblies in Vol. 2 of the Fire Resistance Directory.

DURASYSTEMS BARRIERS INC — Type DuraDuct HP.

2A2. Through-Penetrating Product\* — As an alternate to Item 2. Fiber cement with galvanized steel facing, 1/4 in. (6 mm) thick, with a max cross-sectional area of 1764 sq in. (1.14 m<sup>2</sup>), and a max individual dimension of 42 in. (1067 mm). Duct to be installed either concentrically or eccentrically within the firestop system such that the annular space is min 0 in. (point contact) to max 2 in. (51 mm). Duct to be rigidly supported on both sides of wall assembly and installed in accordance. Refer to Ventilation Duct Assemblies in Vol. 2 of the Fire Resistance Directory.

DURASYSTEMS BARRIERS INC — Type DuraDuct SD.

2A3. Through-Penetrating Product\* — As an alternate to Item 2. Galvanized steel faced duct panel, with a max cross-sectional area of 2450 sq in. (1.58 m<sup>2</sup>), and a max individual dimension of 49-1/2 in. (1258 mm) Duct to be installed either concentrically or eccentrically within the firestop system such that the annular space is min 0 in. (point contact) to max 2 in. (51 mm). Duct to be rigidly supported on both sides wall assembly. Refer to Ventilation Duct Assemblies in Vol. 2 of the Fire Resistance Directory.

DURASYSTEMS BARRIERS INC — Type DuraDuct GNX.

3 Firestop System — The firestop system shall consist of the following:

A. Packing Material — (Optional, Not Shown) — Polyethylene backer rod, mineral wool batt insulation or fiberglass batt insulation friction fitted into annular space. Packing material to be recessed from both surfaces of wall to accommodate the required thickness of fill material.

A1. Packing Material — Required as specified in Table below. Min 3-3/4 in. (95 mm) or 5 in. (127 mm) thickness of min 4 pcf (64 kg/m<sup>3</sup>) mineral wool batt insulation firmly packed into opening as a permanent form for 1 and 2 hr rated assemblies, respectively. Packing material to be recessed from both surfaces of wall to accommodate the required thickness of fill material.

B. Fill, Void or Cavity Material\* — Sealant — Min 5/8 in. (16 mm) thickness of fill material applied within the annulus, flush with both surfaces of wall. Min 1/4 in. (6 mm) diam bead of fill material shall be applied at the point contact location between the steel duct and the gypsum board.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CFS-S SIL GG Sealant, FS-ONE Sealant, FS-ONE MAX Intumescent Sealant or CP606 Flexible Firestop Sealant

C. Steel Retaining Angles — Min No. 16 gauge galv steel angles sized to lap steel duct a min of 2 in. (51 mm) and to lap wall surfaces a min of 1 in. (25 mm). When max duct dimension does not exceed 48 in. (122 cm) and duct area does not exceed 1300 in<sup>2</sup> (8387 cm<sup>2</sup>), angles may be min No. 18 gauge galv steel. Angles attached to steel duct on both sides of wall with min No. 10 by 1/2 in. (13 mm) long steel sheet metal screws located a max of 1 in. (25 mm) from each end of steel duct and spaced a max of 6 in. (152 mm) OC. Steel angles are optional for those sides of duct that do not exceed the dimension specified in Table below, dependent on packing material, sealant and annular space as specified.

Max Duct Dimension	Duct Thickness	Annular Space	Packing Material	Angle (Item 3C) Required
24 in. (610 mm)	24 ga or heavier	1/2 in. min to 1 in. max (13 to 25 mm)	Item 3A1	No

\* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.



## Firestop Gun Grade Silicone Sealant CFS-S SIL GG

### Product description

- A silicone based firestop sealant that provides maximum movement in fire-rated joints, and seals through-penetration applications

### Product features

- Halogen and solvent free
- Asbestos free
- Simple to use and apply
- Good adhesion without use of a primer
- Smoke, fume, water and UV resistant
- Excellent movement capability, meets 500 cycle requirements (ASTM E 1966 and UL 2079)
- Meets Class I W-rating requirements
- Meets LEED™ requirements for indoor environmental quality credit 4.1 Low Emitting Materials, Sealants and Adhesives and 4.2 Paints and Coatings

### Areas of application

- Sealing construction/expansion joints
- Top-of-wall joints
- Metal pipes
- Cable bundles
- HVAC penetrations

### For use with


- Various base materials such as masonry, concrete, metal, etc.
- Wall and floor assemblies rated up to 4 hours

### Examples

- Where a gypsum wall assembly meets the underside of a metal or concrete deck
- Sealing expansion joints to impede the passage of fire, smoke and toxic fumes
- Sealing around penetrations through fire-rated assemblies


### Installation instructions

- Refer to what is included in the package, the MSDS, and the applicable listing.

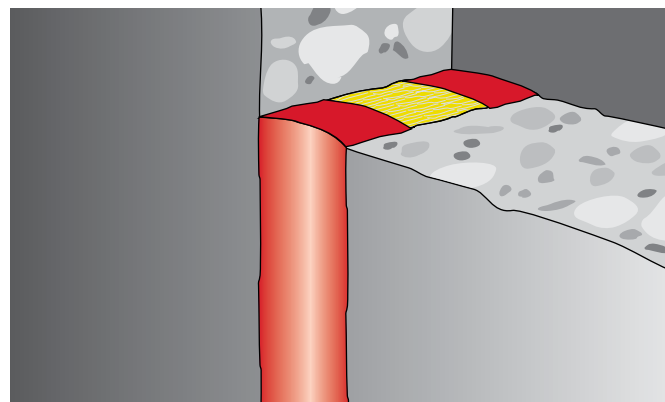

Technical Data*	CFS-S SIL GG
Chemical basis	Neutral elastic silicone
Density	Approx. 1.4 g/cm <sup>3</sup>
Color	Available in red, white, and gray
Application temperature	40°F to 104°F (5°C to 40°C)
Skin-forming time	Approx. 15 min.
Curing time	Approx. 2 mm / 3 days
Volume shrinkage	Approx. 0 – 5%
Movement capability (UL 2079)	Approx. 33%
Temperature resistance	–40°F to 300°F (–40°C to 149°C)
Surface burning characteristics (ASTM E84-12)	Flame spread: 0 Smoke development: 25
Sound transmission classification (ASTM E 90-09)	59 (Relates to specific construction)
Tested in accordance with	UL 2079 ASTM E 814 ASTM E 1966 ASTM C 920 UL 1479 ASTM E 84 ASTM G21

\*At 73°F (23°C) and 50% relative humidity





# CERTIFICATE OF COMPLIANCE

**Certificate Number** 20131115-R13240  
**Report Reference** R13240  
**Issue Date** 2013-November-15

**Issued to:** Hilti Construction Chemicals, Div of Hilti Inc.  
5400 S 122<sup>nd</sup> East Ave  
Tulsa, OK 74146

**This is to certify that  
representative samples of**


Fill, Void or Cavity Materials  
Fill, Void or Cavity Materials Certified for Canada  
CFS-S SIL GG and CFS-S SIL SL for use in Through-  
Penetration Firestop and Joint Systems in the UL Fire  
Resistance Directory and in the Products Certified for  
Canada Directory.

Have been investigated by UL in accordance with the  
Standard(s) indicated on this Certificate.


**Standard(s) for Safety:** ANSI/UL 1479, "Fire Tests of Through-Penetration  
Firestops," – Edition 3 – Revision Date 2012/10/19  
ANSI/UL 2079, "Tests for Fire Resistance of Building Joint  
Systems," – Edition 4 – Revision Date 2012/12/12  
CAN/ULC-S115, "Standard Method of Fire Tests of Firestop  
Systems." – Edition 4 – Issue Date 2011/06/01

**Additional Information:** See the UL Online Certifications Directory at  
[www.ul.com/database](http://www.ul.com/database) for additional information

Only those products bearing the UL Classification Mark should be considered as being covered by  
UL's Classification and Follow-Up Service.

The UL Classification Mark includes: UL in a circle: with the word "CLASSIFIED"  (as shown); a control  
number (may be alphanumeric) assigned by UL; a statement to indicate the extent of UL's evaluation of  
the product; and the product category name (product identity) as indicated in the appropriate UL  
Directory.

Look for the UL Classification Mark on the product.



William R. Carney, Director, North American Certification Programs

UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please  
contact a local UL Customer Service Representative at [www.ul.com/contactus](http://www.ul.com/contactus)





August 26, 2015

To Whom It May Concern:

Re: **Hilti CFS-S SIL GG Firestop Sealant - LEED Information**

Item Numbers:

2076729
2076881
2076882
2076883
2077322

The Hilti CFS-S SIL GG Firestop Sealant is manufactured in Toronto, Ontario.

There is no post-consumer or post-industrial content in CFS-S SIL GG and it cannot be recycled. The CFS-S SIL GG does not contain any Rapidly Renewable Materials. The VOC content for CFS-S SIL GG is 48.0 grams/liter.

CFS-S SIL GG is not regulated as a hazardous waste by the Federal EPA Standards. The regulations for the disposal of non-regulated industrial waste can vary from state to state and even city to city. For this reason, you should consult your local and state regulatory agencies for direction on disposal.

Please feel free to contact me at (918) 872-3704 if you have questions.

Sincerely,

Jerry Metcalf MPH, CHMM  
Sr. Manager, Safety/Environmental  
Hilti Inc.  
918 872 3704  
[jerry.metcalf@hilti.com](mailto:jerry.metcalf@hilti.com)

Rev. Date: 8/14/15

The manufacturing plant location on this certificate has been provided for LEEDS reporting purposes only. It should never be used for Country of Origin certification or a representation of compliance/non-compliance with Buy American or Buy America requirements, as those requirements differ.

The manufacturing plant location(s) identified on the certificate represent standard Hilti catalog products only. "Specially" produced non-catalog Hilti products may have differing manufacturing plant locations.

Contact your Hilti representative in cases of "specially" produced products for a custom LEEDS certificates.

Hilti, Inc.  
5400 South 122<sup>nd</sup> East Avenue  
Tulsa, OK 74146

1-800-879-8000  
[www.hilti.com](http://www.hilti.com)

## Flexible Firestop Sealant (CP 606)

### Product description

- An acrylic based firestop sealant that provides movement capability in fire rated joints and seals through-penetrations applications

### Product features

- Silicone free
- Halogen, asbestos and solvent free
- Paintable
- Tested up to 33% movement with 500 cycles in accordance to UL 2079 and ASTM 1966
- Smoke and fume resistant
- Easy clean up with water
- Single component systems available
- Meets LEED™ requirements for indoor environmental quality credit 4.1 Low Emitting Materials, Sealants and Adhesives and 4.2 Paints and Coatings

### Areas of application


- Sealing construction/expansion joints
- Top-of-wall joints
- Metal pipes
- Cable bundles
- HVAC penetrations

### For use with

- Various base materials such as masonry, concrete, gypsum, etc.
- Wall and floor assemblies rated up to 3 hours


### Examples

- Where a gypsum wall assembly meets the underside of a metal or concrete deck
- Sealing expansion joints to impede the passage of fire, smoke and toxic fumes
- Sealing around HVAC penetrations through fire-rated assemblies

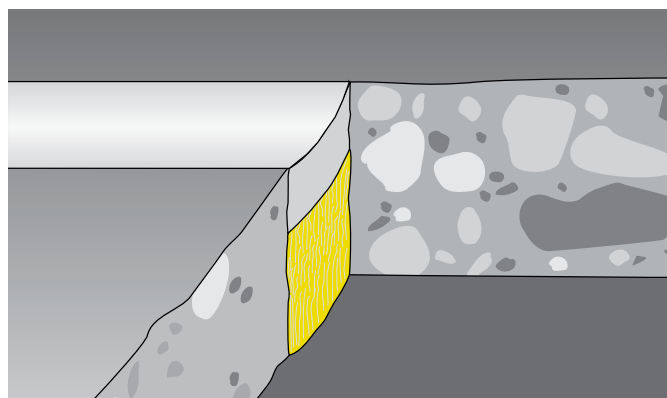

Technical Data*	CP 606
<b>Chemical basis</b>	Acrylic based firestop sealant
<b>Color</b>	Available in red, white and gray
<b>Application temperature</b>	40°F to 104°F (5°C to 40°C)
<b>Skin-forming time</b>	Approx. 15 min
<b>Curing time</b>	Approx. 3 mm / 3 days
<b>Average volume shrinkage (ASTM C1241)</b>	22.2%
<b>Movement capability</b>	Approx. 10%
<b>Temperature resistance</b>	-22°F to 176°F (-30°C to 80°C)
<b>Surface burning characteristics (ASTM E 84-96)</b>	Flame Spread: 10 Smoke Development: 0
<b>Sound transmission classification (ASTM E 90-99)</b>	56 (Relates to specific construction)
<b>Tested in accordance with</b>	
• UL 2079	• ASTM E 814
• ASTM E 84	• UL 1479
	• ASTM E 1966
	• ASTM G21

\*At 73°F (23°C) and 50% relative humidity



## Installation instructions for CP 606

### Notice

- Before handling, read Material Safety Data Sheet and product label for safe usage and health information.
- Instructions below are general guidelines — always refer to the applicable drawing in the UL Fire Resistance Directory or Hilti Firestop Systems Guide for complete installation information
- The use of backing material is recommended to control the sealant depth and help ensure assembly seal is complete

### Opening

1. Clean the opening. Surfaces to which CP 606 will be applied should be cleaned of loose debris, dirt, oil, wax and grease. The surface should be moisture and frost free.

### Application of firestop

2. Insert fill of mineral wool or backer (as required).
3. Apply firestop over backer.
4. Smooth firestop sealant with a trowel before the skin forms. Once cured, CP 606 can only be removed mechanically.
5. For maintenance reasons, a penetration seal can be


permanently marked with an identification plate and fastened in a visible position next to the seal.

### Not for use


- On areas immersed in water

### Storage


- Store only in the original packaging in a location protected from moisture at a temperature of 40°F to 77°F (5°C to 25°C)
- Observe expiration date on package




1. Clean opening




2. Insert backing material compressed per UL System




3. Apply CP 606




4. Smooth CP 606




5. Fasten identification plate (if required)




1. Clean opening



2. Insert backing material



3. Apply CP 606



4. Smooth CP 606



5. Fasten identification plate (if required)

**Hilti. Outperform. Outlast.**

# CERTIFICATE OF COMPLIANCE

**Certificate Number** 20160930-R13240  
**Report Reference** R13240  
**Issue Date** 2016-September-30

**Issued to:** Hilti Construction Chemicals, Div of Hilti Inc.  
5400 S 122<sup>nd</sup> East Ave  
Tulsa, OK 74146

**This is to certify that  
representative samples of** Fill, Void or Cavity Materials  
Fill, Void or Cavity Materials Certified for Canada

CP 606 Sealant for use in Through-Penetration Firestop,  
Joint in wall and partition Systems as currently described in  
the UL Fire Resistance Directory and in the Products  
Certified for Canada Directory.

Have been investigated by UL in accordance with the  
Standard(s) indicated on this Certificate.

**Standard(s) for Safety:** ANSI/UL 1479, "Fire Tests of Through-Penetration  
Firestops,"  
ANSI/UL 2079, "Tests for Fire Resistance of Building Joint  
Systems,"  
CAN/ULC-S115, "Standard Method of Fire Tests of Firestop  
Systems."

**Additional Information:** See the UL Online Certifications Directory at  
[www.ul.com/database](http://www.ul.com/database) for additional information

Only those products bearing the UL Certification Mark should be considered as being covered by UL's  
Certification and Follow-Up Service.

Look for the UL Certification Mark on the product.



Bruce Mahrenholz, Director North American Certification Program

UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please  
contact a local UL Customer Service Representative at <http://ul.com/aboutul/locations/>





February 26, 2010

To Whom It May Concern:

Re: Hilti CP 606 Flexible Firestop – LEEDs Info.

The Hilti CP 606 Flexible Firestop Sealant is manufactured in Germany.

The CP 606 pail is made of polyethylene and can be completely recycled. There is no post-consumer or post-industrial content in CP 606 and it cannot be recycled. The CP 606 does not contain any Rapidly Renewable Materials. The VOC content for CP 606 is 71.0 grams/liter.

CP 606 is not regulated as a hazardous waste by the Federal EPA Standards. The regulations for the disposal of non-regulated industrial waste can vary from state to state and even city to city. For this reason, you should consult your local and state regulatory agencies for direction on disposal.

Please feel free to contact me at (918) 872-3704 if you have questions.

Sincerely,

A handwritten signature in black ink, reading "Jerry Metcalf". The signature is written in a cursive, flowing style.

Jerry Metcalf MPH, CHMM  
Safety/Environmental Manager  
Hilti Inc.  
918 872 3704  
[jerry.metcalf@hilti.com](mailto:jerry.metcalf@hilti.com)

Rev. Date: 2/26/10

Hilti, Inc.  
5400 South 122<sup>nd</sup> East Avenue  
Tulsa, OK 74146

1-800-879-8000  
[www.hilti.com](http://www.hilti.com)



## High-performance intumescent firestop sealant FS-ONE MAX

### Applications

- For effectively sealing most common through penetrations in a variety of base materials
- For use on concrete, masonry and drywall
- Mixed and multiple penetrations
- Metal pipe penetrations: copper, steel and EMT
- Insulated metal pipe penetrations: steel and copper
- Plastic pipe penetrations: closed or vented

### Advantages


- US-produced: "Buy American" compliant
- One product for a variety of common through penetrations
- Cost-effective, easy-to-use solution
- Water-based and paintable
- Industry-leading VOC results
- Ethylene glycol-free



Chemical resistant



Mold and mildew resistant



Intertek



### Technical data

Chemical basis	Water-based acrylic dispersion
Approx. Density	84.3 lb/ft³
Color	Red
Application temperature range	41 - 104 °F
Approx. cure time <sup>1)</sup>	4 mm/3 days
Temperature resistance range	-4 to 212 °F
Mold and mildew performance	Class 0 (ASTM G21-96)
Mold and mildew resistance	Yes
Surface burning characteristics UL 723 (ASTM E84)	Flame spread: 0 Smoke development: 10
Tested in accordance with	UL 1479, ASTM E814, ASTM E84, CAN/ ULC-S115, ASTM G21, ASTM E90
California State fire marshal approval	CSFM Listing 4485-1200:0108 for FS-ONE MAX Intumescent Firestop Sealant
Expansion ratio (unrestricted, up to)	1:5

<sup>1)</sup> at 75°F/24°C, 50% relative humidity



Order Designation	Package Content	Item number
FS-ONE MAX 20oz foil (3 case + disp)	1x Foil pack dispenser manual CS 270-P1, 75x Firestop sealant FS-ONE MAX 20 oz foil	3530252
FS-ONE MAX 10oz tube (1 case)	12x Firestop sealant FS-ONE MAX 10 oz cartridge	3530249
FS-ONE MAX 5 gallon (18 pails)	18x Firestop sealant FS-ONE MAX 5 gallon pail	3530263
FS-ONE MAX 20oz foil (1 case)	25x Firestop sealant FS-ONE MAX 20 oz foil	3530250
FS-ONE MAX 20oz foil (3 cases)	75x Firestop sealant FS-ONE MAX 20 oz foil	3530251
FS-ONE MAX 20oz Foil-Pallet	600x FSONE-MAX 20 oz foil, 290x Bulk Shipping Condition	3534713
FS-ONE MAX 10 oz cartridge		2101531
FS-ONE MAX 5 gallon pail		2101533

**Hilti. Outperform. Outlast.**

Hilti, Inc. (USA) 1-800-879-8000 | www.us.hilti.com | en español 1-800-879-5000 | Hilti (Canada) Corp. 1-800-363-4458 | www.hilti.ca





Date: June 22, 2015

Subject: **Buy American Certification**

Product: Firestop sealant FS-ONE MAX 10.1OZ Cartridge (Item #2101531)  
Firestop sealant FS-ONE MAX 20.0OZ Foil (Item #2101532)  
Firestop sealant FS-ONE MAX 5GAL Pail (Item #2101533)

To Whom it May Concern:

Hilti, Inc. certifies that the above referenced product(s) as described on the Purchase Order identified above, is (are) a domestic end product (as defined in FAR Subpart 25.1, "Buy American Act--Supplies"), or satisfies the preference for domestic construction material (as defined in FAR Subpart 25.2, "Buy American Act--Construction Materials").

Sincerely,

A handwritten signature in black ink, appearing to read "Thomas M. Horan", written in a cursive style.

Thomas M. Horan, QA Manager

Buyamericanfsonemax.doc

**Hilti, Inc.**  
5400 South 122nd East Avenue  
Tulsa, OK 74121 USA

T (918) 872-3000 | F 800-879-7000  
[www.hilti.com](http://www.hilti.com)





August 26, 2015

To Whom It May Concern:

Re: **Hilti FS-ONE Max Firestop – LEED Info.**

Item Numbers:

2101531
2101532
2101533

The Hilti FS-ONE MAX Firestop is manufactured in the United States

There is no post-consumer or post-industrial content in FS-ONE MAX and it cannot be recycled. The VOC content for FS-ONE MAX is 9 grams/liter.

FS-ONE MAX is not regulated as a hazardous waste by the Federal EPA Standards. The regulations for the disposal of non-regulated industrial waste can vary from state to state and even city to city. For this reason, you should consult your local and state regulatory agencies for direction on disposal.

Please feel free to contact me at (918) 872-3704 if you have questions.

Sincerely,

Jerry Metcalf MPH, CHMM  
Sr. Manager, Safety/Environmental  
Hilti Inc  
(918) 872 3704  
[jerry.metcalf@hilti.com](mailto:jerry.metcalf@hilti.com)

Rev. Date: 7/31/15

The manufacturing plant location on this certificate has been provided for LEEDS reporting purposes only. It should never be used for Country of Origin certification or a representation of compliance/non-compliance with Buy American or Buy America requirements, as those requirements differ.

The manufacturing plant location(s) identified on the certificate represent standard Hilti catalog products only. "Specially" produced non-catalog Hilti products may have differing manufacturing plant locations.

Contact your Hilti representative in cases of "specially" produced products for a custom LEEDS certificates.

Hilti, Inc.  
5400 South 122<sup>nd</sup> East Avenue  
Tulsa, OK 74146

1-800-879-8000  
[www.hilti.com](http://www.hilti.com)