



1 UTILITY SPACE ELEVATION
T2.00 N.T.S.

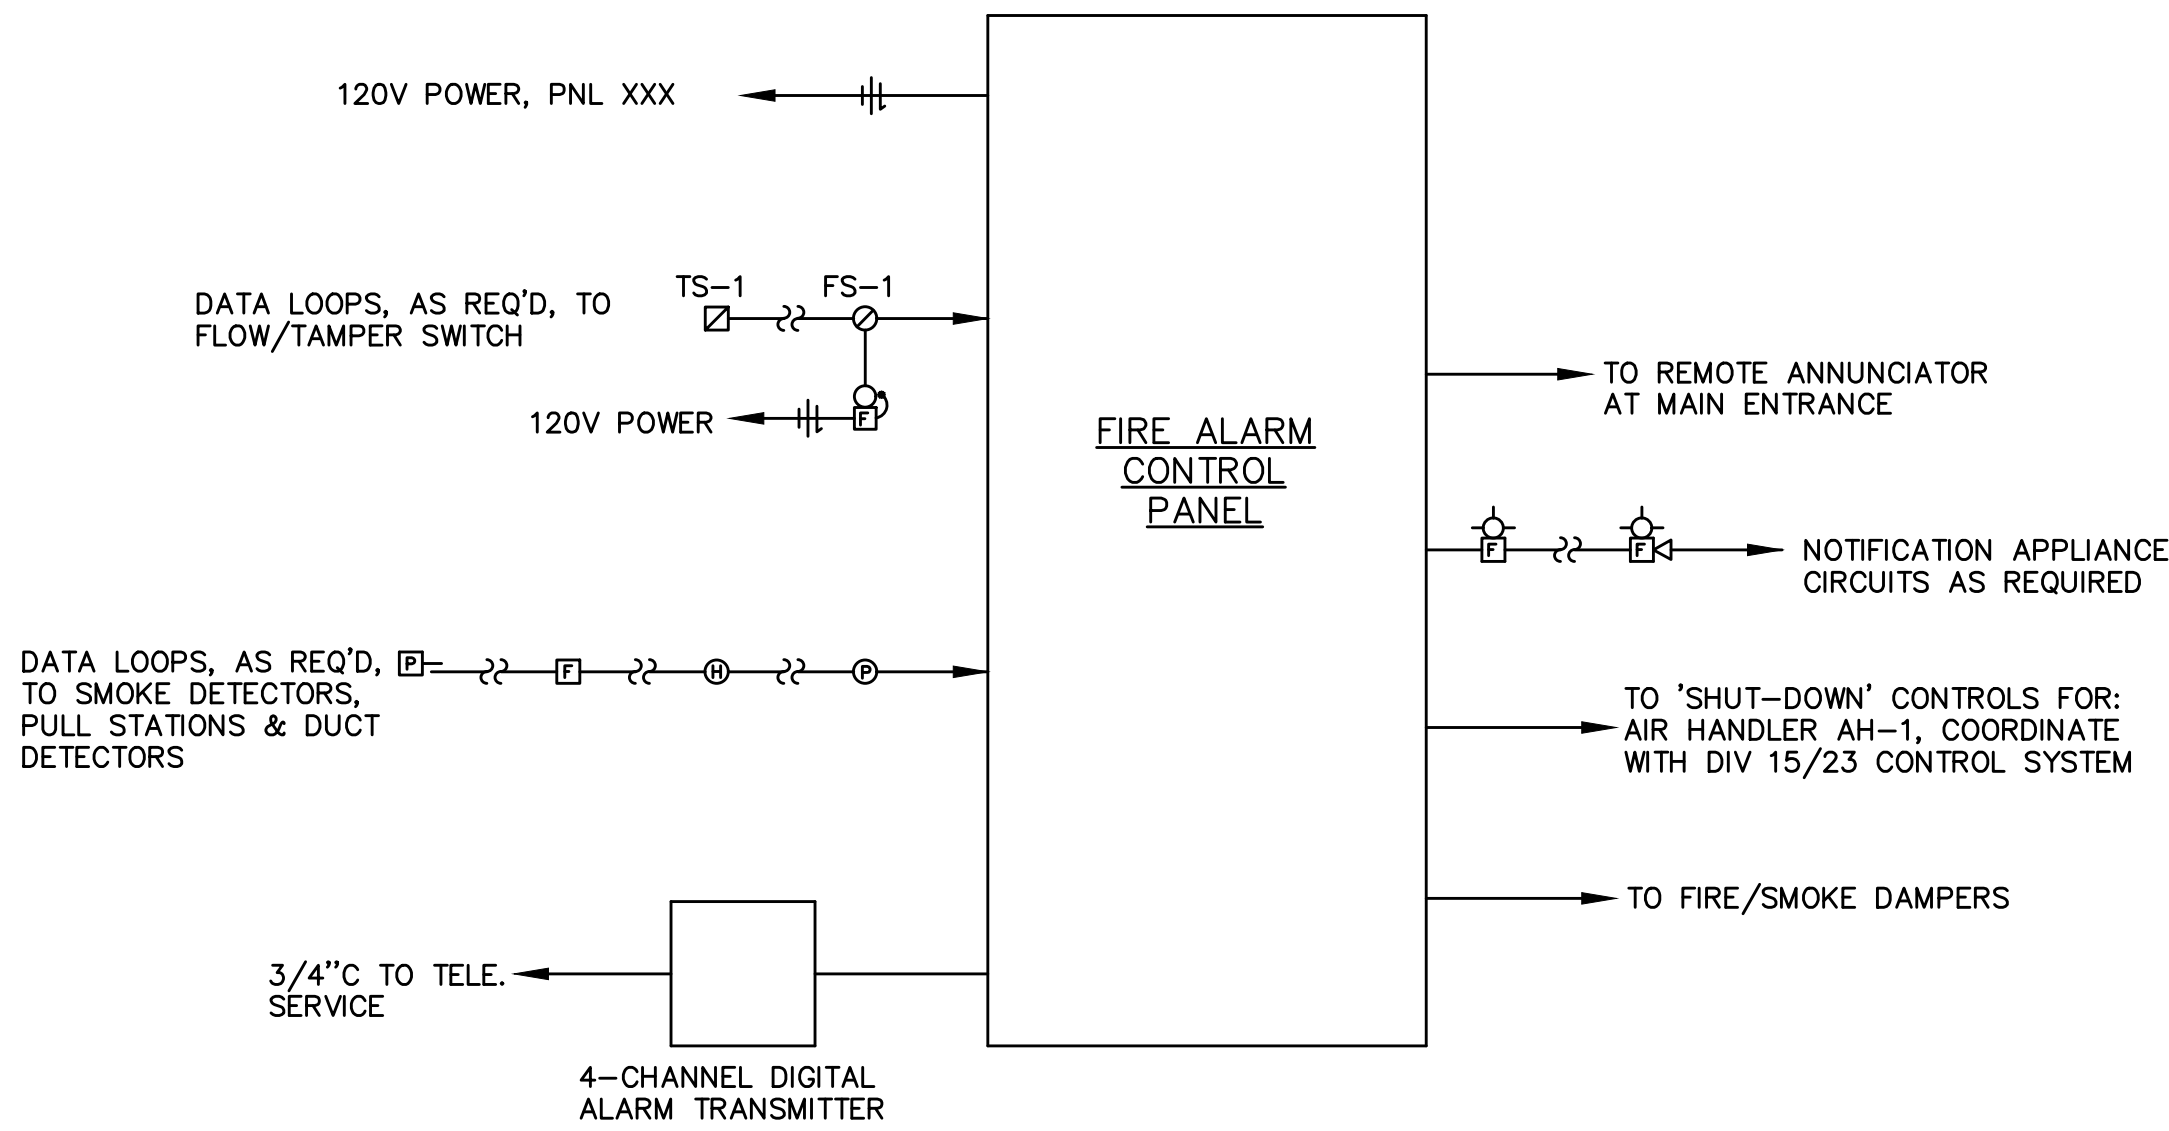

2 FIRE ALARM DETAIL
T2.00 N.T.S.

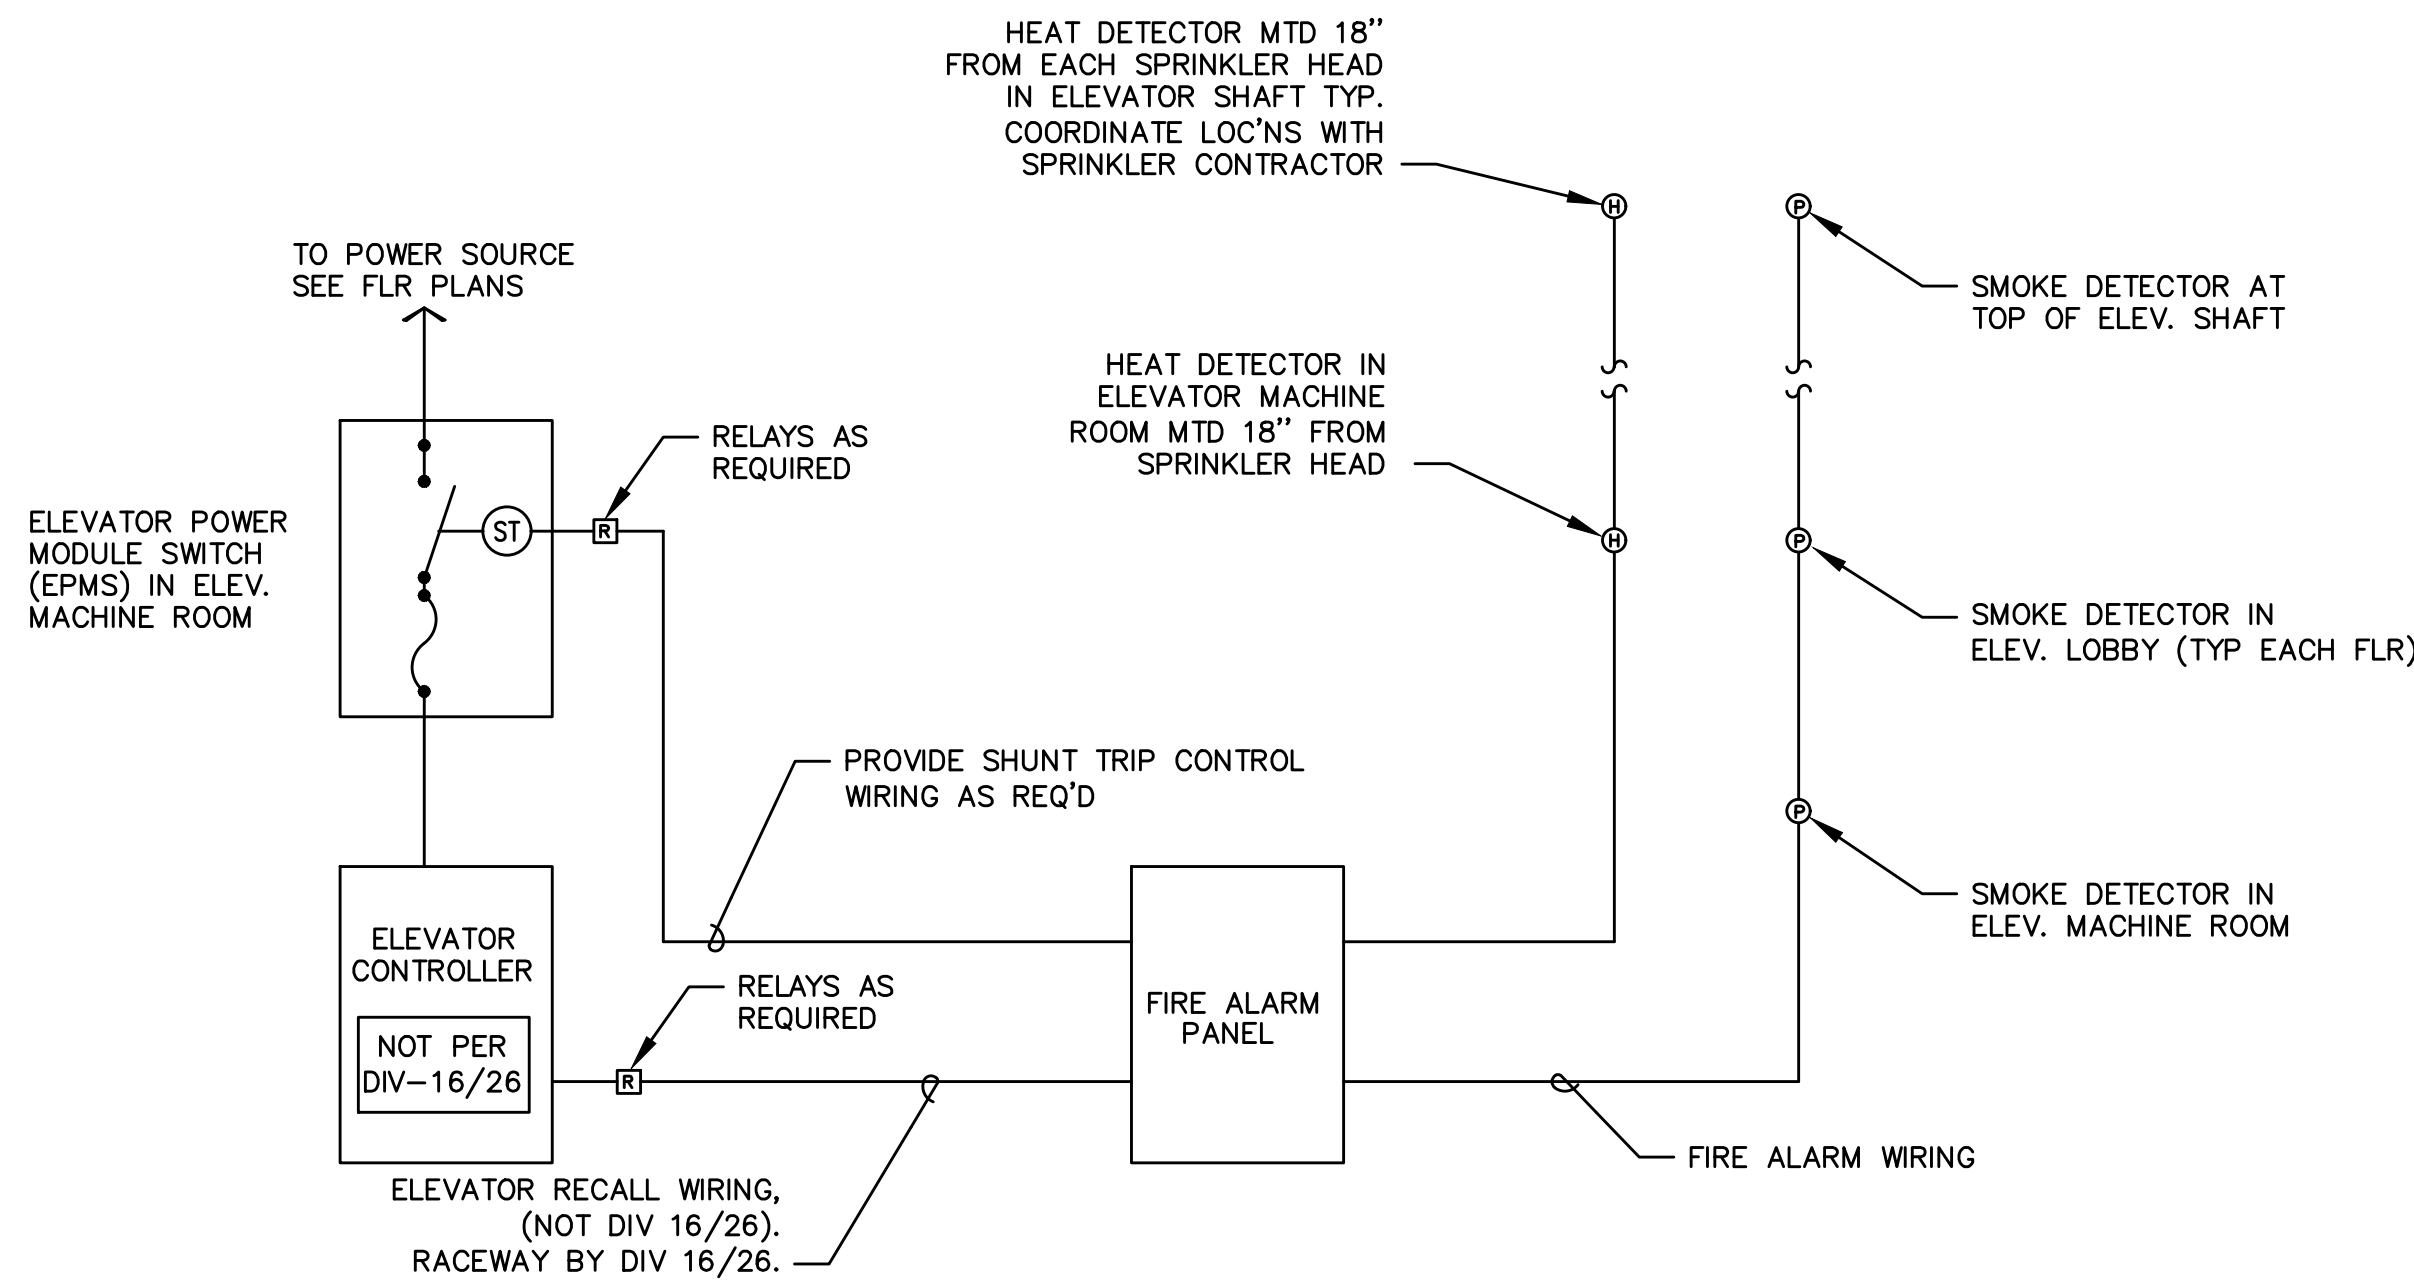

NOTES

1. CONNECT HEAT DETECTORS IN MACHINE RM AND ELEVATOR SHAFT SUCH THAT AN ALARM CONDITION WILL ACTIVATE SHUNT TRIP DEVICE IN 'EMPS'.
2. CONNECT SMOKE DETECTORS IN MACHINE ROOM, ELEVATOR LOBBYS, AND ELEVATOR SHAFT SUCH THAT AN ALARM CONDITION WILL ACTIVATE ELEVATOR RECALL SYSTEM. COORDINATE WITH ELEVATOR SUPPLIER.

3 ELEVATOR RECALL & AUTO DISCONNECT DETAIL
T2.00 N.T.S.

FIRE ALARM AND DETECTION SYSTEM SHOWN ON PLAN(S) ARE FOR DESIGN INTENT ONLY. THIS IS A DEFERRED SUBMITTAL SYSTEM REQUIRING THE CONTRACTOR TO COMPLETE THE PERMIT READY DESIGN AND CALCULATIONS AS REQUIRED PER THE AUTHORITY HAVING JURISDICTION. VERIFY BUILDING OCCUPANCY TYPE AND OCCUPANT LOAD WITH ARCHITECTURAL PLANS.

CARTEE
APARTMENTS

323 W BROAD ST.
BOISE, ID 83702

JOB NO. 18-001.00



M Consulting Engineers
2007 S.E. Ash St.
Portland, OR 97214
PHN: (503) 234-0548
FAX: (503) 234-0677
INC. WWW.MFIA-ENG.COM
CONTACT: Gary Adovnik

PERMIT SET

04.30.2019

issue:	date:
50% SD	07.20.2018
100% SD	09.28.2018
50% DD	11.02.2018
100% DD	12.21.2018
60% CD	02.12.2019
PERMIT SET	04.30.2019

revision: date:

title:
TELCOM
DETAILS

sheet:

T2.00