





MFA Consulting Engineers
2007 S.E. Ash St.
Portland, OR 97214
PH: (503) 234-0548
FAX: (503) 234-0677
INC. WWW.MFA-ENG.COM
CONTACT: Gary Adovnik

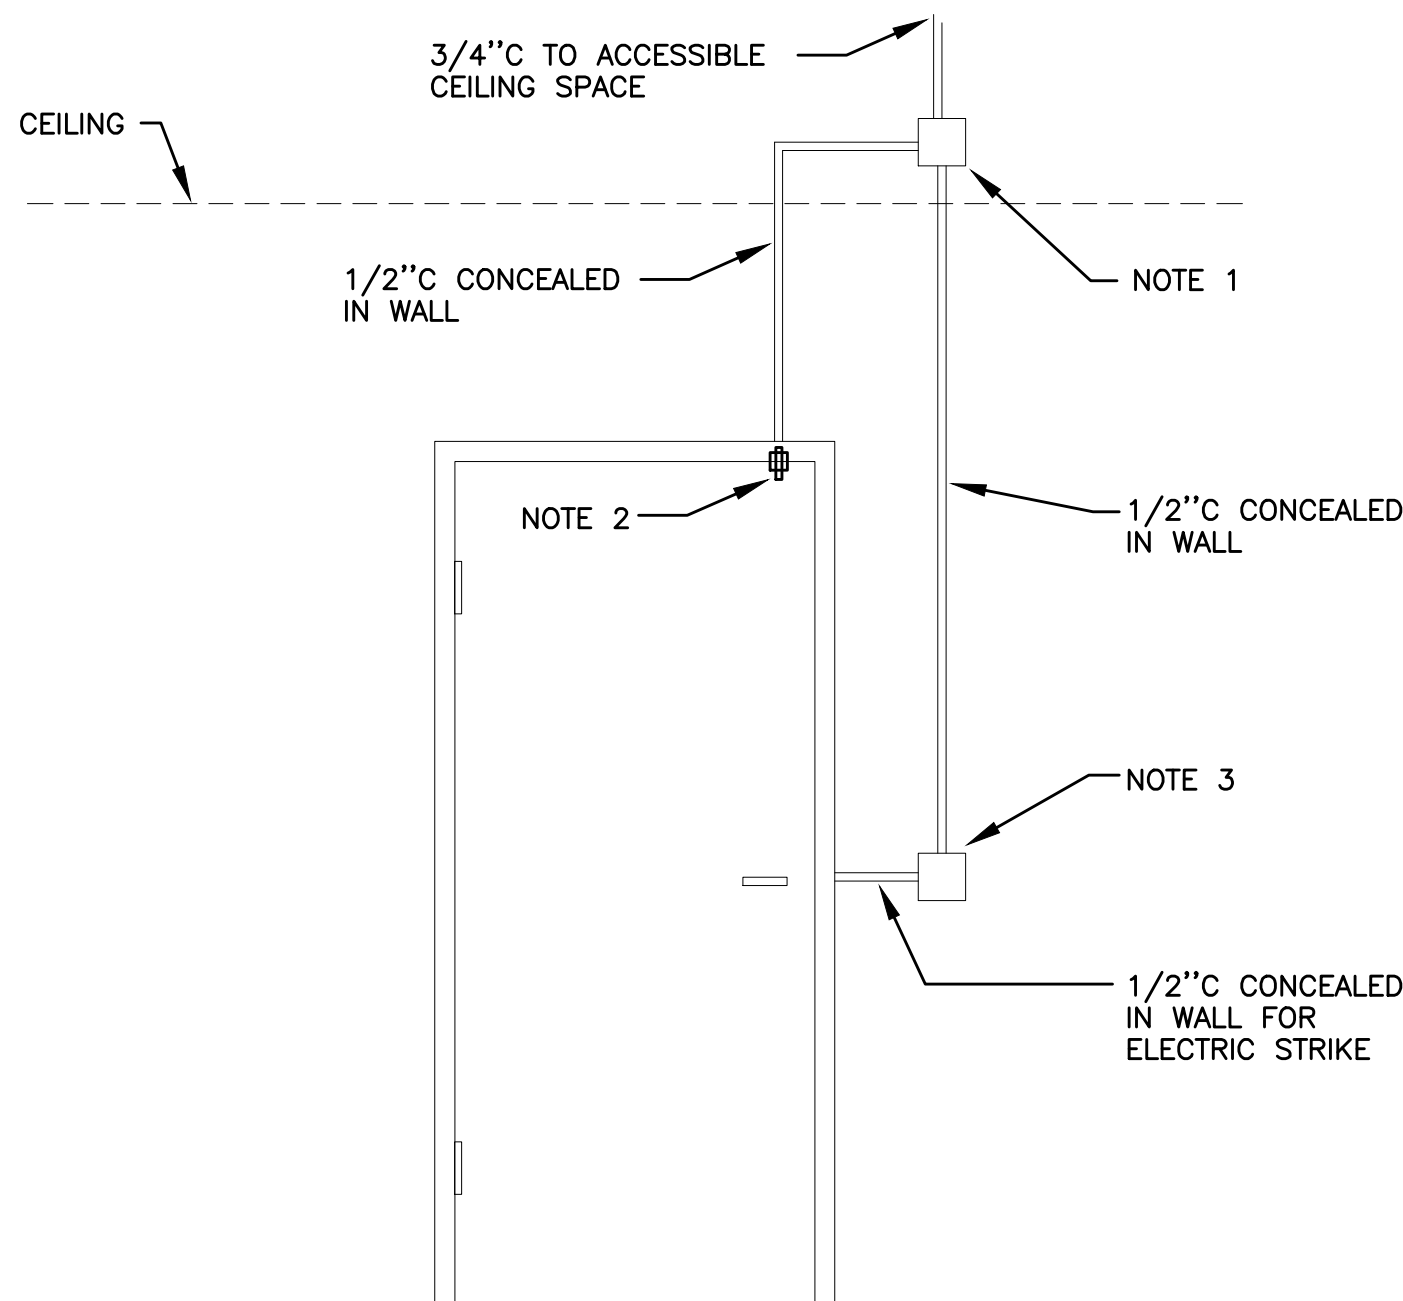


- SECURITY ROUGH-IN NOTES
1. 4 SQUARE J-BOX 4" ABOVE FINISHED CEILING, VERIFY WITH ARCHITECT.
 2. DOOR STATUS CONTACT, ONLY NEEDED WHEN STRIKE DOES NOT HAVE INTEGRAL SWITCH.
 3. DBL GANG BOX, PROVIDE SNGL GANG REDUCER RING IF NEEDED BY SECURITY DEVICE. COORDINATE WITH ARCHITECT TO MEET ADA REQUIREMENTS.

1 SINGLE DOOR ACCESS CONTROL DETAIL
T2.02 N.T.S.

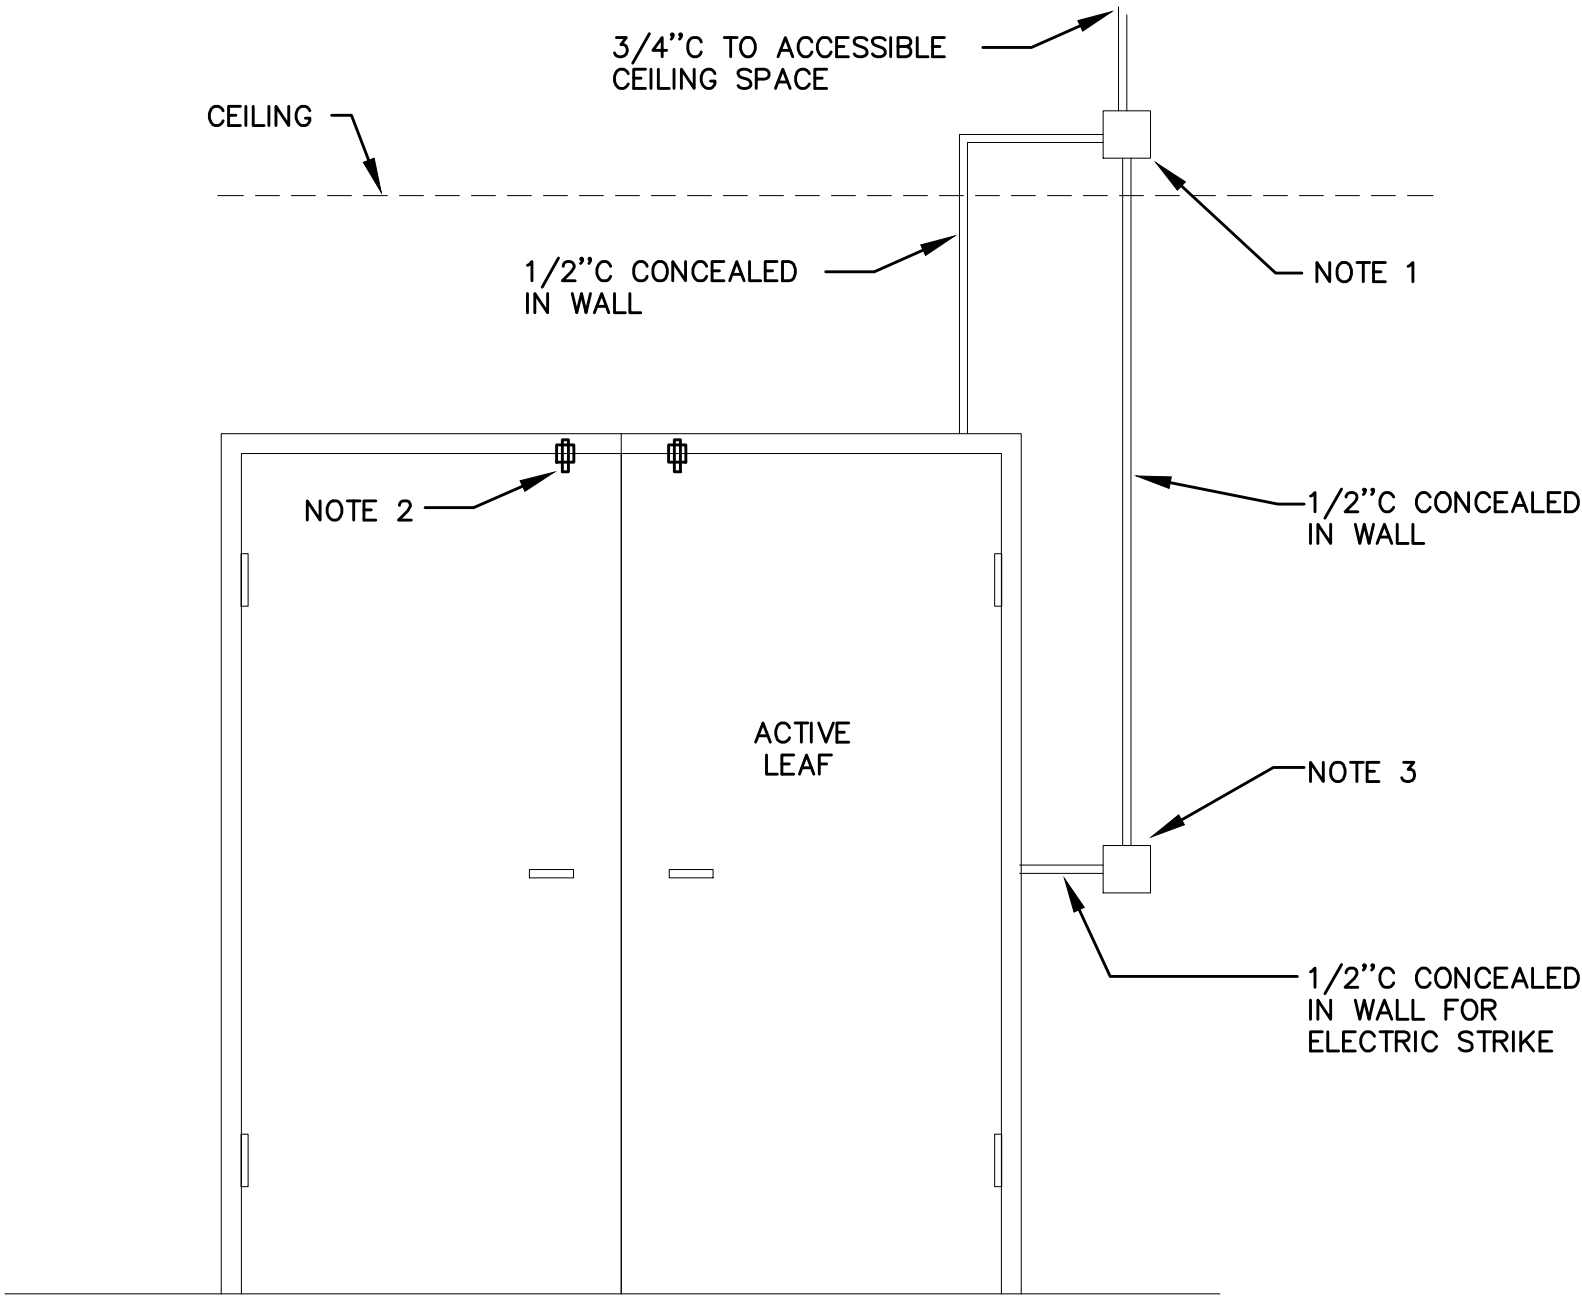

- SECURITY ROUGH-IN NOTES
1. 4 SQUARE J-BOX 4" ABOVE FINISHED CEILING, VERIFY WITH ARCHITECT.
 2. DOOR STATUS CONTACT, ONLY NEEDED WHEN STRIKE DOES NOT HAVE INTEGRAL SWITCH.
 3. DBL GANG BOX, PROVIDE SNGL GANG REDUCER RING IF NEEDED BY SECURITY DEVICE. COORDINATE WITH ARCHITECT TO MEET ADA REQUIREMENTS.

2 DOUBLE DOOR ACCESS CONTROL DETAIL
T2.02 N.T.S.

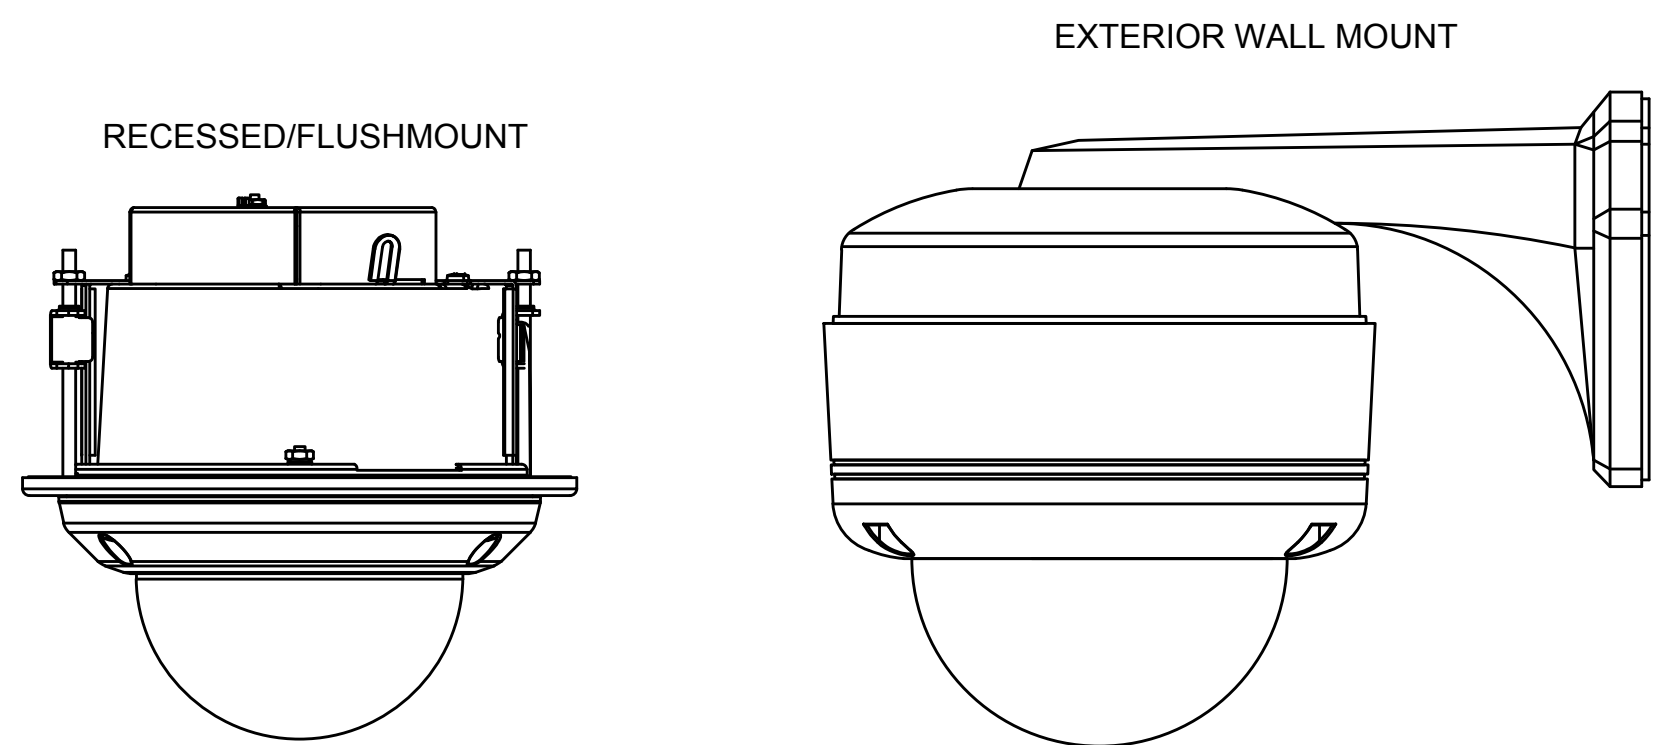

3 CCTV CAMERA MOUNT
T2.02 N.T.S.

PERMIT SET

09.17.2018	date:
issue:	
50% DD	04.30.2018
100% DD	06.18.2018
50% CD	08.03.2018
PERMIT SET	09.17.2018

revision:	date:
-----------	-------

title:
TELCOM
DETAILS

sheet:
T2.02

FIRE ALARM AND DETECTION SYSTEM SHOWN ON PLAN(S) ARE FOR DESIGN INTENT ONLY. THIS IS A DEFERRED SUBMITTAL SYSTEM REQUIRING THE CONTRACTOR TO COMPLETE THE PERMIT READY DESIGN AND CALCULATIONS AS REQUIRED PER THE AUTHORITY HAVING JURISDICTION. VERIFY BUILDING OCCUPANCY TYPE AND OCCUPANT LOAD WITH ARCHITECTURAL PLANS.