

HALSEY 106

JOB NO. 17-067.00



M Consulting Engineers
2007 S.E. Ash St.
Portland, OR 97214
PHN: (503) 234-0548
FAX: (503) 234-0677
INC. WWW.MFIA-ENG.COM
CONTACT: Gary Adovnik

PERMIT SET

09.17.2018

Issue:

date:

50% DD

100% DD

50% CD

PERMIT SET

04.30.2018

06.18.2018

08.03.2018

09.17.2018

revision:

date:


Title:

FLOOR PLAN
LEVEL 1

sheet:

T3.01

© 2017 HOLST ARCHITECTURE INC.

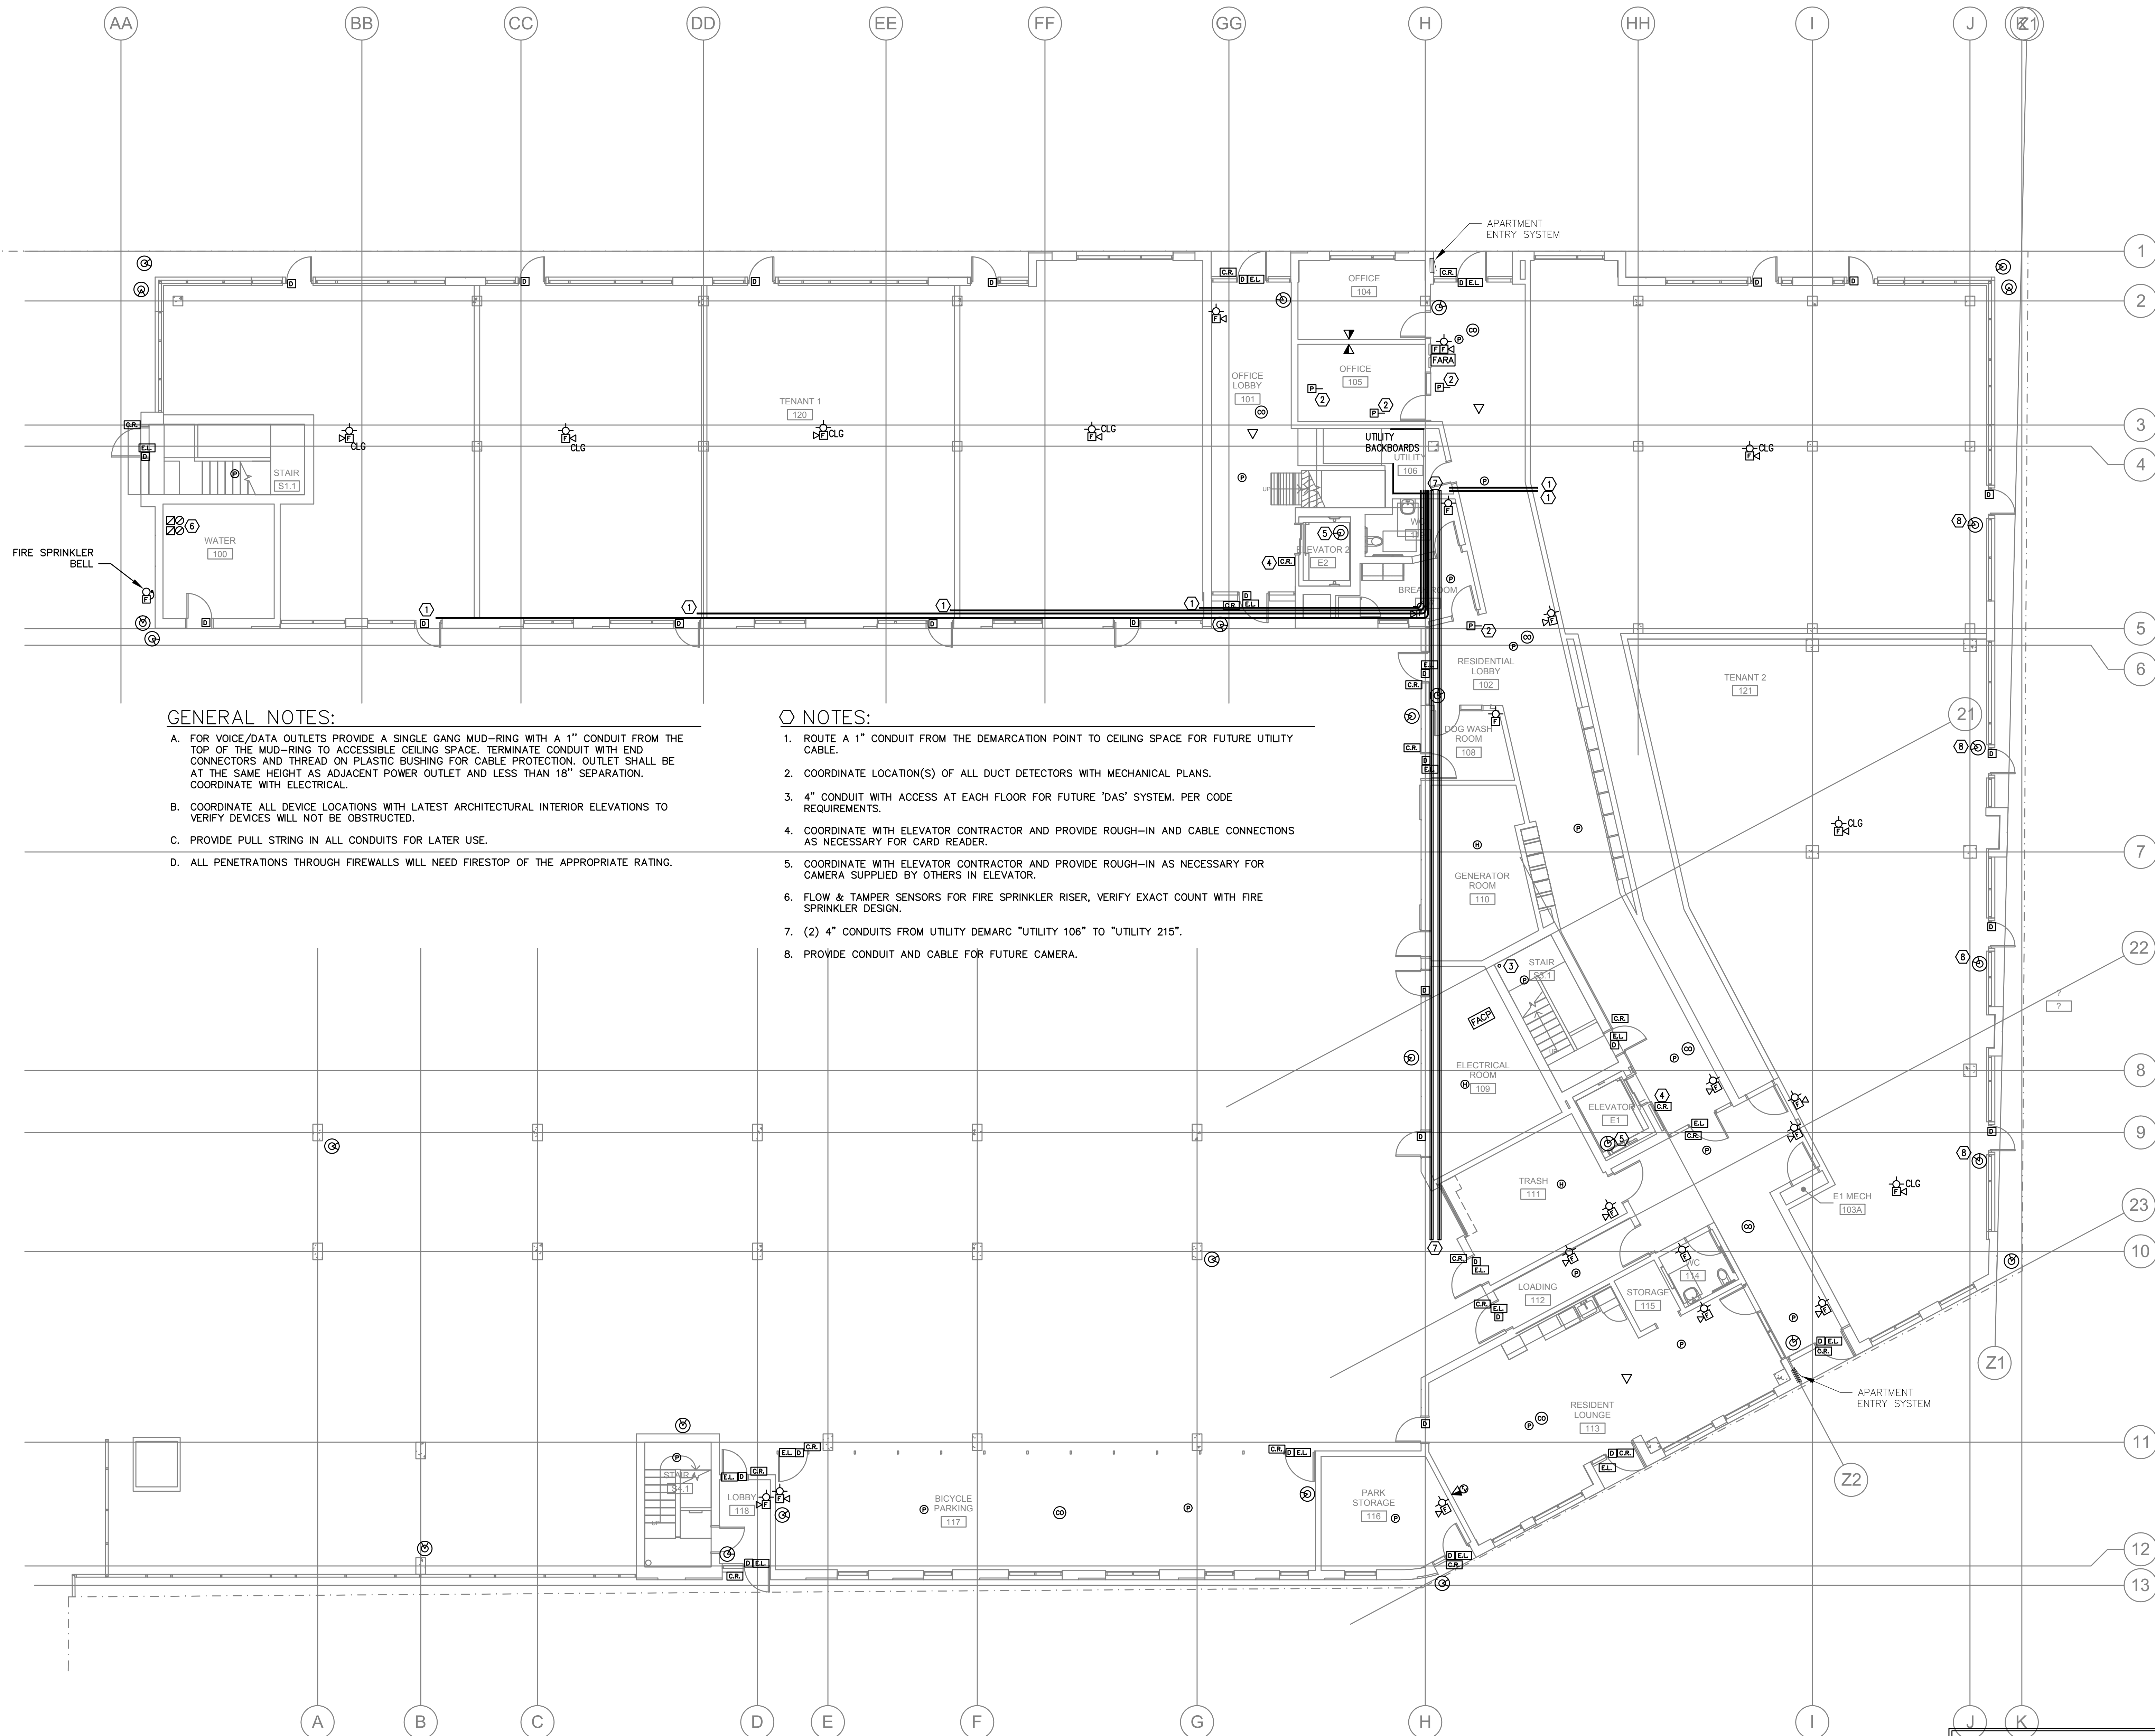

GENERAL NOTES:

- FOR VOICE/DATA OUTLETS PROVIDE A SINGLE GANG MUD-RING WITH A 1" CONDUIT FROM THE TOP OF THE MUD-RING TO ACCESSIBLE CEILING SPACE. TERMINATE CONDUIT WITH END CONNECTORS AND THREAD ON PLASTIC BUSHING FOR CABLE PROTECTION. OUTLET SHALL BE AT THE SAME HEIGHT AS ADJACENT POWER OUTLET AND LESS THAN 18" SEPARATION. COORDINATE WITH ELECTRICAL.
- COORDINATE ALL DEVICE LOCATIONS WITH LATEST ARCHITECTURAL INTERIOR ELEVATIONS TO VERIFY DEVICES WILL NOT BE OBSTRUCTED.
- PROVIDE PULL STRING IN ALL CONDUITS FOR LATER USE.
- ALL PENETRATIONS THROUGH FIREWALLS WILL NEED FIRESTOP OF THE APPROPRIATE RATING.

NOTES:

- ROUTE A 1" CONDUIT FROM THE DEMARCATION POINT TO CEILING SPACE FOR FUTURE UTILITY CABLE.
- COORDINATE LOCATION(S) OF ALL DUCT DETECTORS WITH MECHANICAL PLANS.
- 4" CONDUIT WITH ACCESS AT EACH FLOOR FOR FUTURE 'DAS' SYSTEM. PER CODE REQUIREMENTS.
- COORDINATE WITH ELEVATOR CONTRACTOR AND PROVIDE ROUGH-IN AND CABLE CONNECTIONS AS NECESSARY FOR CARD READER.
- COORDINATE WITH ELEVATOR CONTRACTOR AND PROVIDE ROUGH-IN AS NECESSARY FOR CAMERA SUPPLIED BY OTHERS IN ELEVATOR.
- FLOW & TAMPER SENSORS FOR FIRE SPRINKLER RISER, VERIFY EXACT COUNT WITH FIRE SPRINKLER DESIGN.
- (2) 4" CONDUITS FROM UTILITY DEMARC "UTILITY 106" TO "UTILITY 215".
- PROVIDE CONDUIT AND CABLE FOR FUTURE CAMERA.

FIRE ALARM AND DETECTION SYSTEM SHOWN ON PLAN(S) ARE FOR DESIGN INTENT ONLY. THIS IS A DEFERRED SUBMITTAL SYSTEM REQUIRING THE CONTRACTOR TO COMPLETE THE PERMIT READY DESIGN AND CALCULATIONS AS REQUIRED PER THE AUTHORITY HAVING JURISDICTION. VERIFY BUILDING OCCUPANCY TYPE AND OCCUPANT LOAD WITH ARCHITECTURAL PLANS.

1 FLOOR PLAN - LEVEL 1
T3.01 1/8" = 1'-0"