

MFA Consulting Engineers
2007 S.E. Ash St.
Portland, OR 97214
PHN: (503) 234-0548
FAX: (503) 234-0677
INC. WWW.MFA-ENG.COM
CONTACT: Gary Adovnik

PRELIMINARY - NOT
FOR CONSTRUCTION

PERMIT SET

09.17.2018	date:
issue:	
50% DD	04.30.2018
100% DD	06.18.2018
50% CD	08.03.2018
PERMIT	09.17.2018


revision:	date:
-----------	-------

title:

ROOF PLAN

sheet:

T3.07

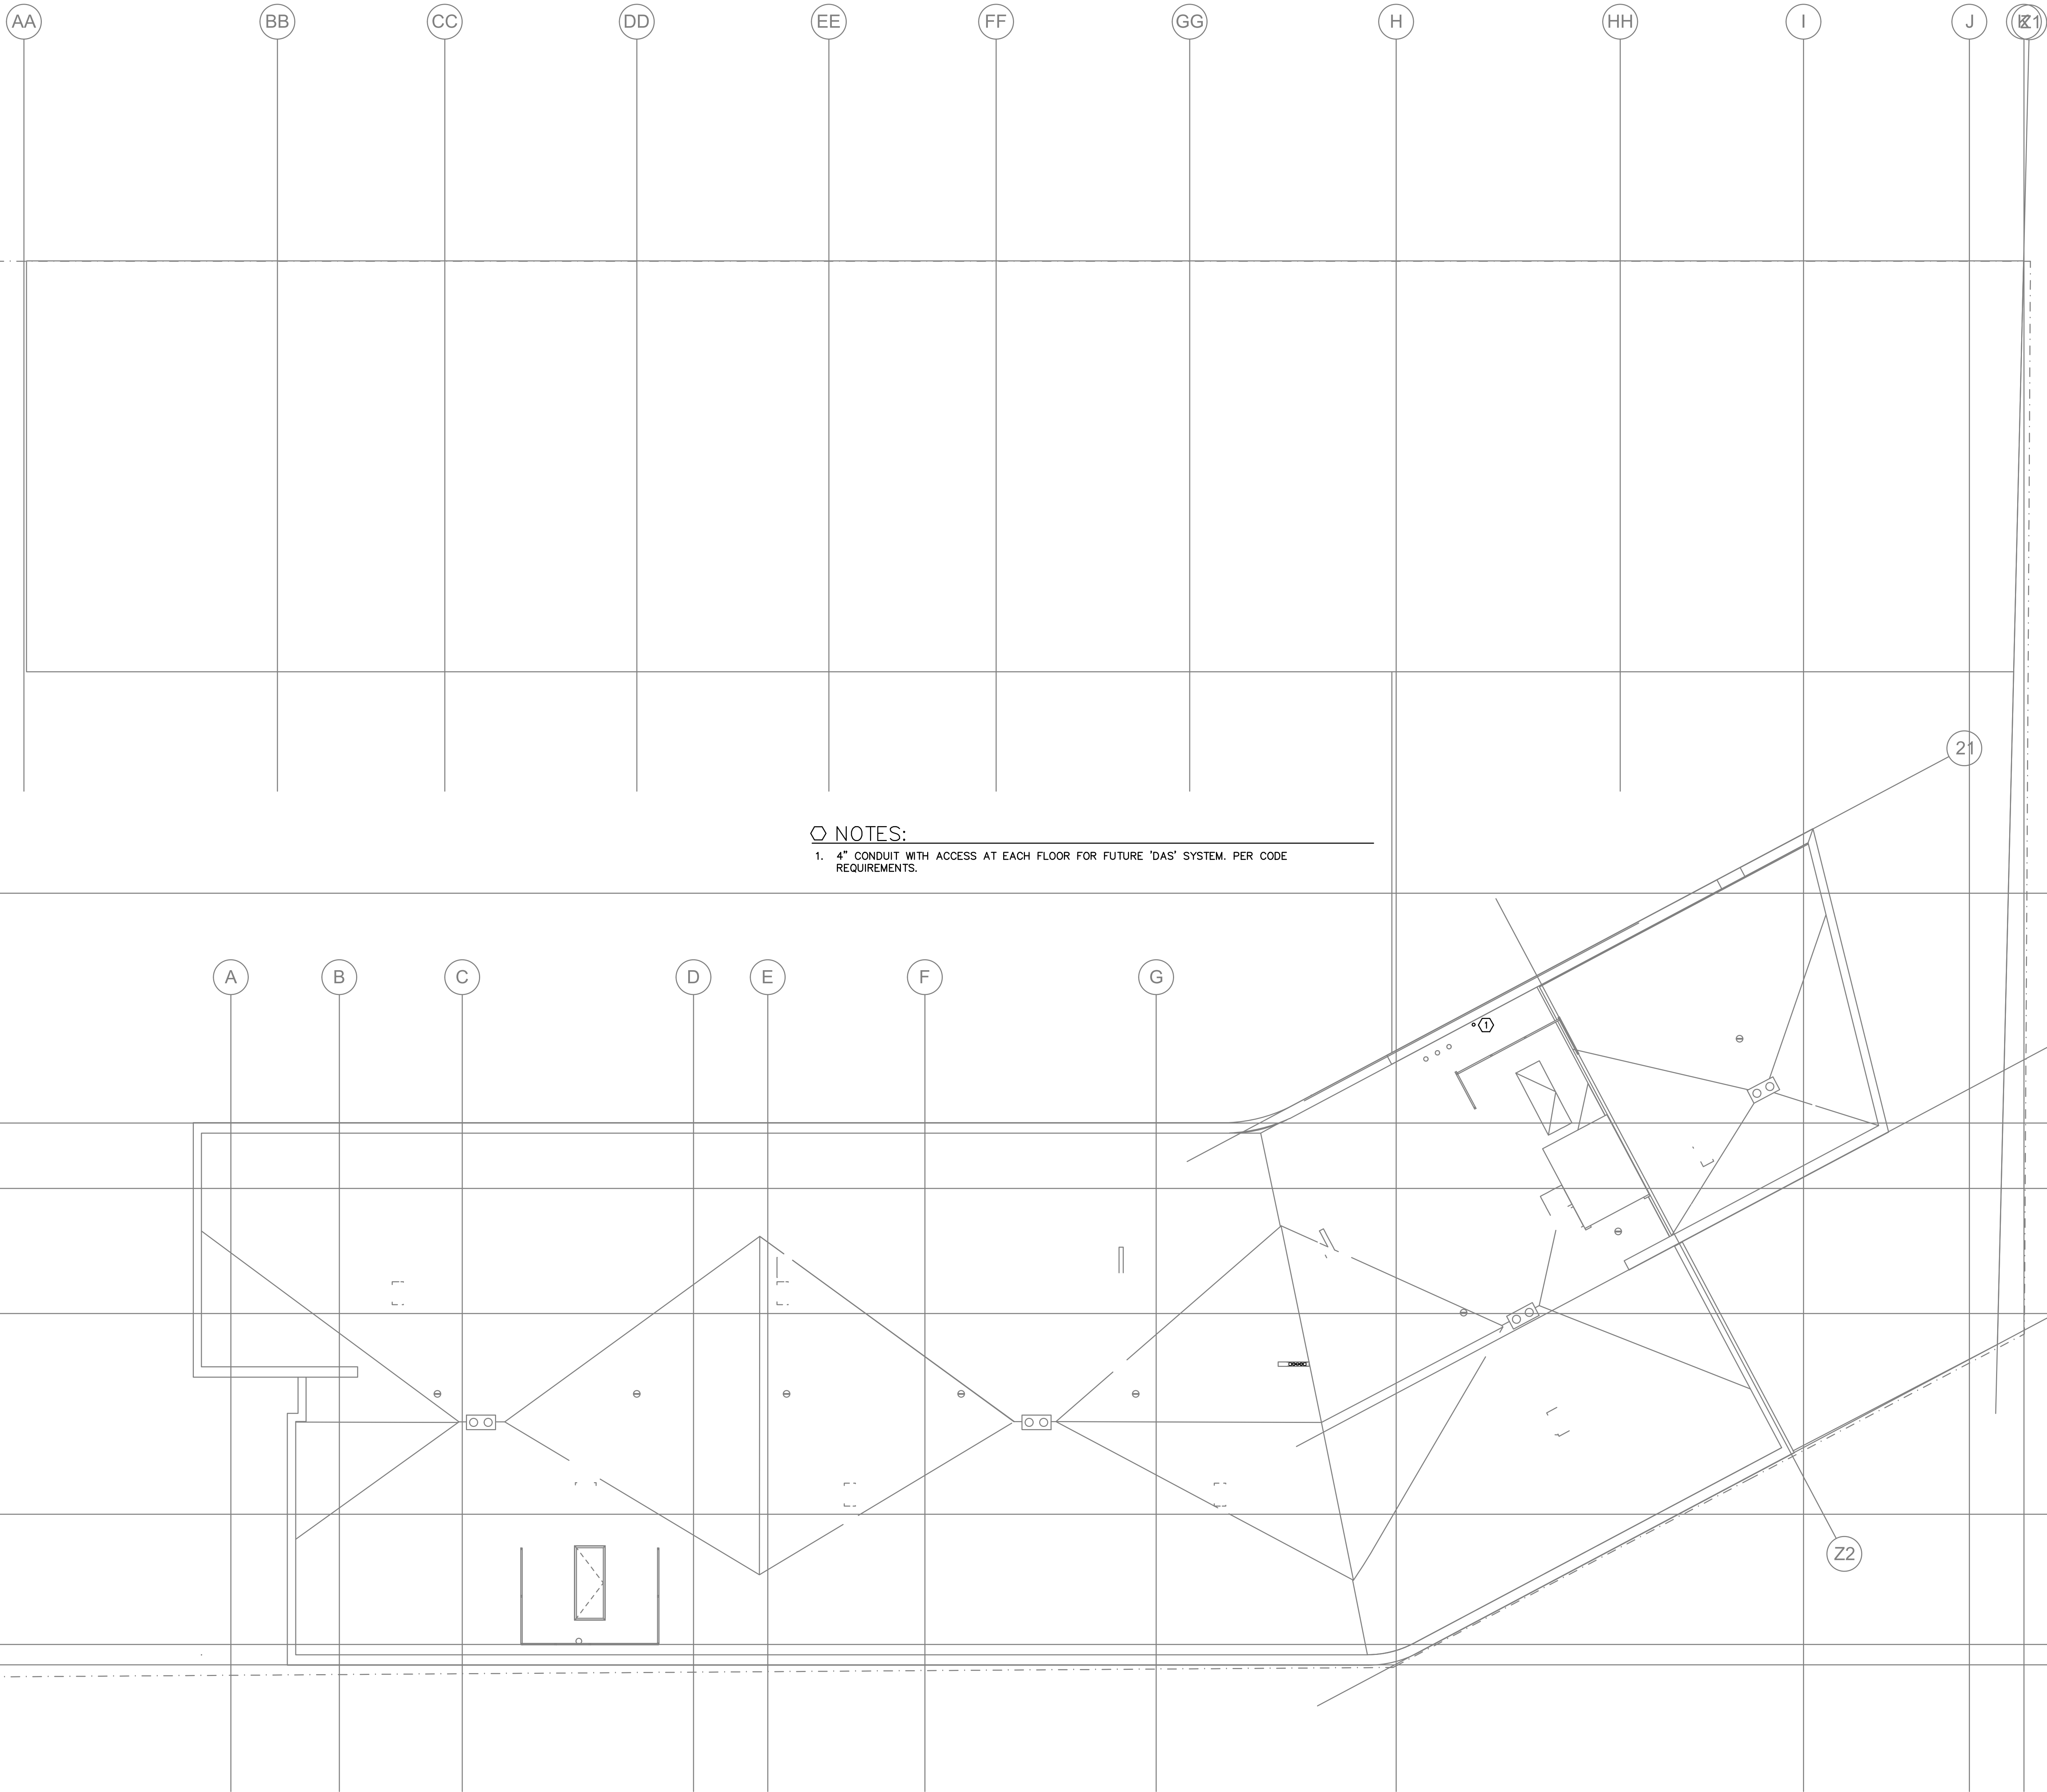

NOTES:
1. 4" CONDUIT WITH ACCESS AT EACH FLOOR FOR FUTURE 'DAS' SYSTEM. PER CODE REQUIREMENTS.

1 ROOF PLAN
T3.07 1/8" = 1'-0"

FIRE ALARM AND DETECTION SYSTEM SHOWN ON PLAN(S) ARE FOR DESIGN INTENT ONLY. THIS IS A DEFERRED SUBMITTAL SYSTEM REQUIRING THE CONTRACTOR TO COMPLETE THE PERMIT READY DESIGN AND CALCULATIONS AS REQUIRED PER THE AUTHORITY HAVING JURISDICTION. VERIFY BUILDING OCCUPANCY TYPE AND OCCUPANT LOAD WITH ARCHITECTURAL PLANS.