



OPERATING NOTE:
 DAMPER TO BE NORMALLY CLOSED AND TO FAIL OPEN ON LOSS OF POWER.
 DAMPER TO OPEN ON INPUT SIGNAL FROM FIRE ALARM PANEL.
 DAMPER TO BE MOTORIZED CLOSED.


1 ELEVATOR RELIEF HOOD NTS

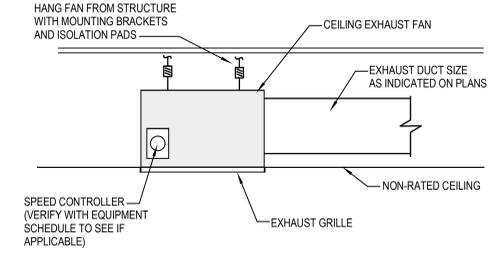


2 CEILING EXHAUST FAN - NON RATED LOCATION NTS

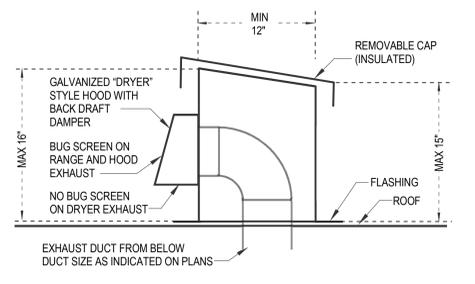


4 VANDERPLOEG ROOF EXHAUST TERMINATION NTS

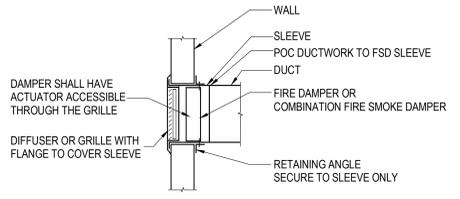


5 FIRE SMOKE DAMPER - AT GRILLE OR DIFFUSER NTS




6 FIRE SMOKE DAMPER - IN WALL NTS

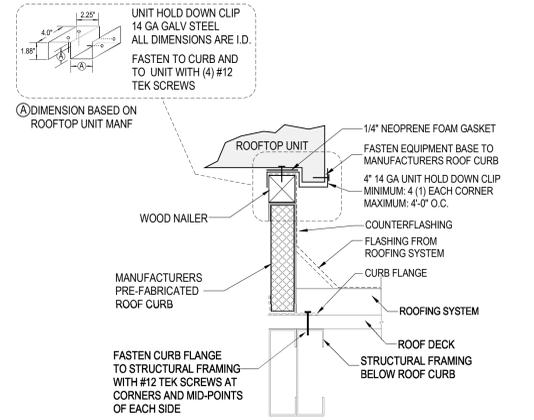


7 ROOF CURB DETAIL NTS

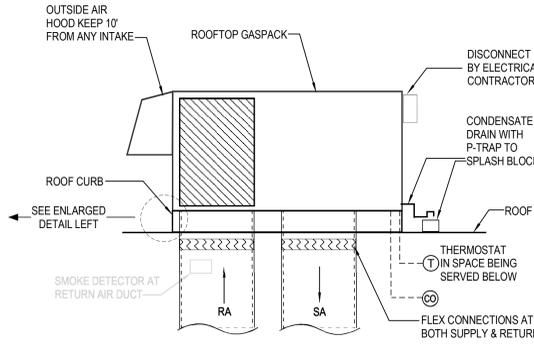


8 PACKAGED ROOFTOP UNIT NTS

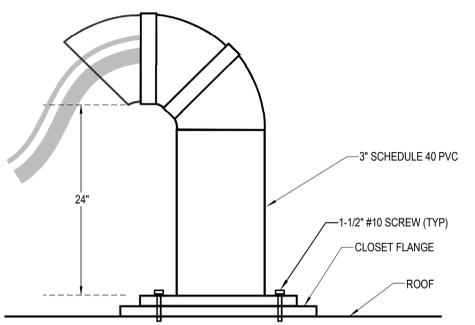


9 REFRIGERATION LINES AT ROOF NTS

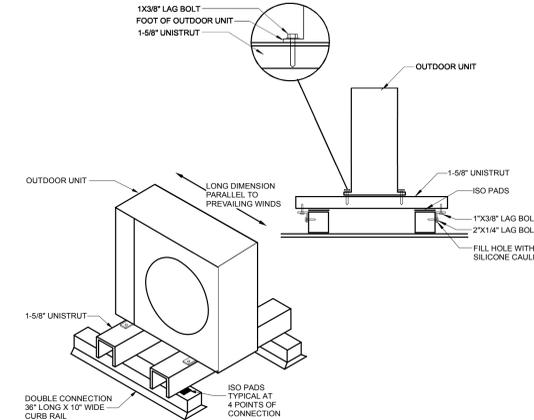


10 OUTDOOR UNIT AT ROOF NTS

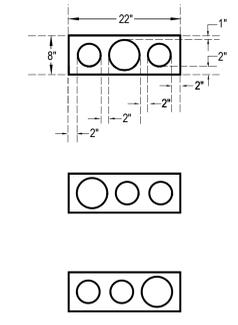

11 EXHAUST PLENUM TERMINATION NTS

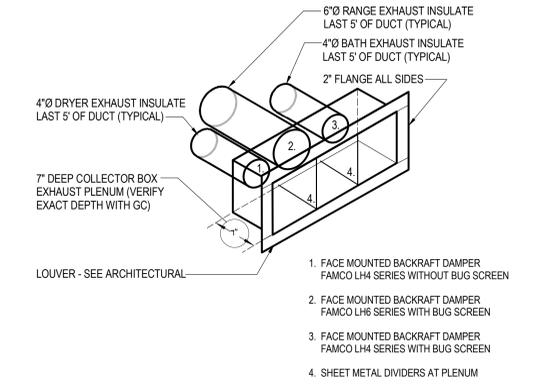

12 DETAIL EXHAUST PLENUM NTS

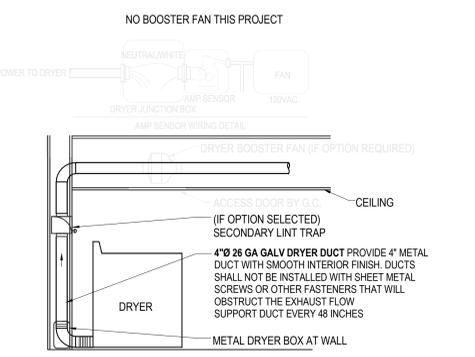

13 DRYER EXHAUST DETAIL NTS

DRYER EXHAUSTING INFORMATION—USE METAL DUCT ONLY VERTICAL AND HORIZONTAL DUCTING

Domestic dryer models	Number of 90° turns	BEST PERFORMANCE	
		A 4" opening	B 2-1/2" opening
	0	200 ft.	175 ft.
	1	185 ft.	165 ft.
	2	175 ft.	155 ft.
	3	165 ft.	145 ft.
GE Front Load Long Vent 7.0 cu. ft. capacity electric dryer (GFDL)	4	155 ft.	135 ft.
	5	145 ft.	125 ft.

14 DRYER VENTING CHART NTS