




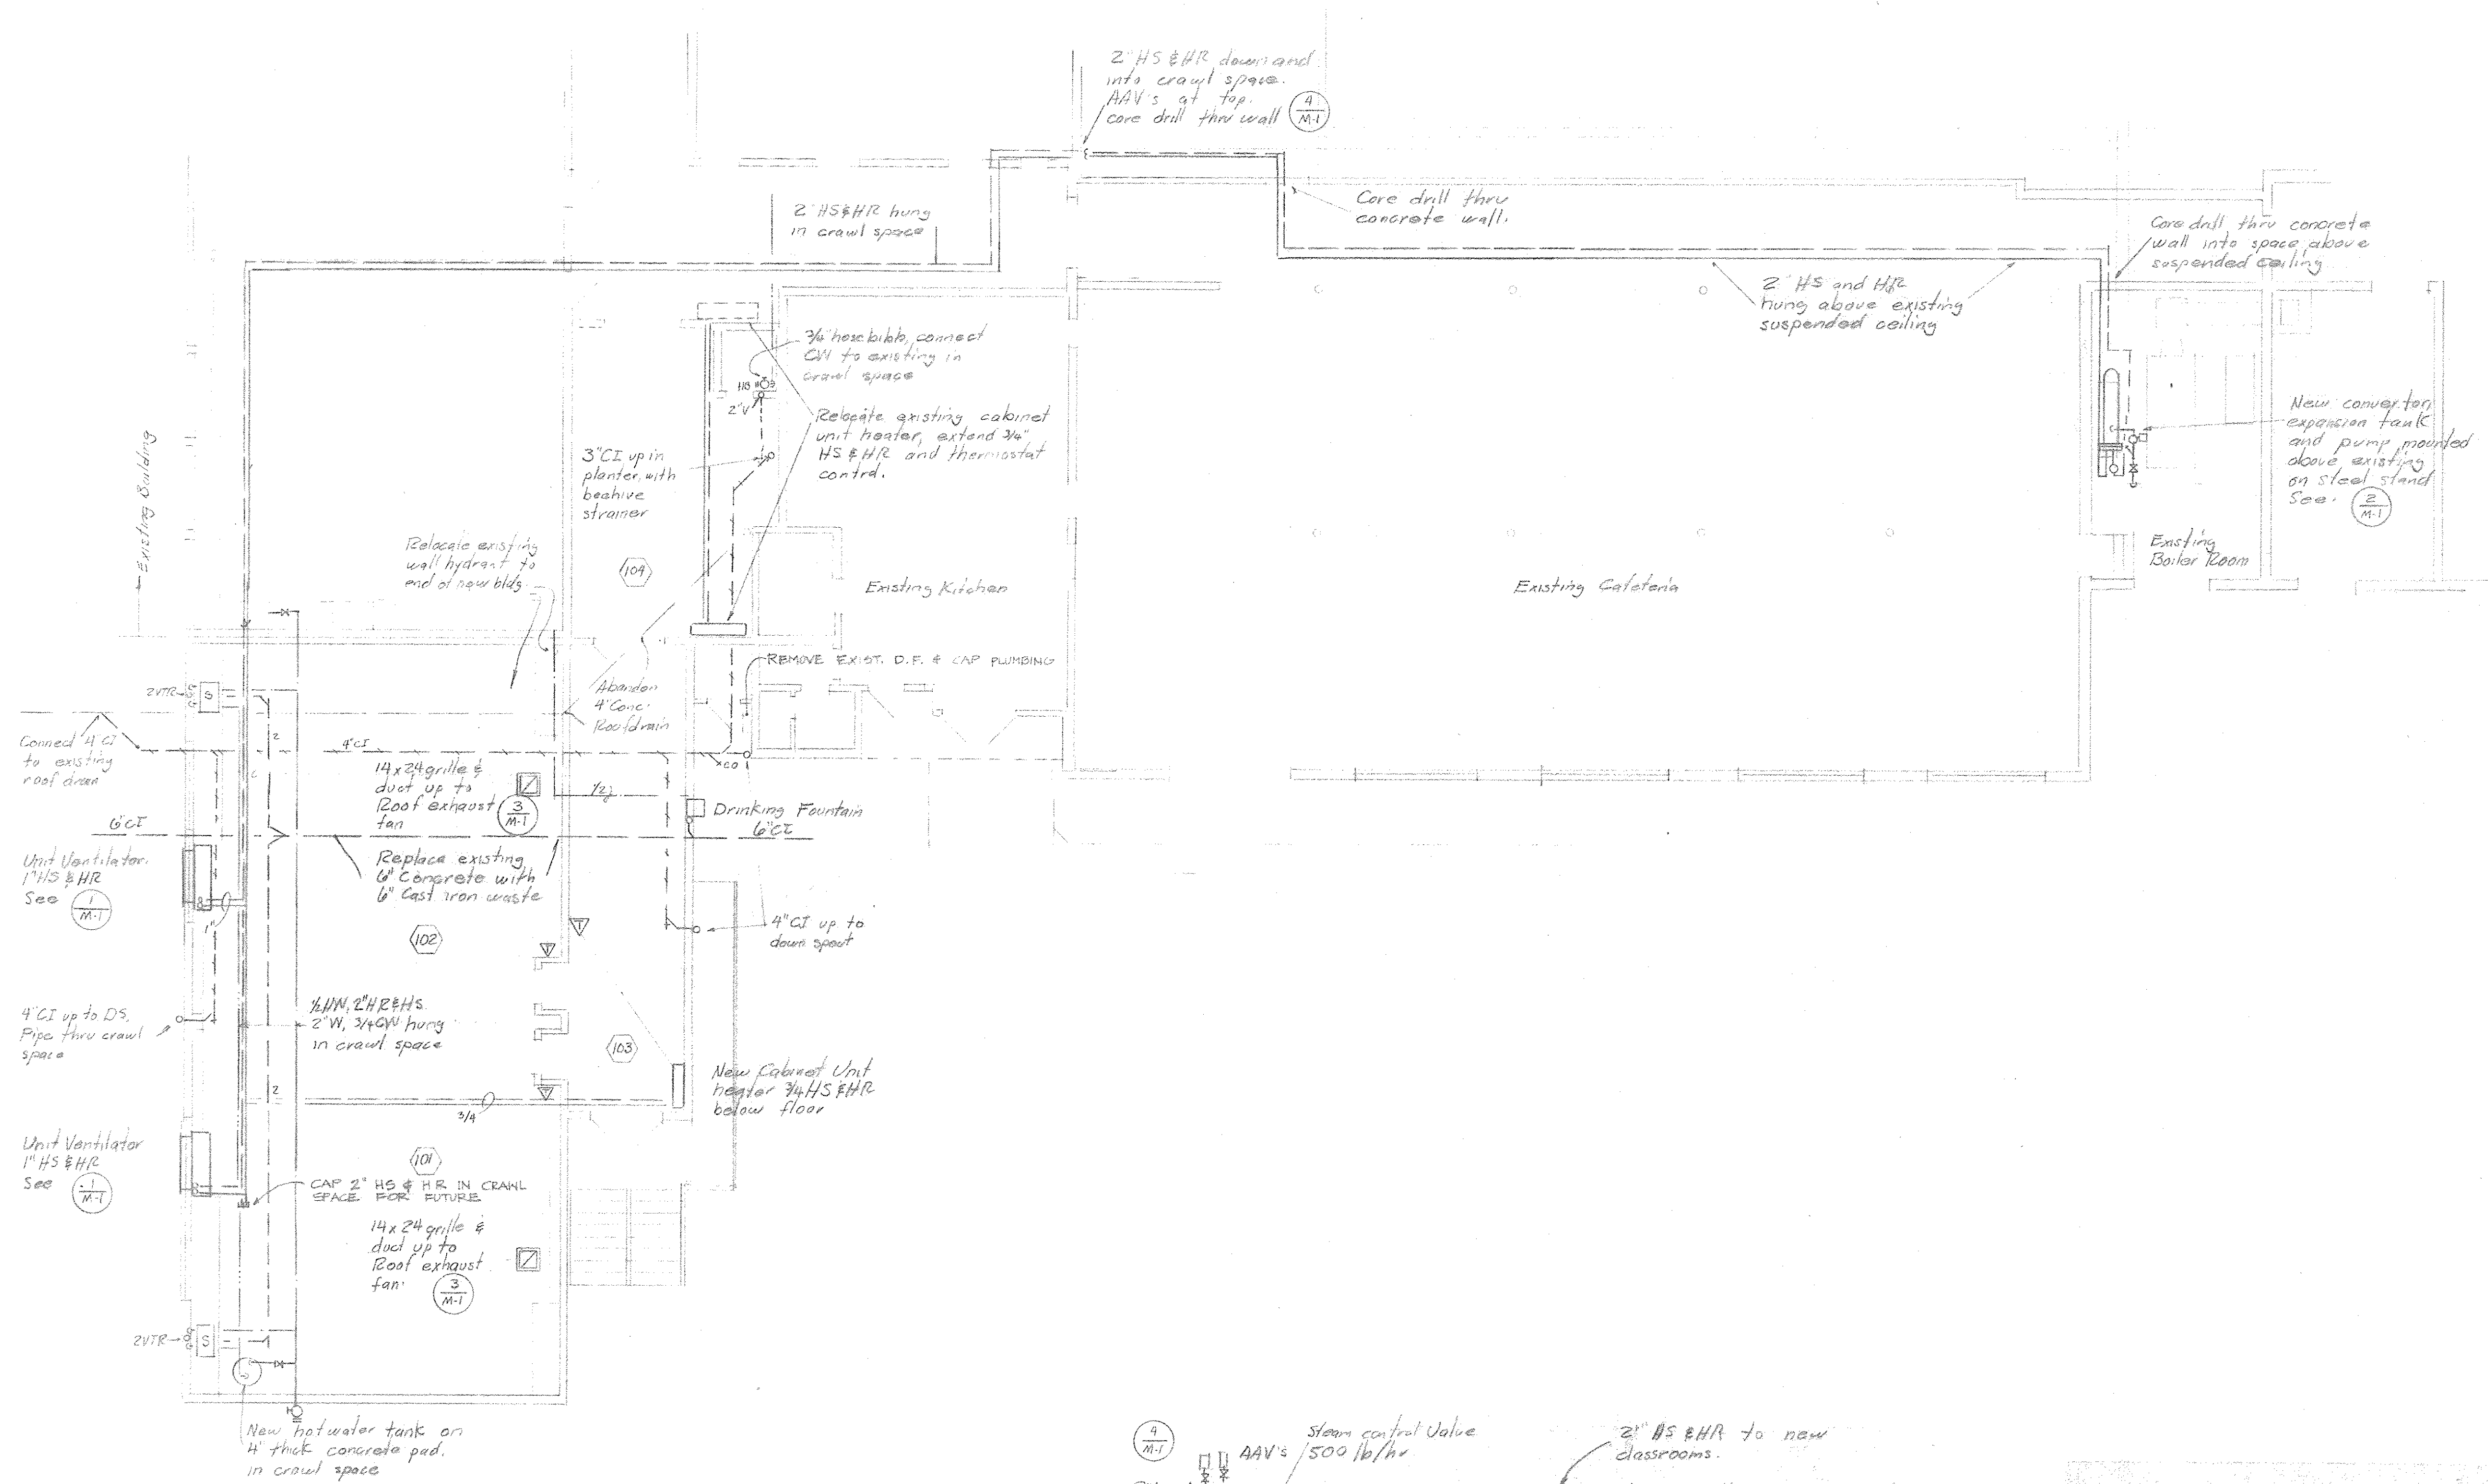


SYMBOLS	
—W	Waste Pipe
---V	Vent Pipe
—RD	Roof Drain Pipe
—CW	Cold Water Pipe
—HW	Hot Water Pipe
—WH	Wall Hydrant
—HS	Heating Supply Pipe
—HR	Heating Return Pipe
—O	Pipe Up
—D	Pipe Down
—X	Plumbing Cleanout
VTR	Vent Thru Roof
14x24	Grille Size Width By Depth
1000	Air Volume In Cubic Ft Per Min
▽	Unit Thermostat
□	Ceiling Exhaust Grille
⊕	Valves, Gate, Globe, Check
⊙	Automatic Valve
⊕	Union, Strainer, Adjusting Cock

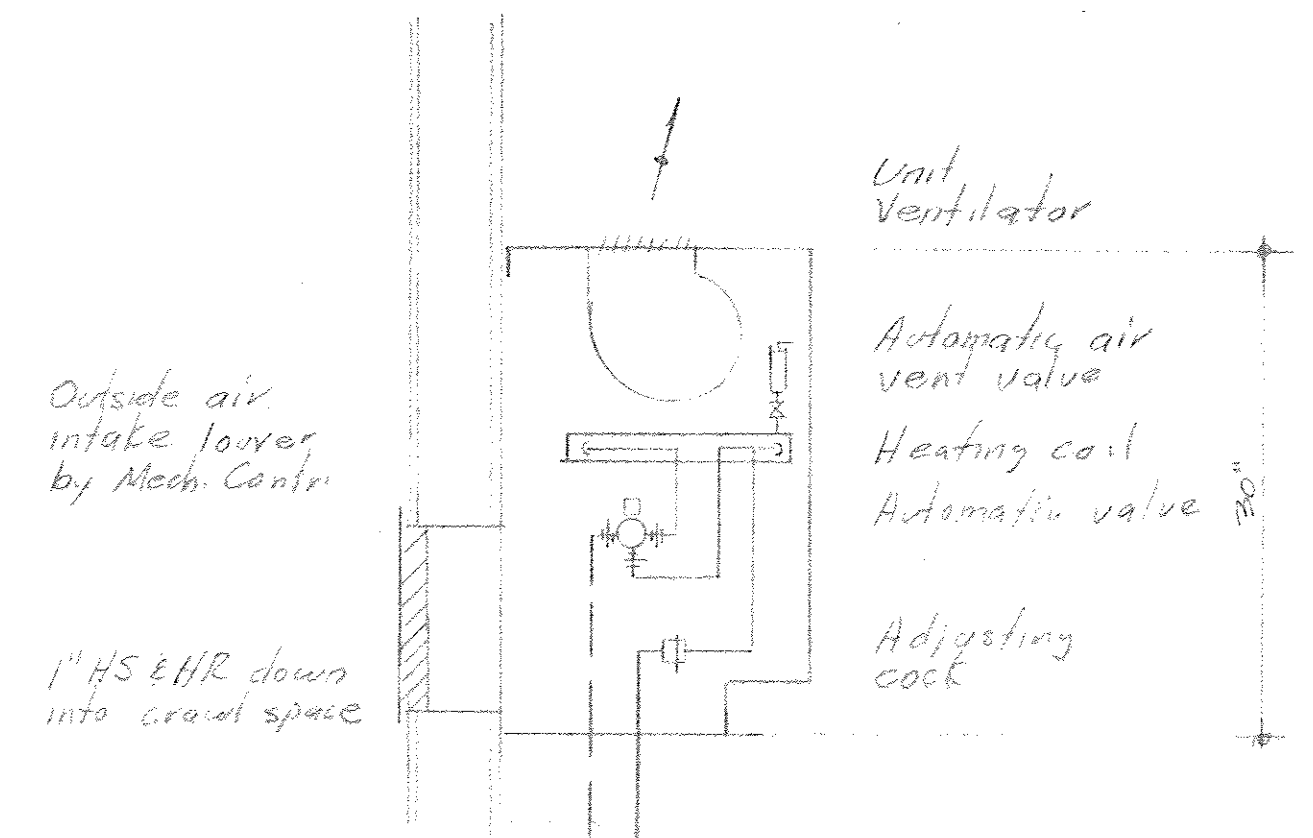


UNIT VENTILATOR
INSTALLATION DETAIL (1) M-1
No Scale

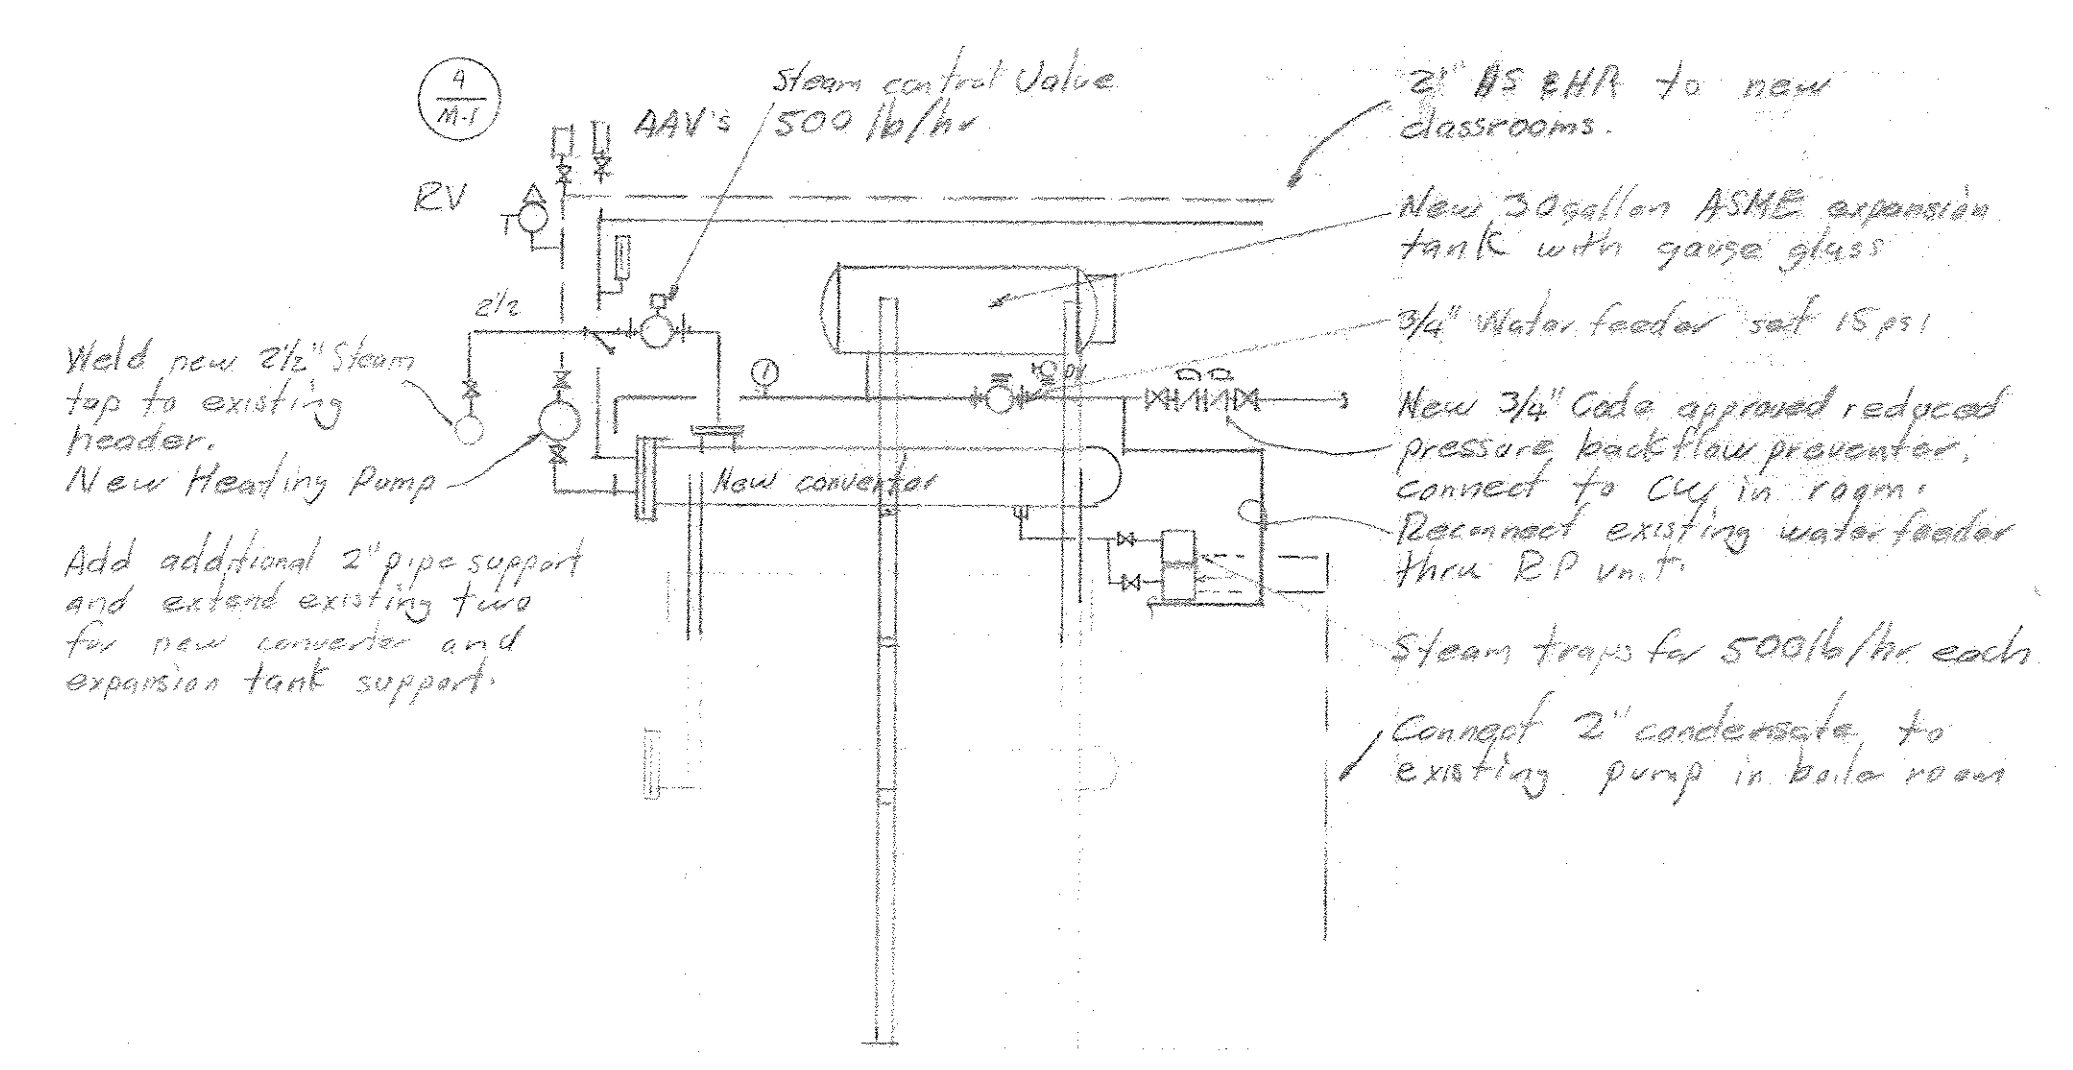

BOILER ROOM PIPING
DIAGRAM (2) M-1
No Scale

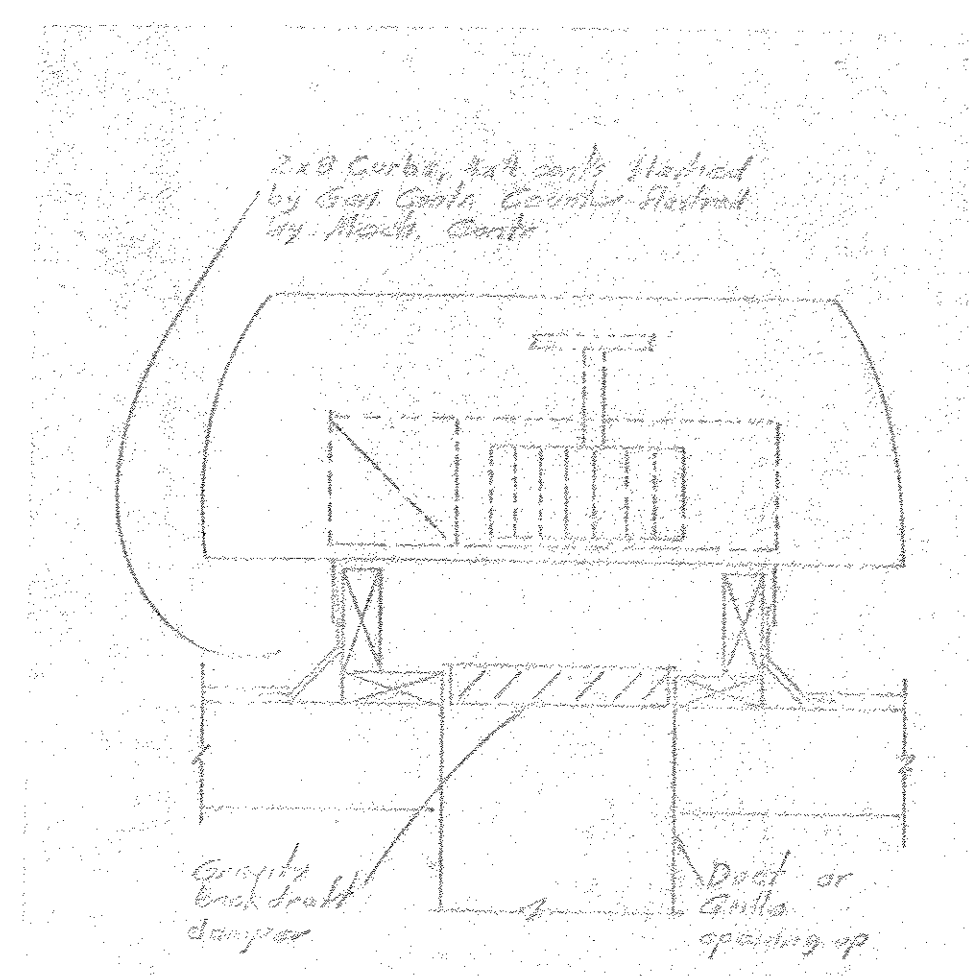

TYPICAL REF.
INSTALLATION DETAIL (3) M-1
NO SCALE

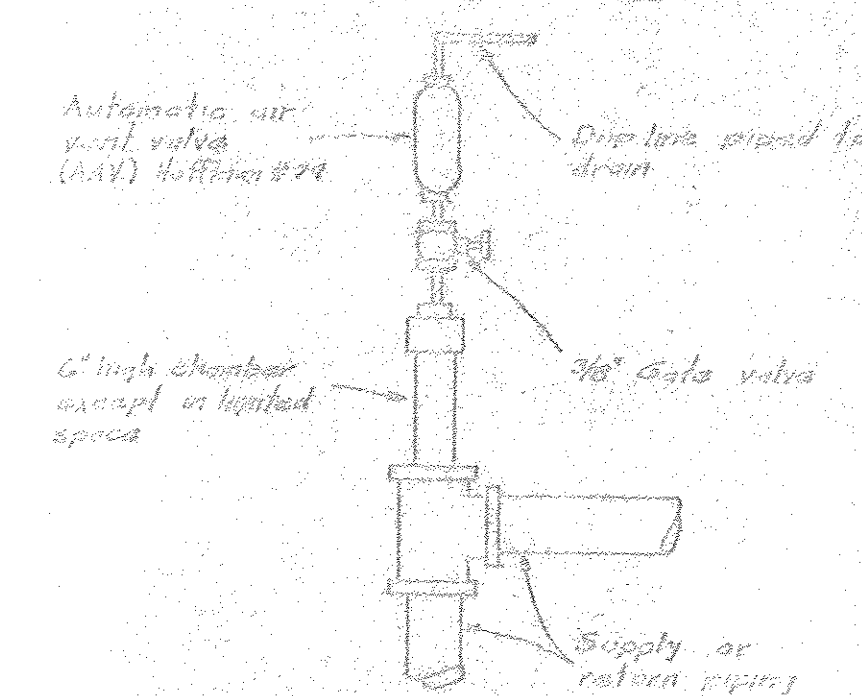

TYPICAL AAV VALVE
INSTALLATION DETAIL (4) M-1
NO SCALE