




1 SINGLE DRYER VENT
M6.3 NOT TO SCALE

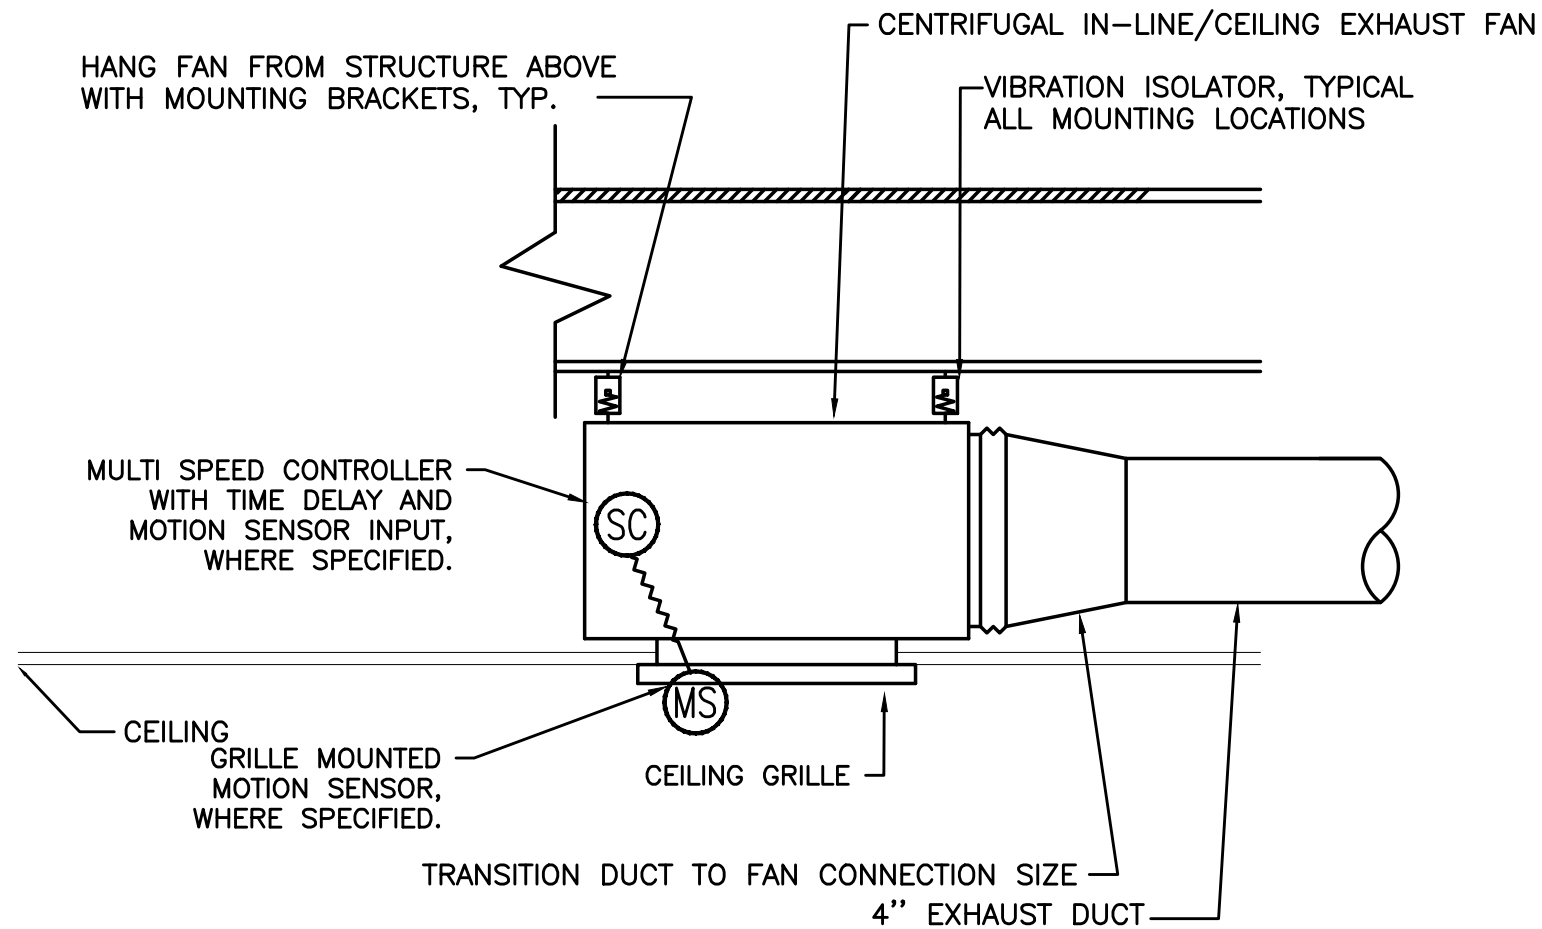


2 RESTROOM EXHAUST FAN
M6.3 SCALE:DETAIL

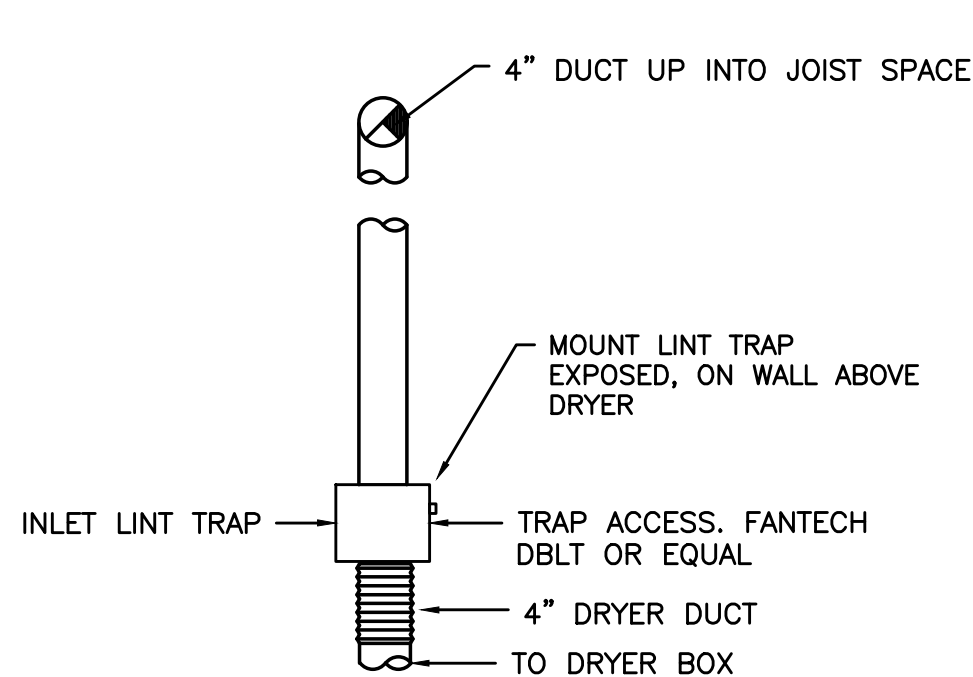


3 LINT TRAP
M6.3 DETAIL

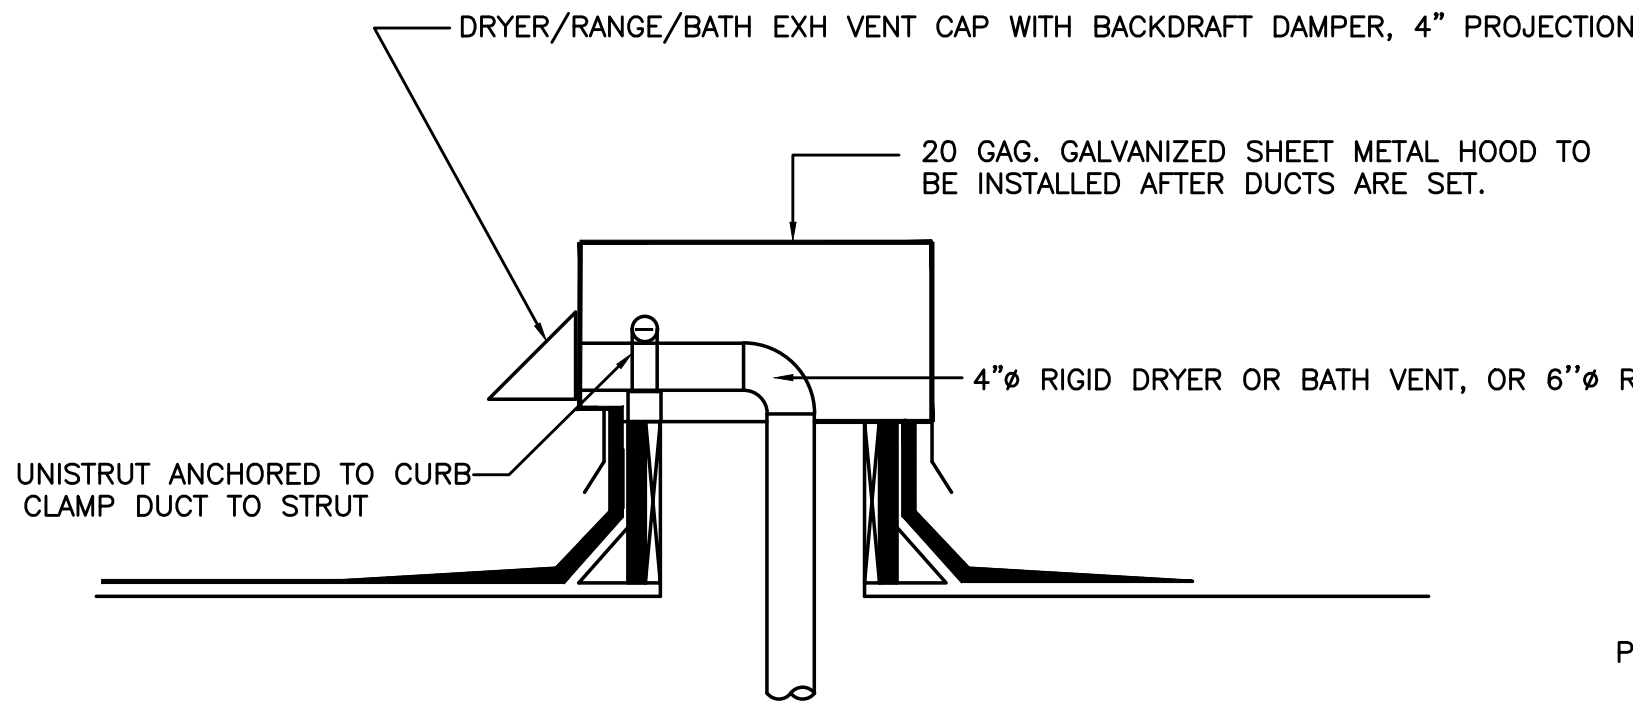

4 TYPICAL ROOFTOP OUTLET HOOD
M6.3 NOT TO SCALE

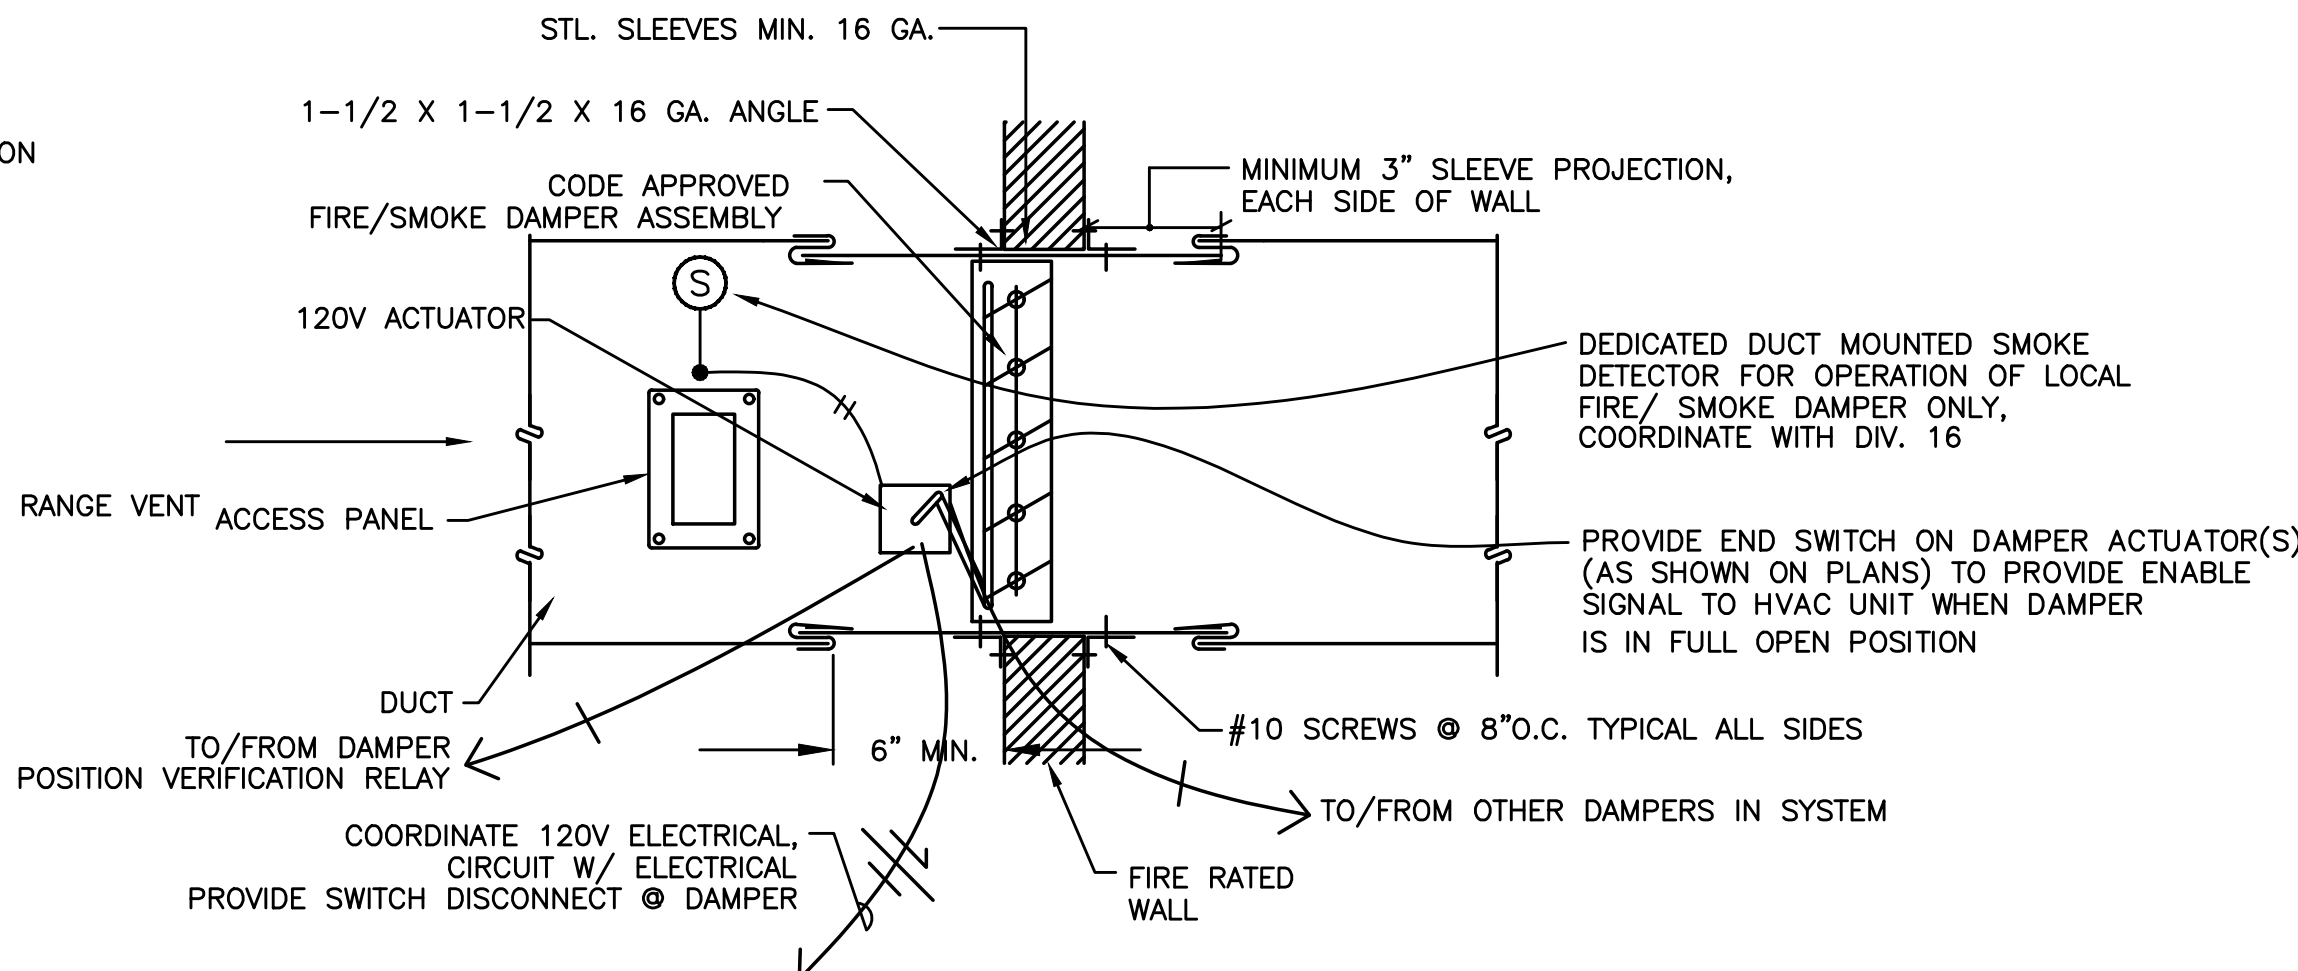

5 FIRE/SMOKE DAMPER W/SMOKE DETECTOR
M6.3 NOT TO SCALE

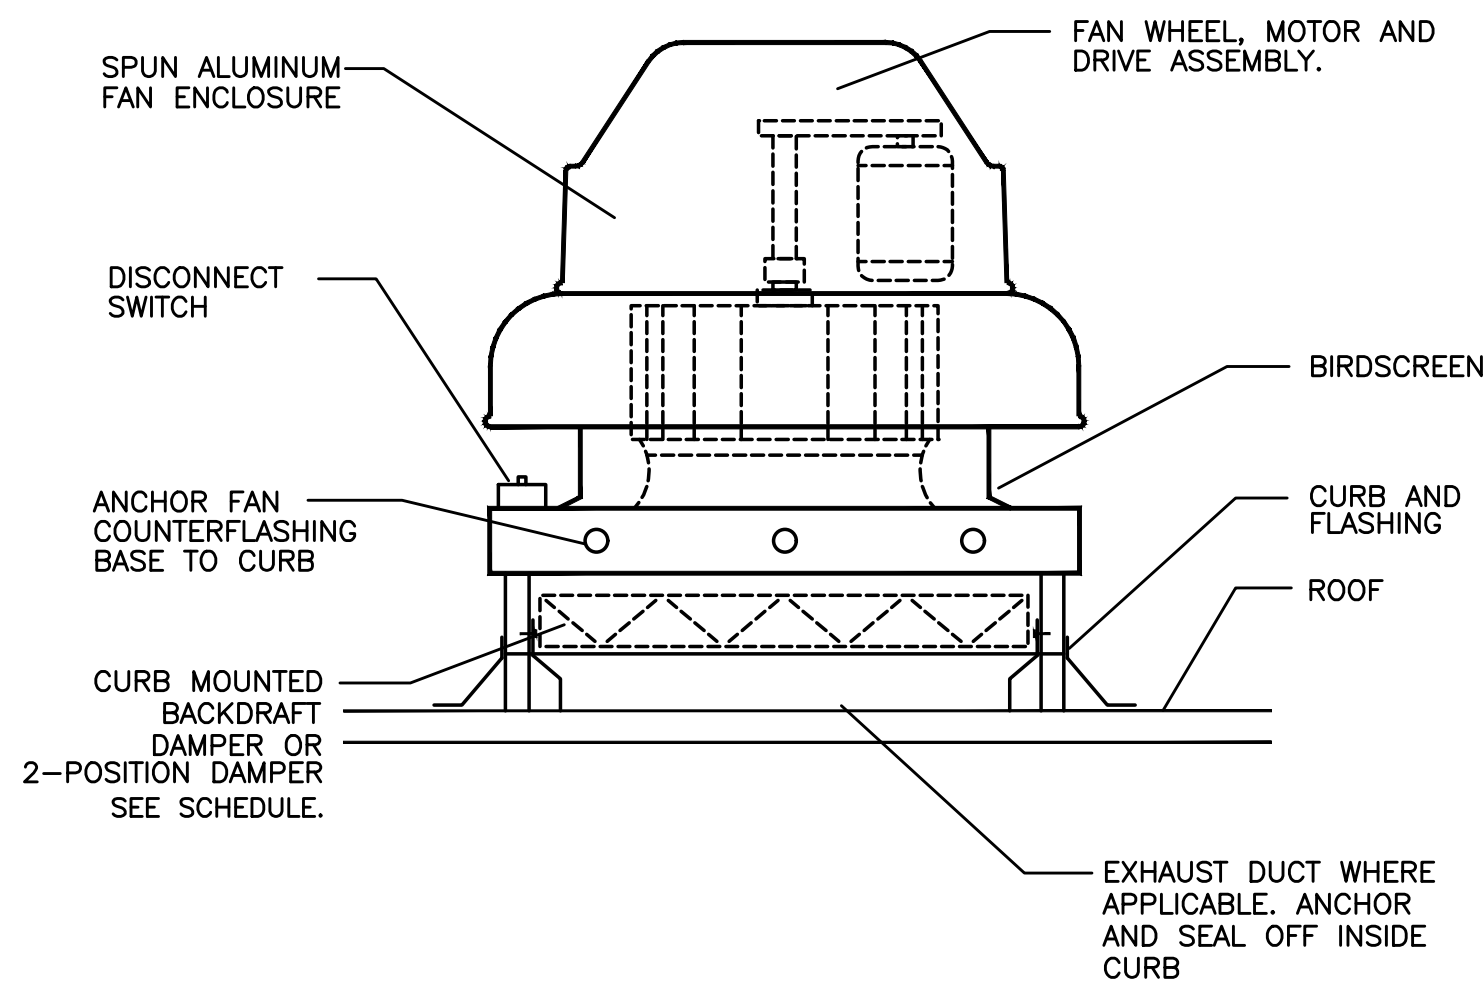

6 EXHAUST FAN
M6.3 DETAIL

NOTE:

PROVIDE ALL REQUIRED CONTROL WIRING TO ACCOMPLISH:

FIRE/SMOKE DAMPER - FIRE/SMOKE DAMPER TO CLOSE UPON ACTIVATION OF LOCAL SMOKE DETECTOR

EXHAUST DUCTS/FANS - FIRE/SMOKE DAMPER TO CLOSE UPON SHUTDOWN OF ASSOCIATED EXHAUST FAN.

SUPPLY OR RETURN DUCTS/FANS - FIRE/SMOKE DAMPER TO CLOSE UPON SHUTDOWN OF ASSOCIATED AIR HANDLING UNIT.

GENERAL NOTES:

PROVIDE ACCESS IN CEILING OR WALL FOR DAMPER AND SMOKE DETECTOR

SEE ELECTRICAL DRAWINGS FOR WIRING INSTALLATION