


- KEYED NOTES:
- 6"Ø RANGE HOOD VENT TERMINATION AT ROOF.
- GENERAL NOTES:
- LIQ. & SUCTION REF LINES ARE SHOWN AS A SINGLE PIPE FOR THE PURPOSE OF SHOWING ROUTING OF THE PIPING.
 - OSA INTAKES AT RTU'S TO BE LOCATED MINIMUM OF 10'-0" RADIUS FROM ANY EXHAUST VENTS, PLUMBING VENTS OR FLUE TERMINATIONS.

SCU
DOWNS

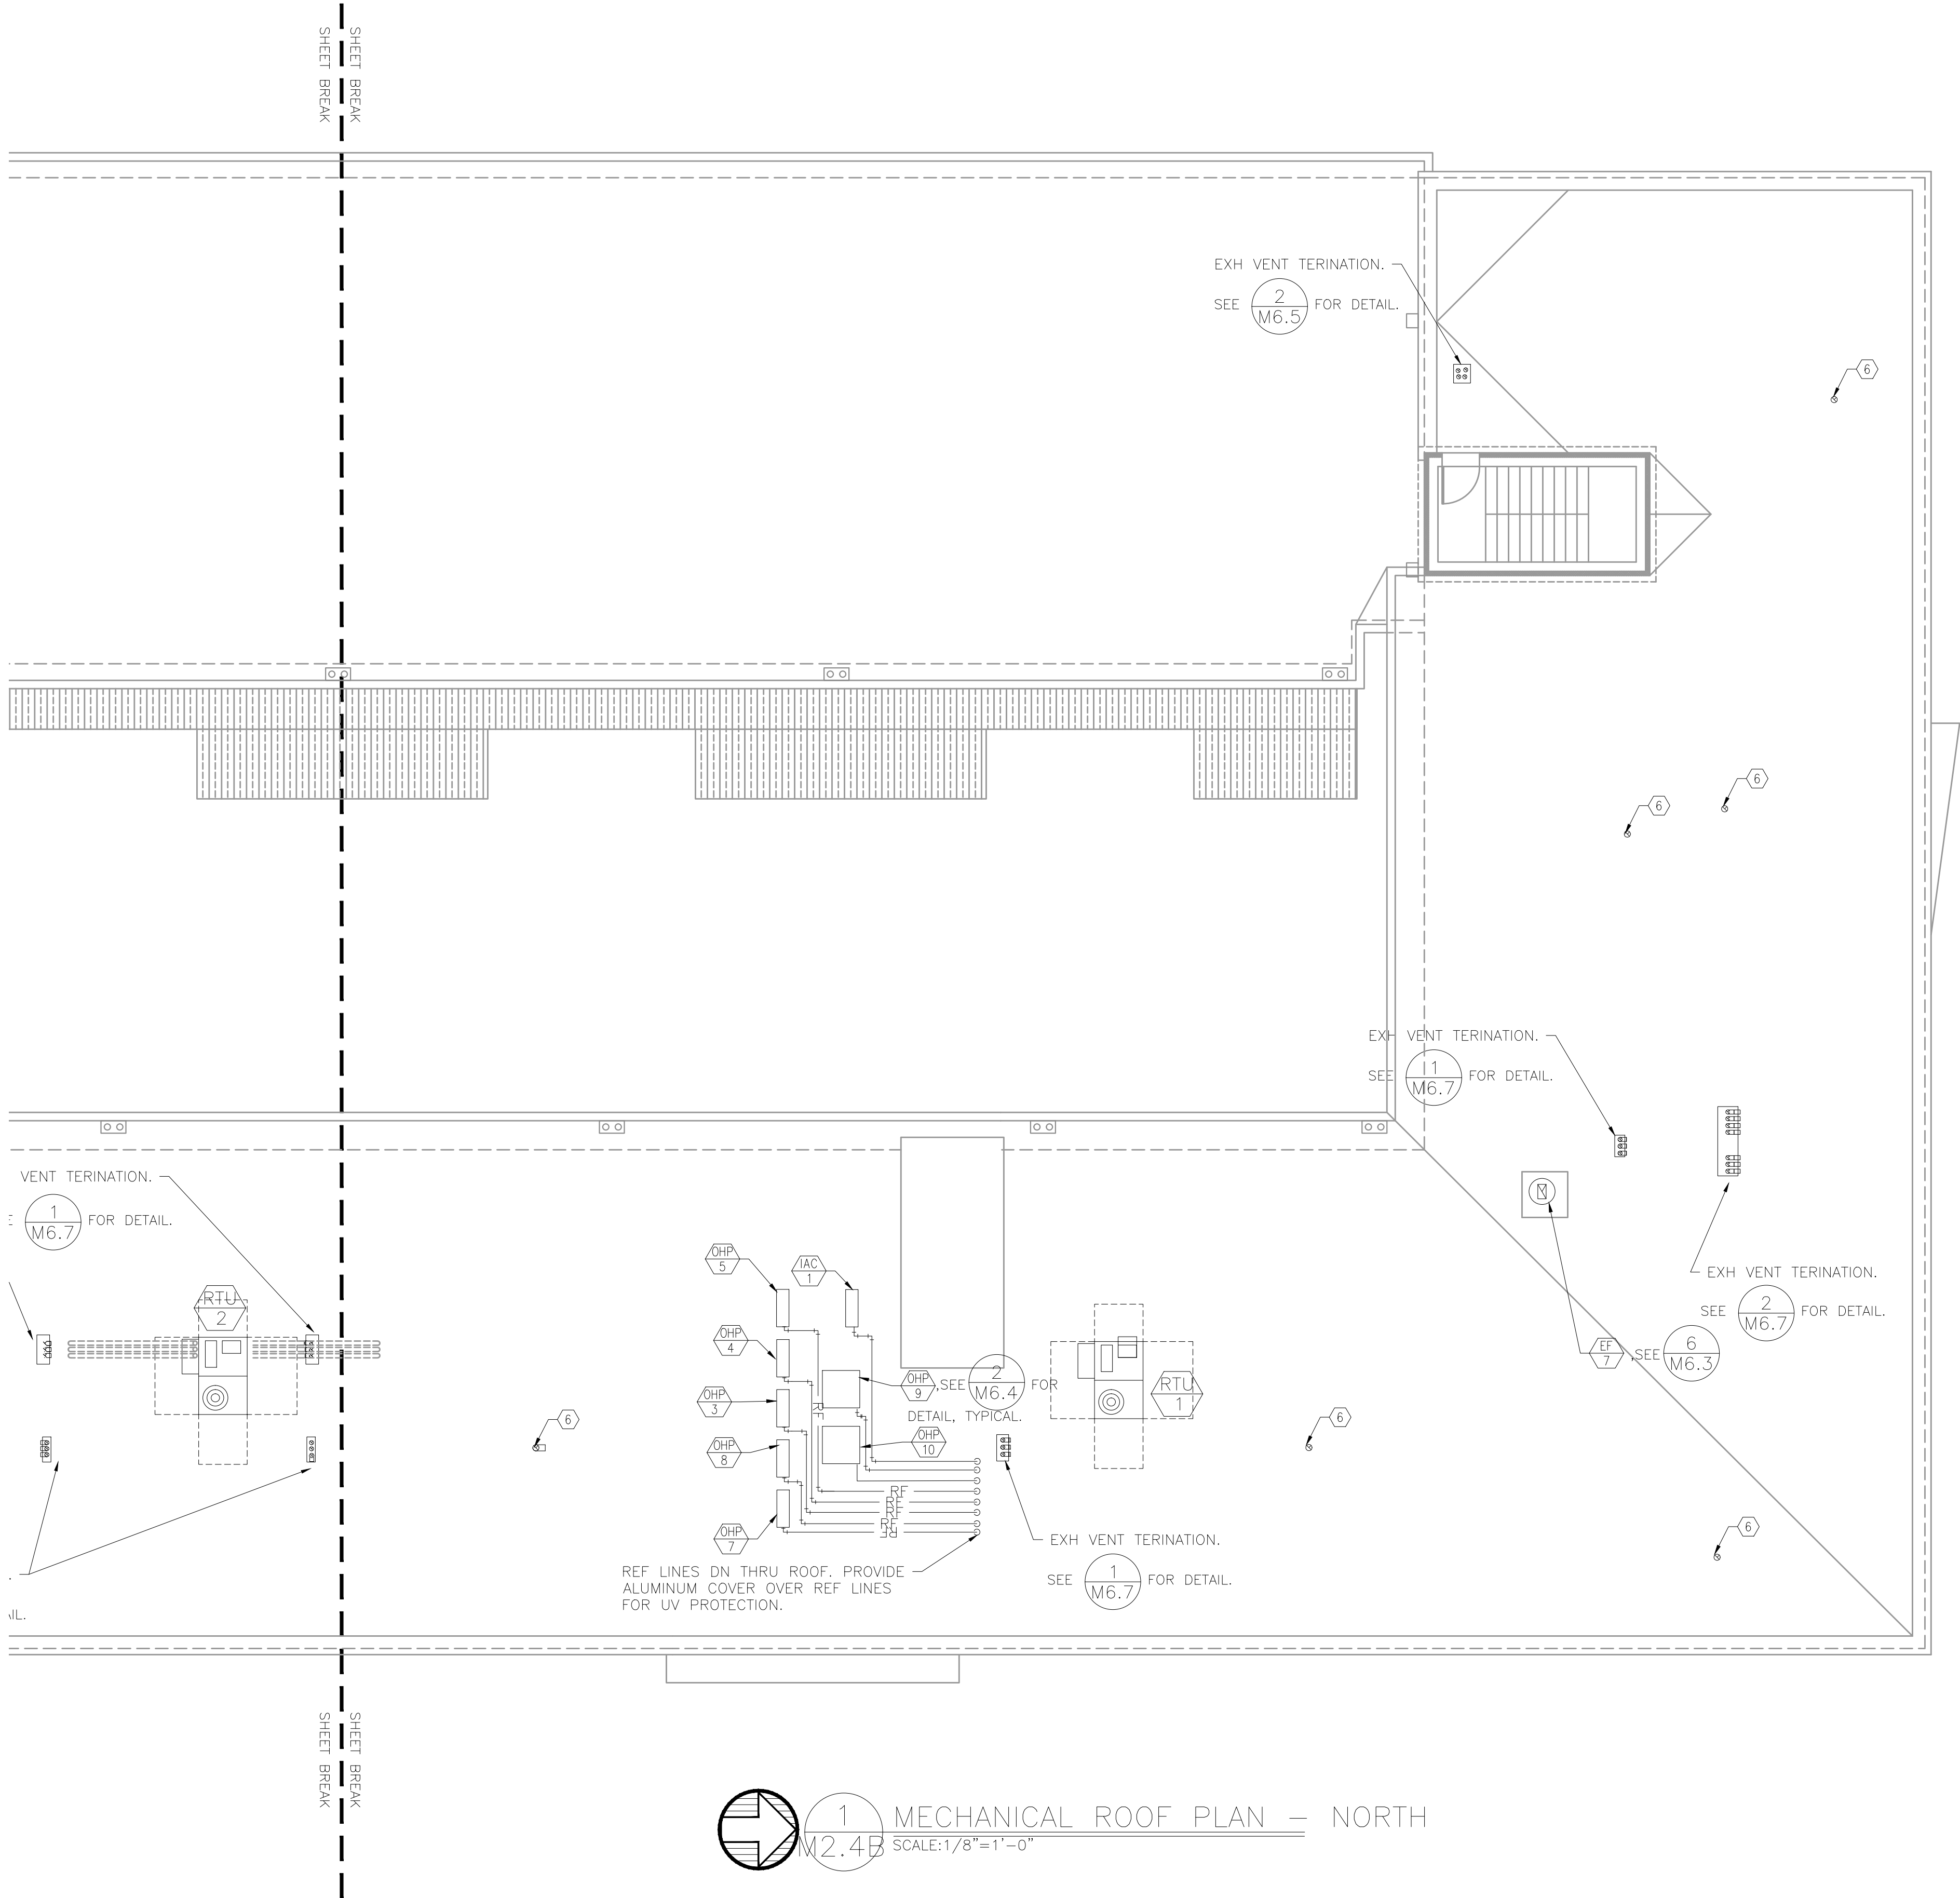

MFI Consulting Engineers
2007 S.E. Ash St.
Portland, OR 97214
PHN: (503) 234-0548
FAX: (503) 234-0677
INC. WWW.MFI-ENG.COM
CONTACT: Takako Baker

KING+PARKS MULTI-FAMILY RESIDENCES

PROJECT SITE: NE Martin Luther King Jr. Boulevard & N Rosa Parks Way
OWNER: Portland Community Reinvestment Initiatives Inc. (PCRI)
6329 NE Martin Luther King Jr. Blvd. Portland, Oregon 97211

PROJECT NO. 16-0602
ISSUE DATE 06.23.2017
REVISIONS

SHEET
MECHANICAL
ROOF PLAN - NORTH

M2.4B

NOT FOR CONSTRUCTION

PRICING SET

© MERRYMAN BARNES ARCHITECTS, INC.

PRELIMINARY
NOT FOR
CONSTRUCTION

MBA

MERRYMAN BARNES ARCHITECTS 4713 N ALBINA AVE SUITE 304 PORTLAND, OREGON 97217 P. 503.222.3753 WWW.MERRYMANBARNESARCHITECTS.COM