


- KEYED NOTES:
- 4"Ø BA EXH FROM BELOW AND UP.
  - 6"Ø RANGE HOOD EXH FROM BELOW. AND UP.
  - 4"Ø BA EXH UP.
  - 6"Ø RANGE HOOD EXH UP THRU ROOF.
  - 6"Ø EXH UP.
  - LINT TRAPS ON DRYER. SEE 5/M6.4 FOR DETAIL. 4"Ø DRYER EXHAUST DUCT WITH RECESSED DRYER BOX. CONSTRUCTION SOLUTIONS DBX1000, OR APPROVED EQUAL.
  - SEE 1/M6.2 FOR HIGH WALL SUPPLY GRILLE WITH FIRE/SMOKE DAMPER INSTALLATION.
- GENERAL NOTES:
- LIQ & SUCTION REF LINES ARE SHOWN AS A SINGLE PIPE FOR THE PURPOSE OF SHOWING ROUTING OF THE PIPING.
  - SIDEWALL EXHAUST TERMINATIONS TO BE LOCATED 3'-0" MIN RADIUS FROM ANY OPERABLE WINDOWS. SEE ARCHITECTURAL ELEVATIONS.
  - TYPICAL DRYER DUCT TO BE CONSTRUCTED AS FOLLOWS: MATERIAL SHALL HAVE A SMOOTH INTERIOR FINISH AND BE 0.016 INCH THICK. RIVET OR SCREW PENETRATIONS TO THE DUCT WALL ARE NOT ACCEPTABLE. DRYER DUCT SHALL BE SUPPORTED EVERY 4 FOOT INTERVALS.
  - SEE SHEET M6.8 FOR WALL PENETRATION DETAILS. SEE ARCHITECTURAL FOR FLOOR/CEILING PENETRATION DETAIL.
  - SEE PLUMBING PLANS FOR CONDENSATE DRAIN LINES.
  - ROUTE EXHAUST DUCT FROM KITCHEN HOOD TO EXTERIOR BETWEEN JOISTS. RATED ASSEMBLIES TO WRAP AROUND EXHAUST DUCT, PER DETAIL A8.11.
  - BATHROOM CEILING FAN AND DUCTWORK ARE LOCATED IN THE DROPPED CEILING & BELOW RATED ASSEMBLY.

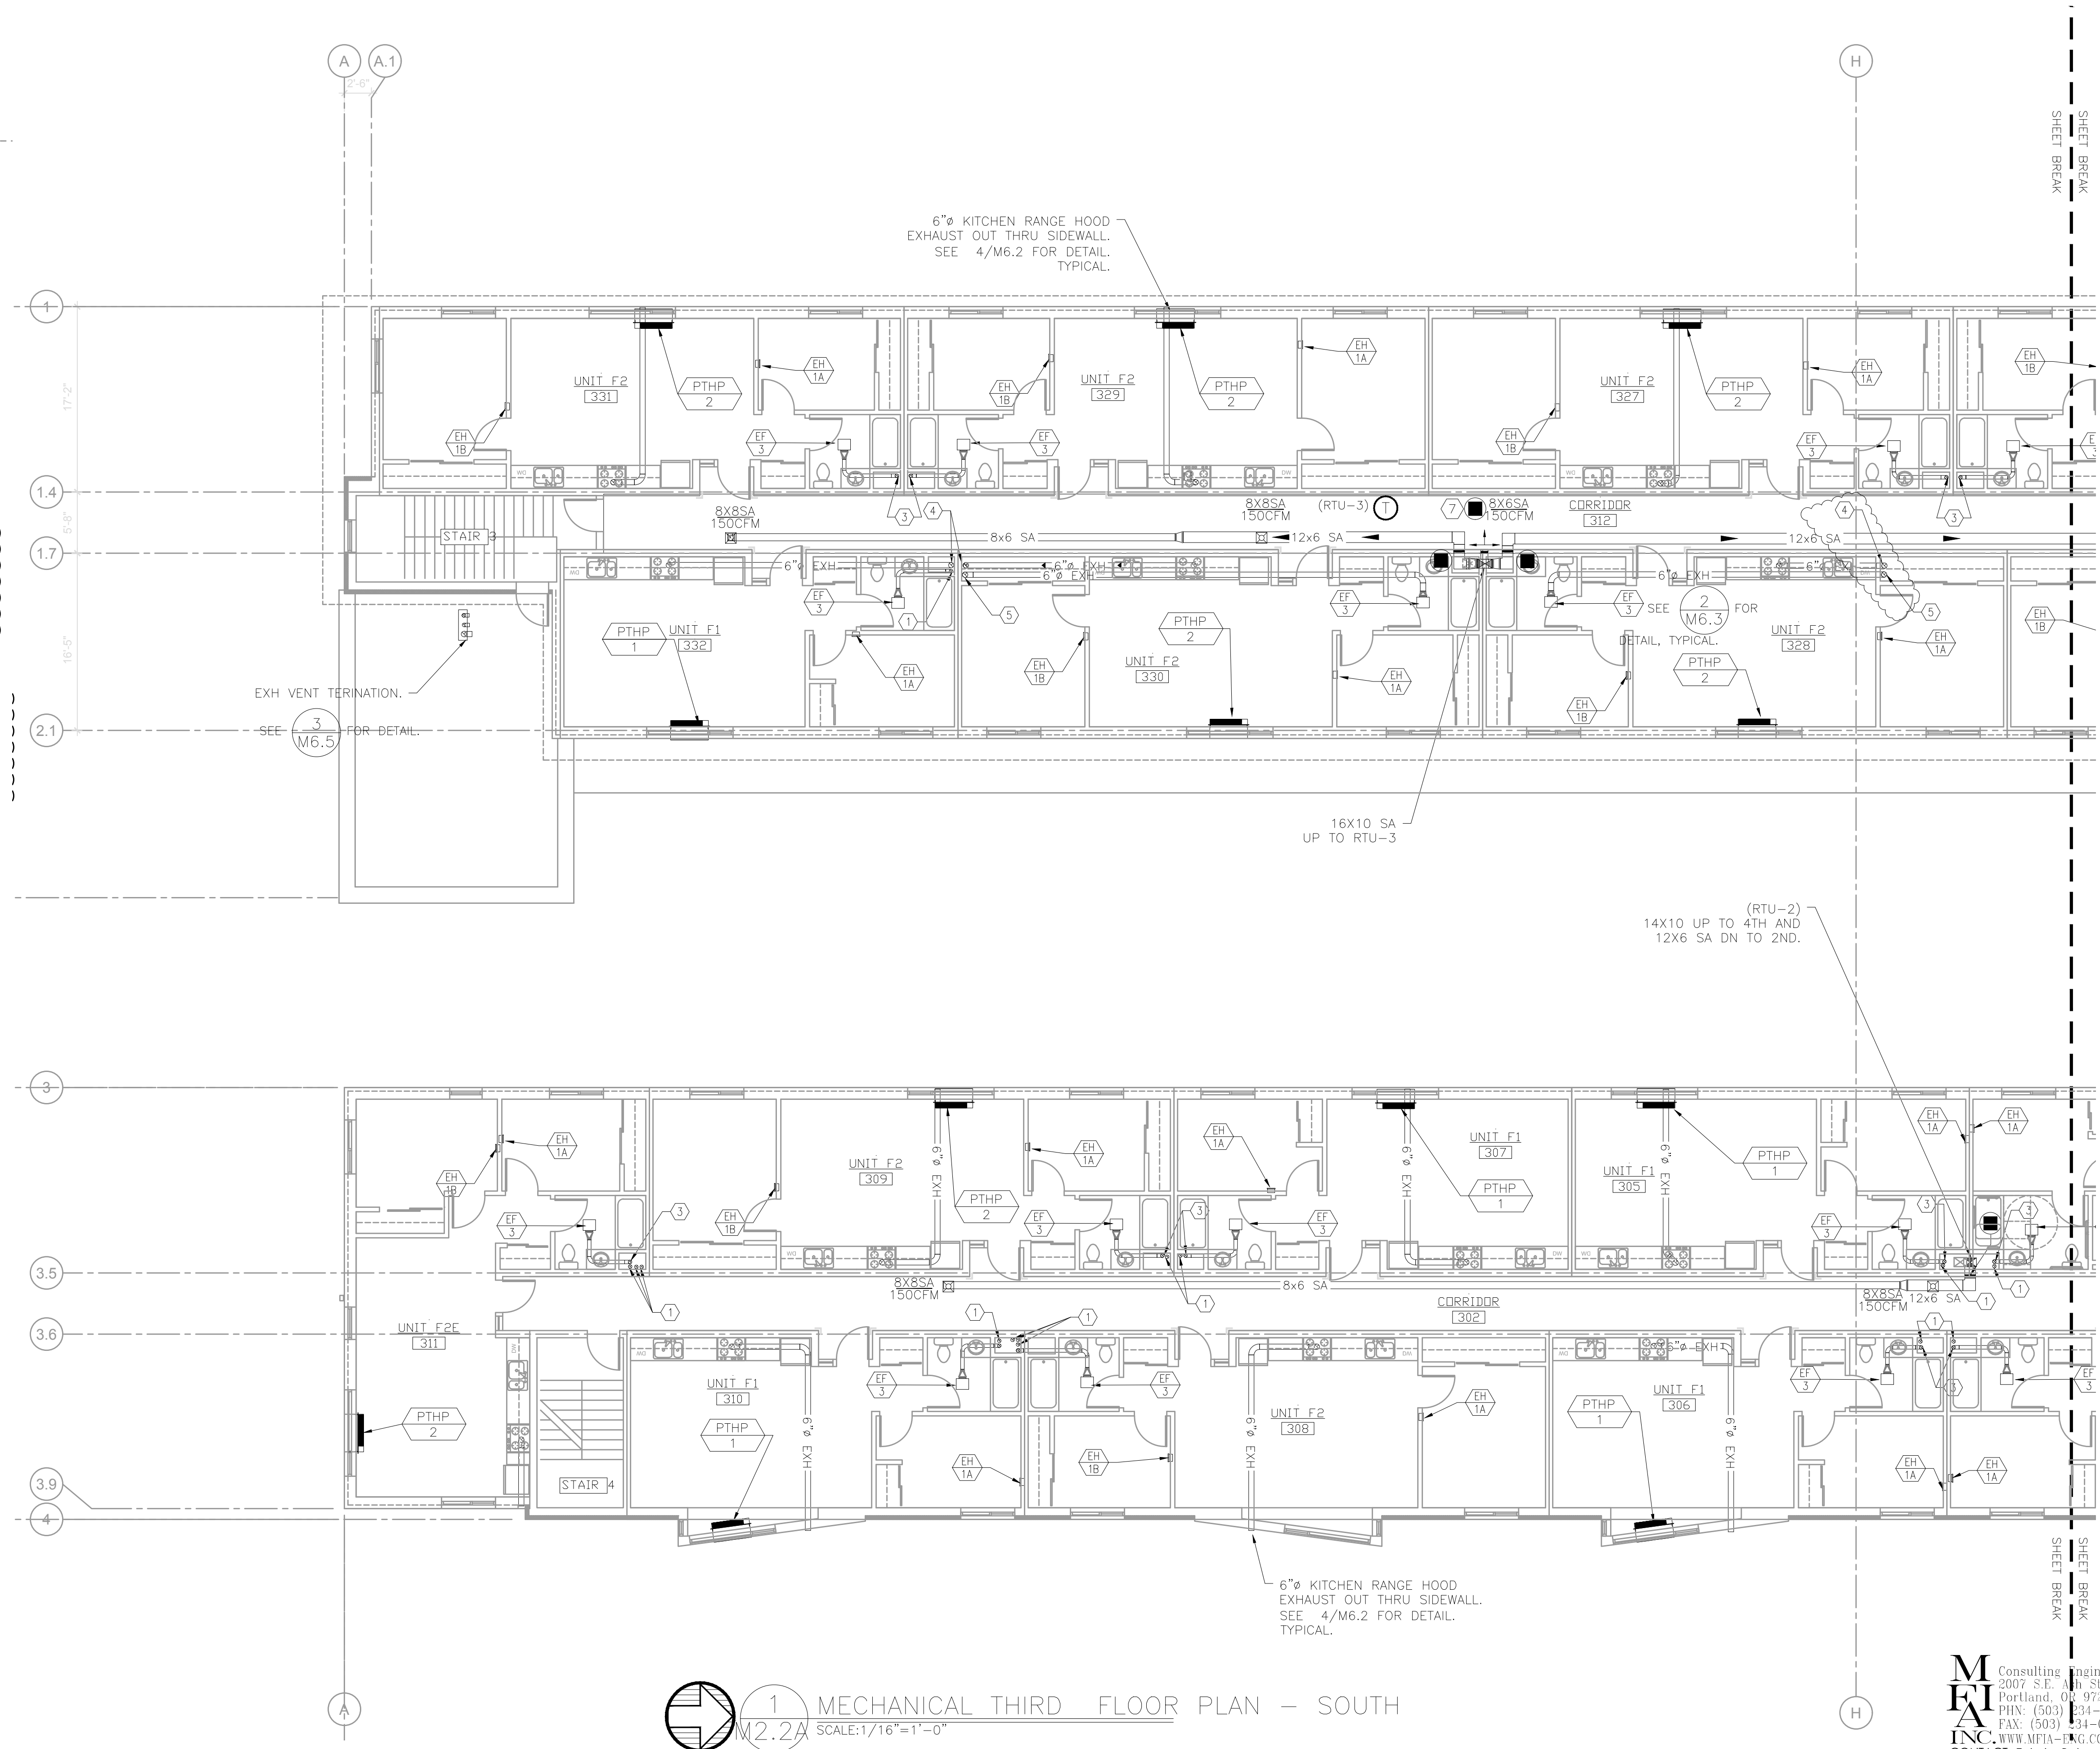

KING+PARKS MULTI-FAMILY RESIDENCES

PROJECT SITE: NE Martin Luther King Jr. Boulevard & N Rosa Parks Way  
OWNER: Portland Community Reinvestment Initiatives Inc. (PCRI)  
6329 NE Martin Luther King Jr. Blvd. Portland, Oregon 97211

PROJECT NO.	ISSUE DATE
16-0602	11.15.2017
REVISIONS	PLAN CHECK RESPONSE
1	07.15.2018

SHEET  
MECHANICAL 3RD  
FLOOR PLANS  
**M2.2A**  
PERMIT SET  
© MERRYMAN BARNES ARCHITECTS, INC.

REGISTERED PROFESSIONAL  
ENGINEER  
TAKAKO BAKER  
JULY 9, 2002  
EXPIRES: 12/31/17

MERRYMAN BARNES ARCHITECTS  
2007 S.E. 11th St.  
Portland, OR 97214  
PHN: (503) 234-0548  
FAX: (503) 234-0677  
CONTACT: Takako Baker