

KING+PARKS MULTI-FAMILY RESIDENCES

PROJECT SITE: NE Martin Luther King Jr. Boulevard & N Rosa Parks Way
OWNER: Portland Community Reinvestment Initiatives Inc. (PCRI)
6329 NE Martin Luther King Jr. Blvd. Portland, Oregon 97211

VBA

PROJECT NO.	ISSUE DATE
16-0602	06.23.2017
REVISIONS	

REVISIONS:

SHEET

MECHANICAL DETAILS


M6.3

NOT FOR CONSTRUCTION


PRICING SET

© MERRYMAN BARNES ARCHITECTS, INC.


4-6-4
CONFIGURATION

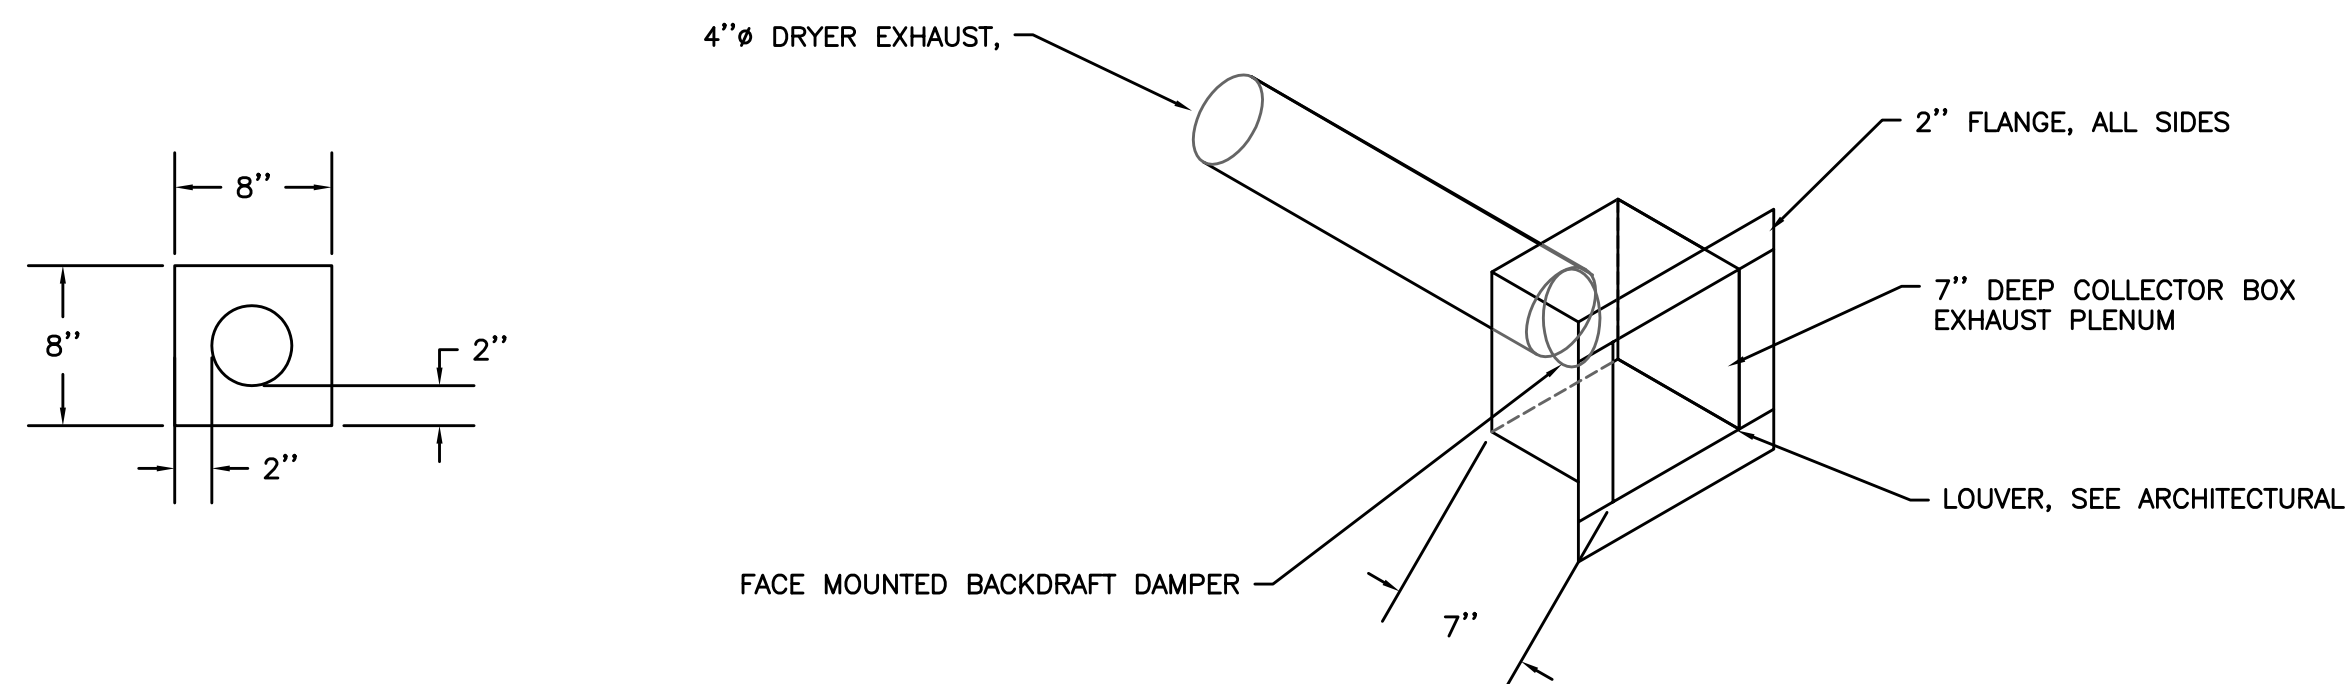


1 SINGLE DRYER VENT
M6.3 NOT TO SCALE

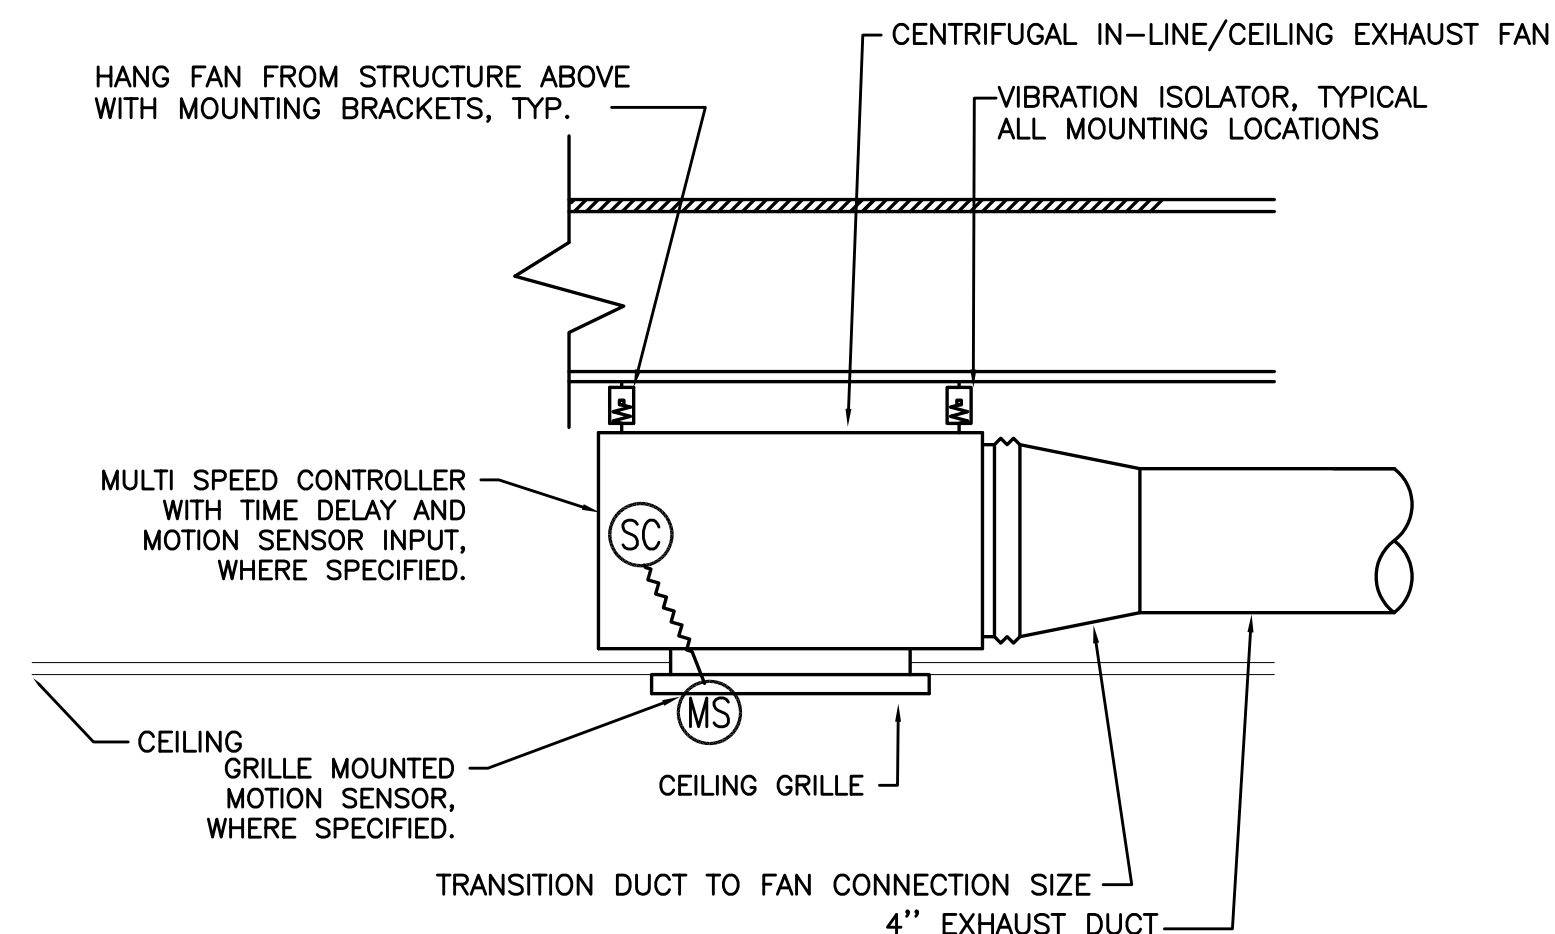


2 RESTROOM EXHAUST FAN
M6.3 SCALE:DETAIL

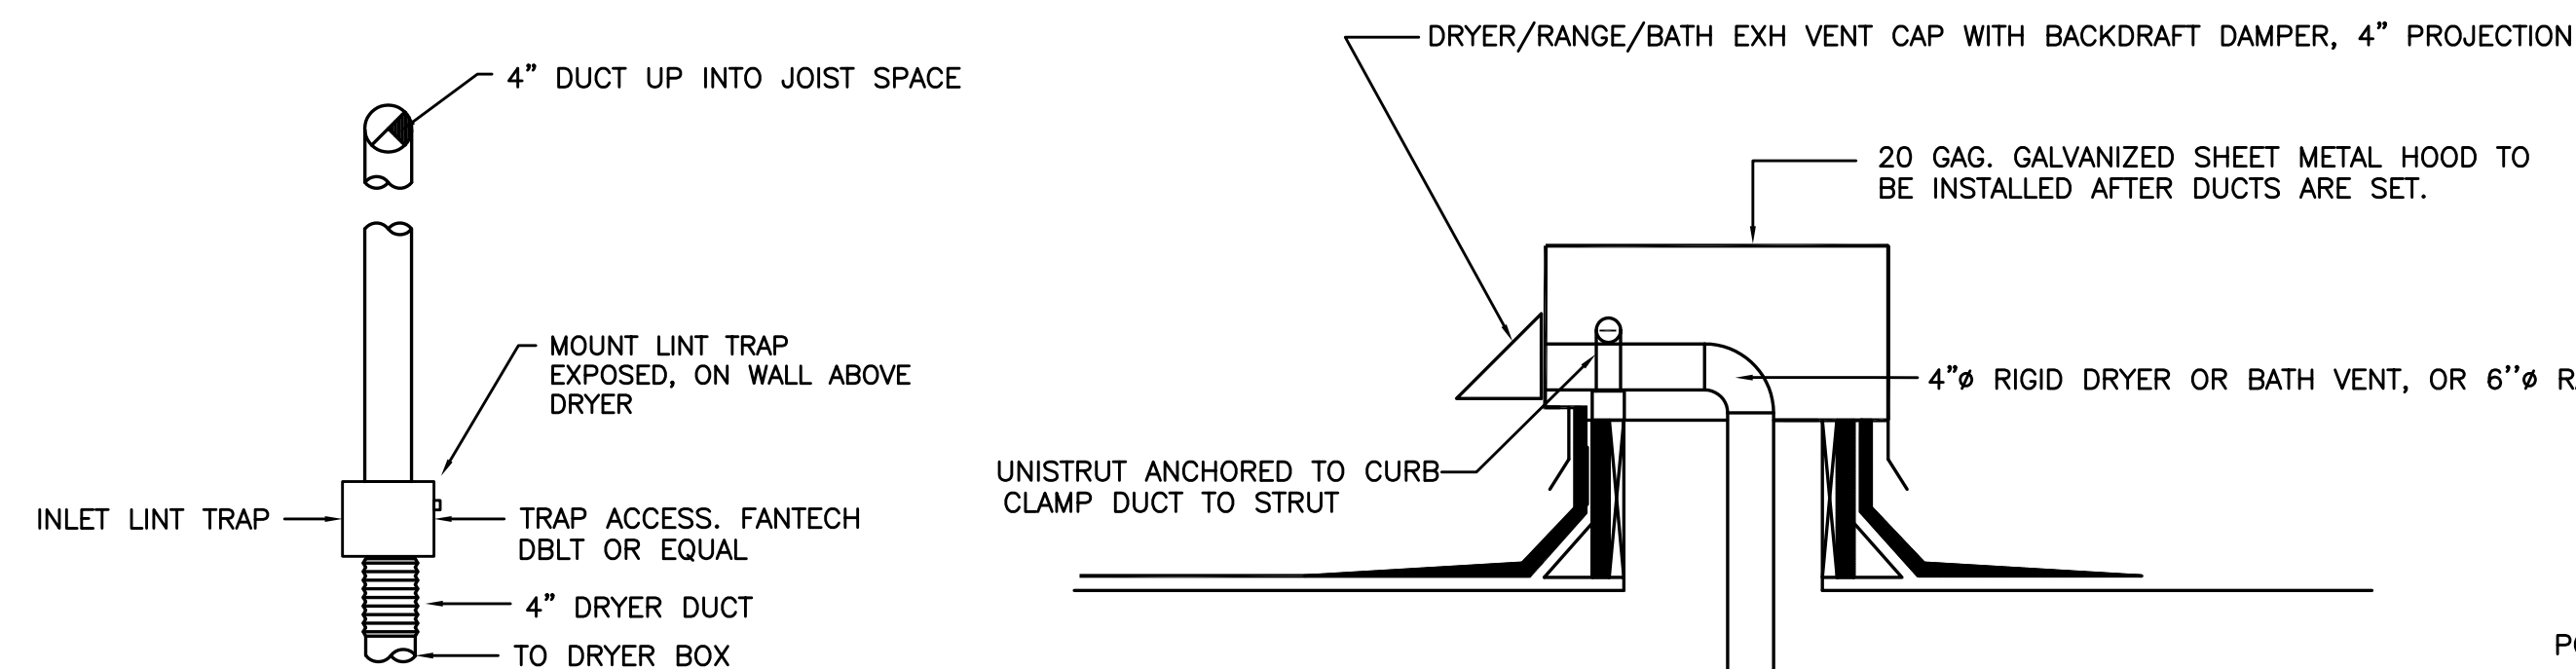

3 LINT TRAP
M6.3 DETAIL

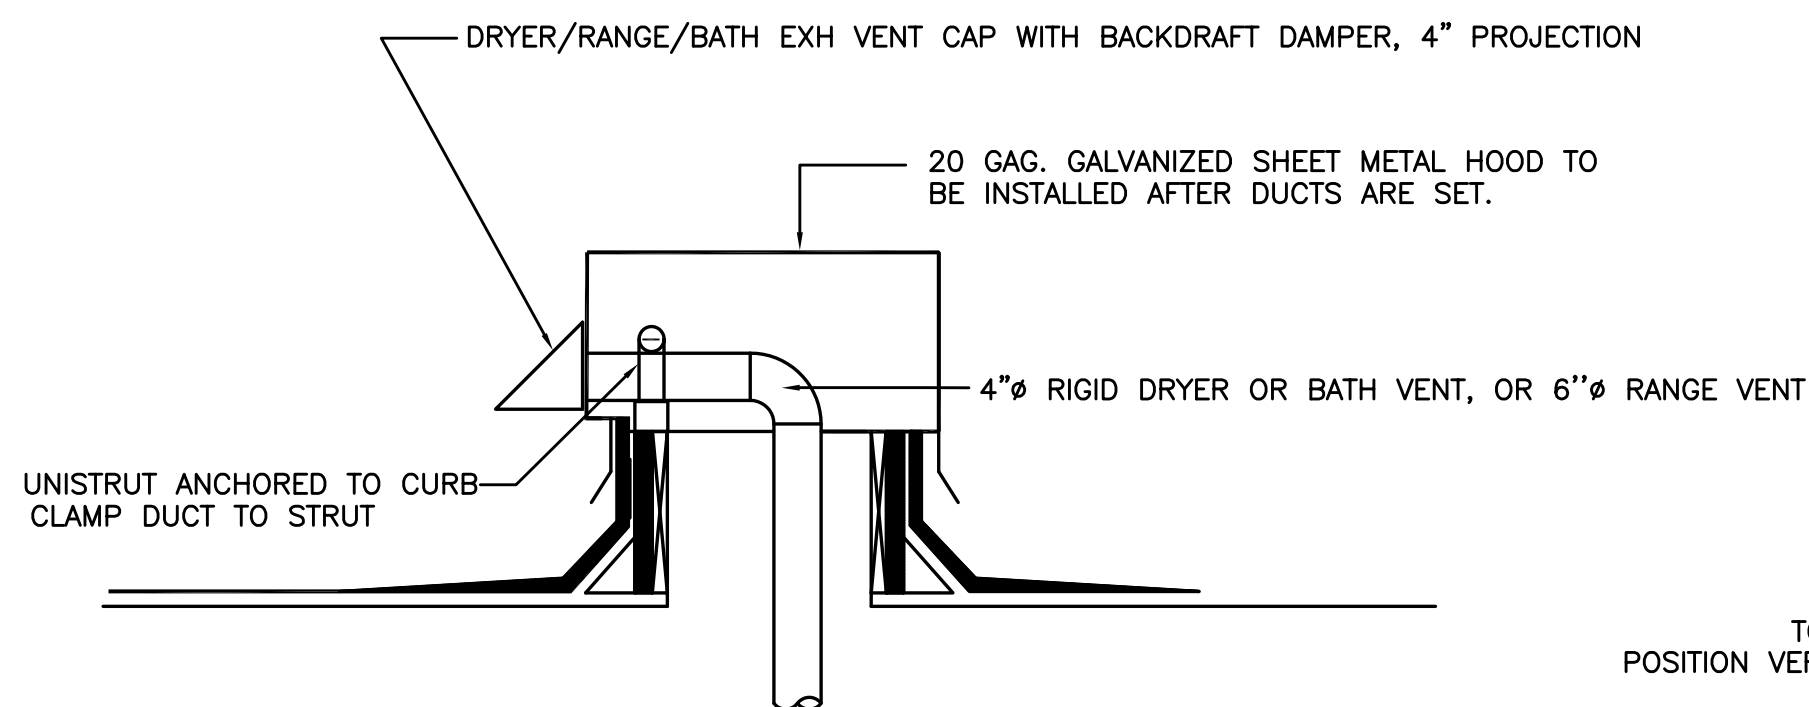

4 TYPICAL ROOFTOP OUTLET HOOD
M6.3 NOT TO SCALE

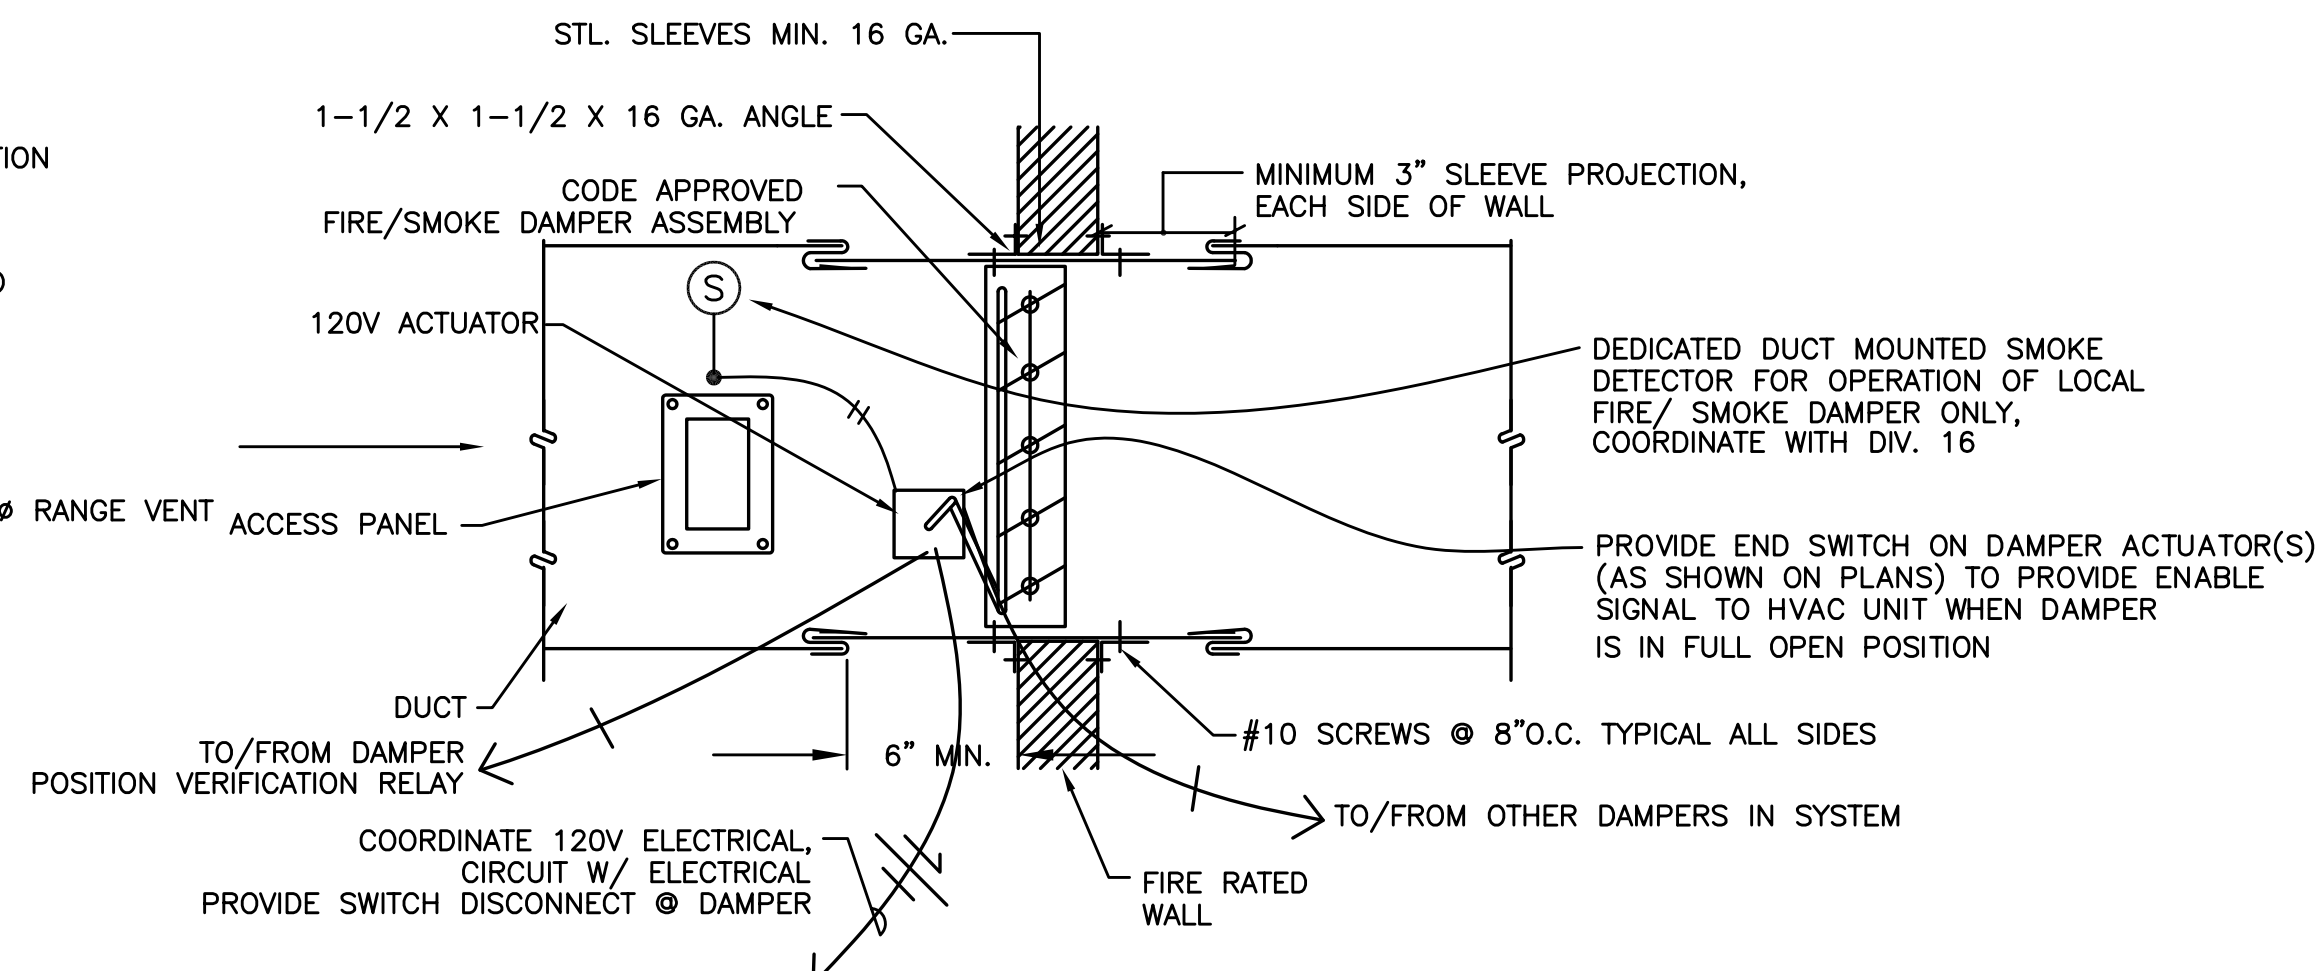

5 FIRE/SMOKE DAMPER W/SMOKE DETECTOR
M6.3 NOT TO SCALE

NOTE:

PROVIDE ALL REQUIRED CONTROL
WIRING TO ACCOMPLISH:

FIRE/SMOKE DAMPER – FIRE/SMOKE
DAMPER TO CLOSE UPON ACTIVATION
OF LOCAL SMOKE DETECTOR


EXHAUST DUCTS/FANS - FIRE/SMOKE
DAMPER TO CLOSE UPON SHUTDOWN OF
ASSOCIATED EXHAUST FAN.

SUPPLY OR RETURN DUCTS/FANS - FIRE/SMOKE
DAMPER TO CLOSE UPON SHUTDOWN OF
ASSOCIATED AIR HANDLING UNIT.

GENERAL NOTES:

PROVIDE ACCESS IN CEILING OR WALL FOR
DAMPER AND SMOKE DETECTOR

SEE ELECTRICAL DRAWINGS
FOR WIRING INSTALLATION

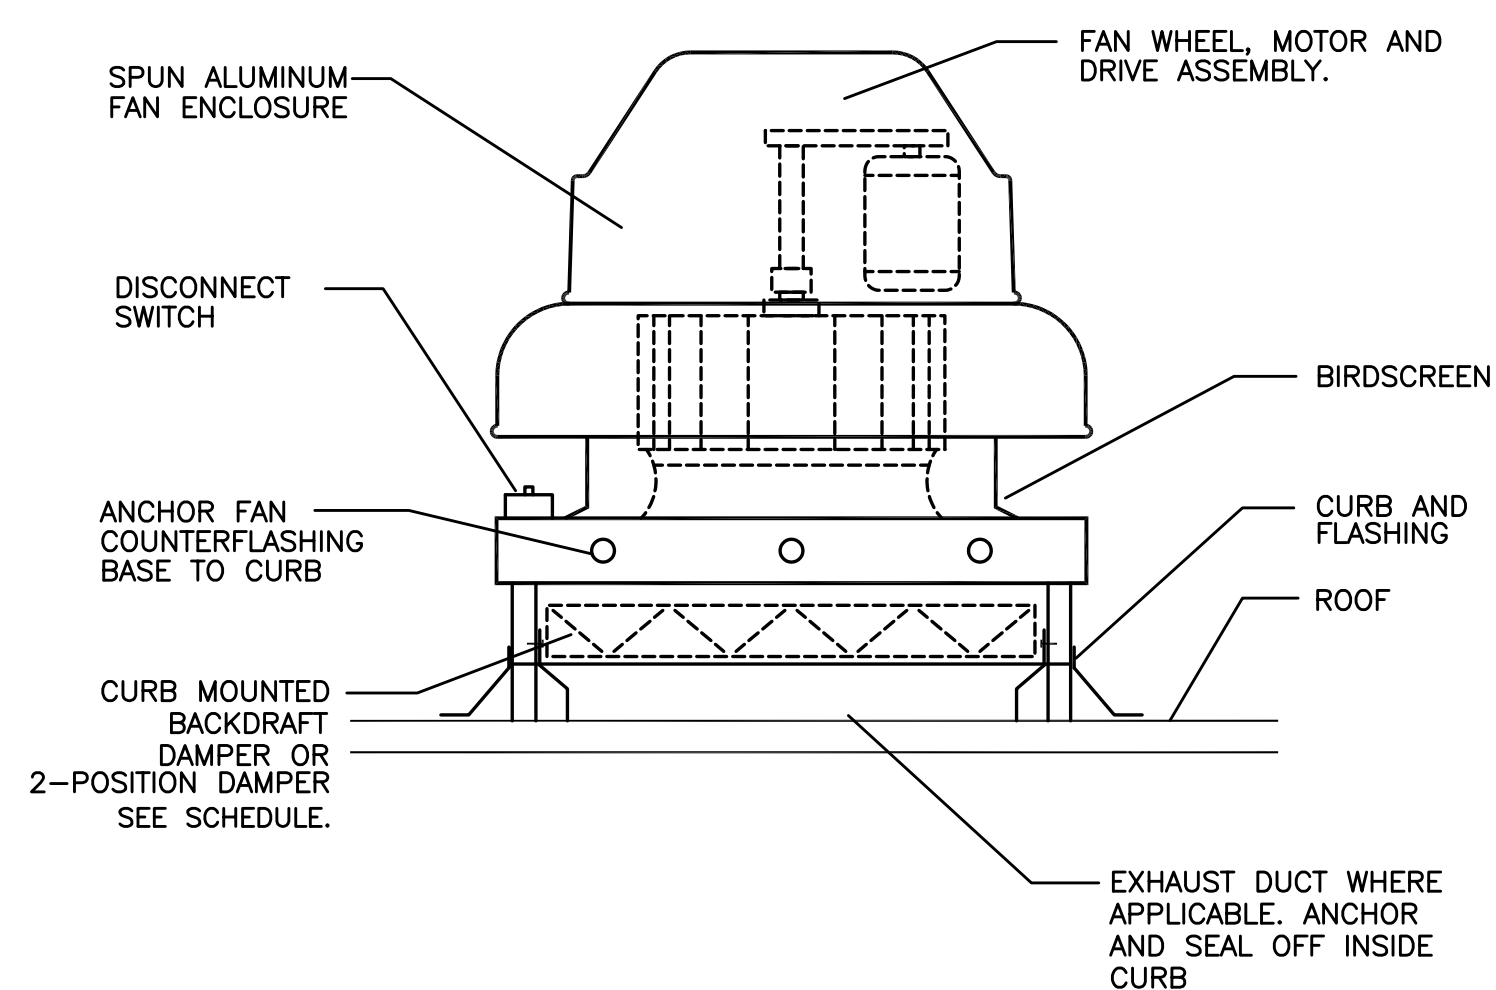

6 EXHAUST FAN
M6.3 DETAIL

MEIA
INC.
Consulting Engineers
2007 S.E. Ash St.
Portland, OR 97214
PHN: (503) 234-0548
FAX: (503) 234-0677
WWW.MEIA-ENG.COM
CONTACT: Takako Baker

MEIA
INC.
Consulting Engineers
2007 S.E. Ash St.
Portland, OR 97214
PHN: (503) 234-0548
FAX: (503) 234-0677
WWW.MEIA-ENG.COM
CONTACT: Takako Baker