


3 UNIT TYPE 'I' - TELCOM
T4.14 SCALE: 1/4" = 1'-0"

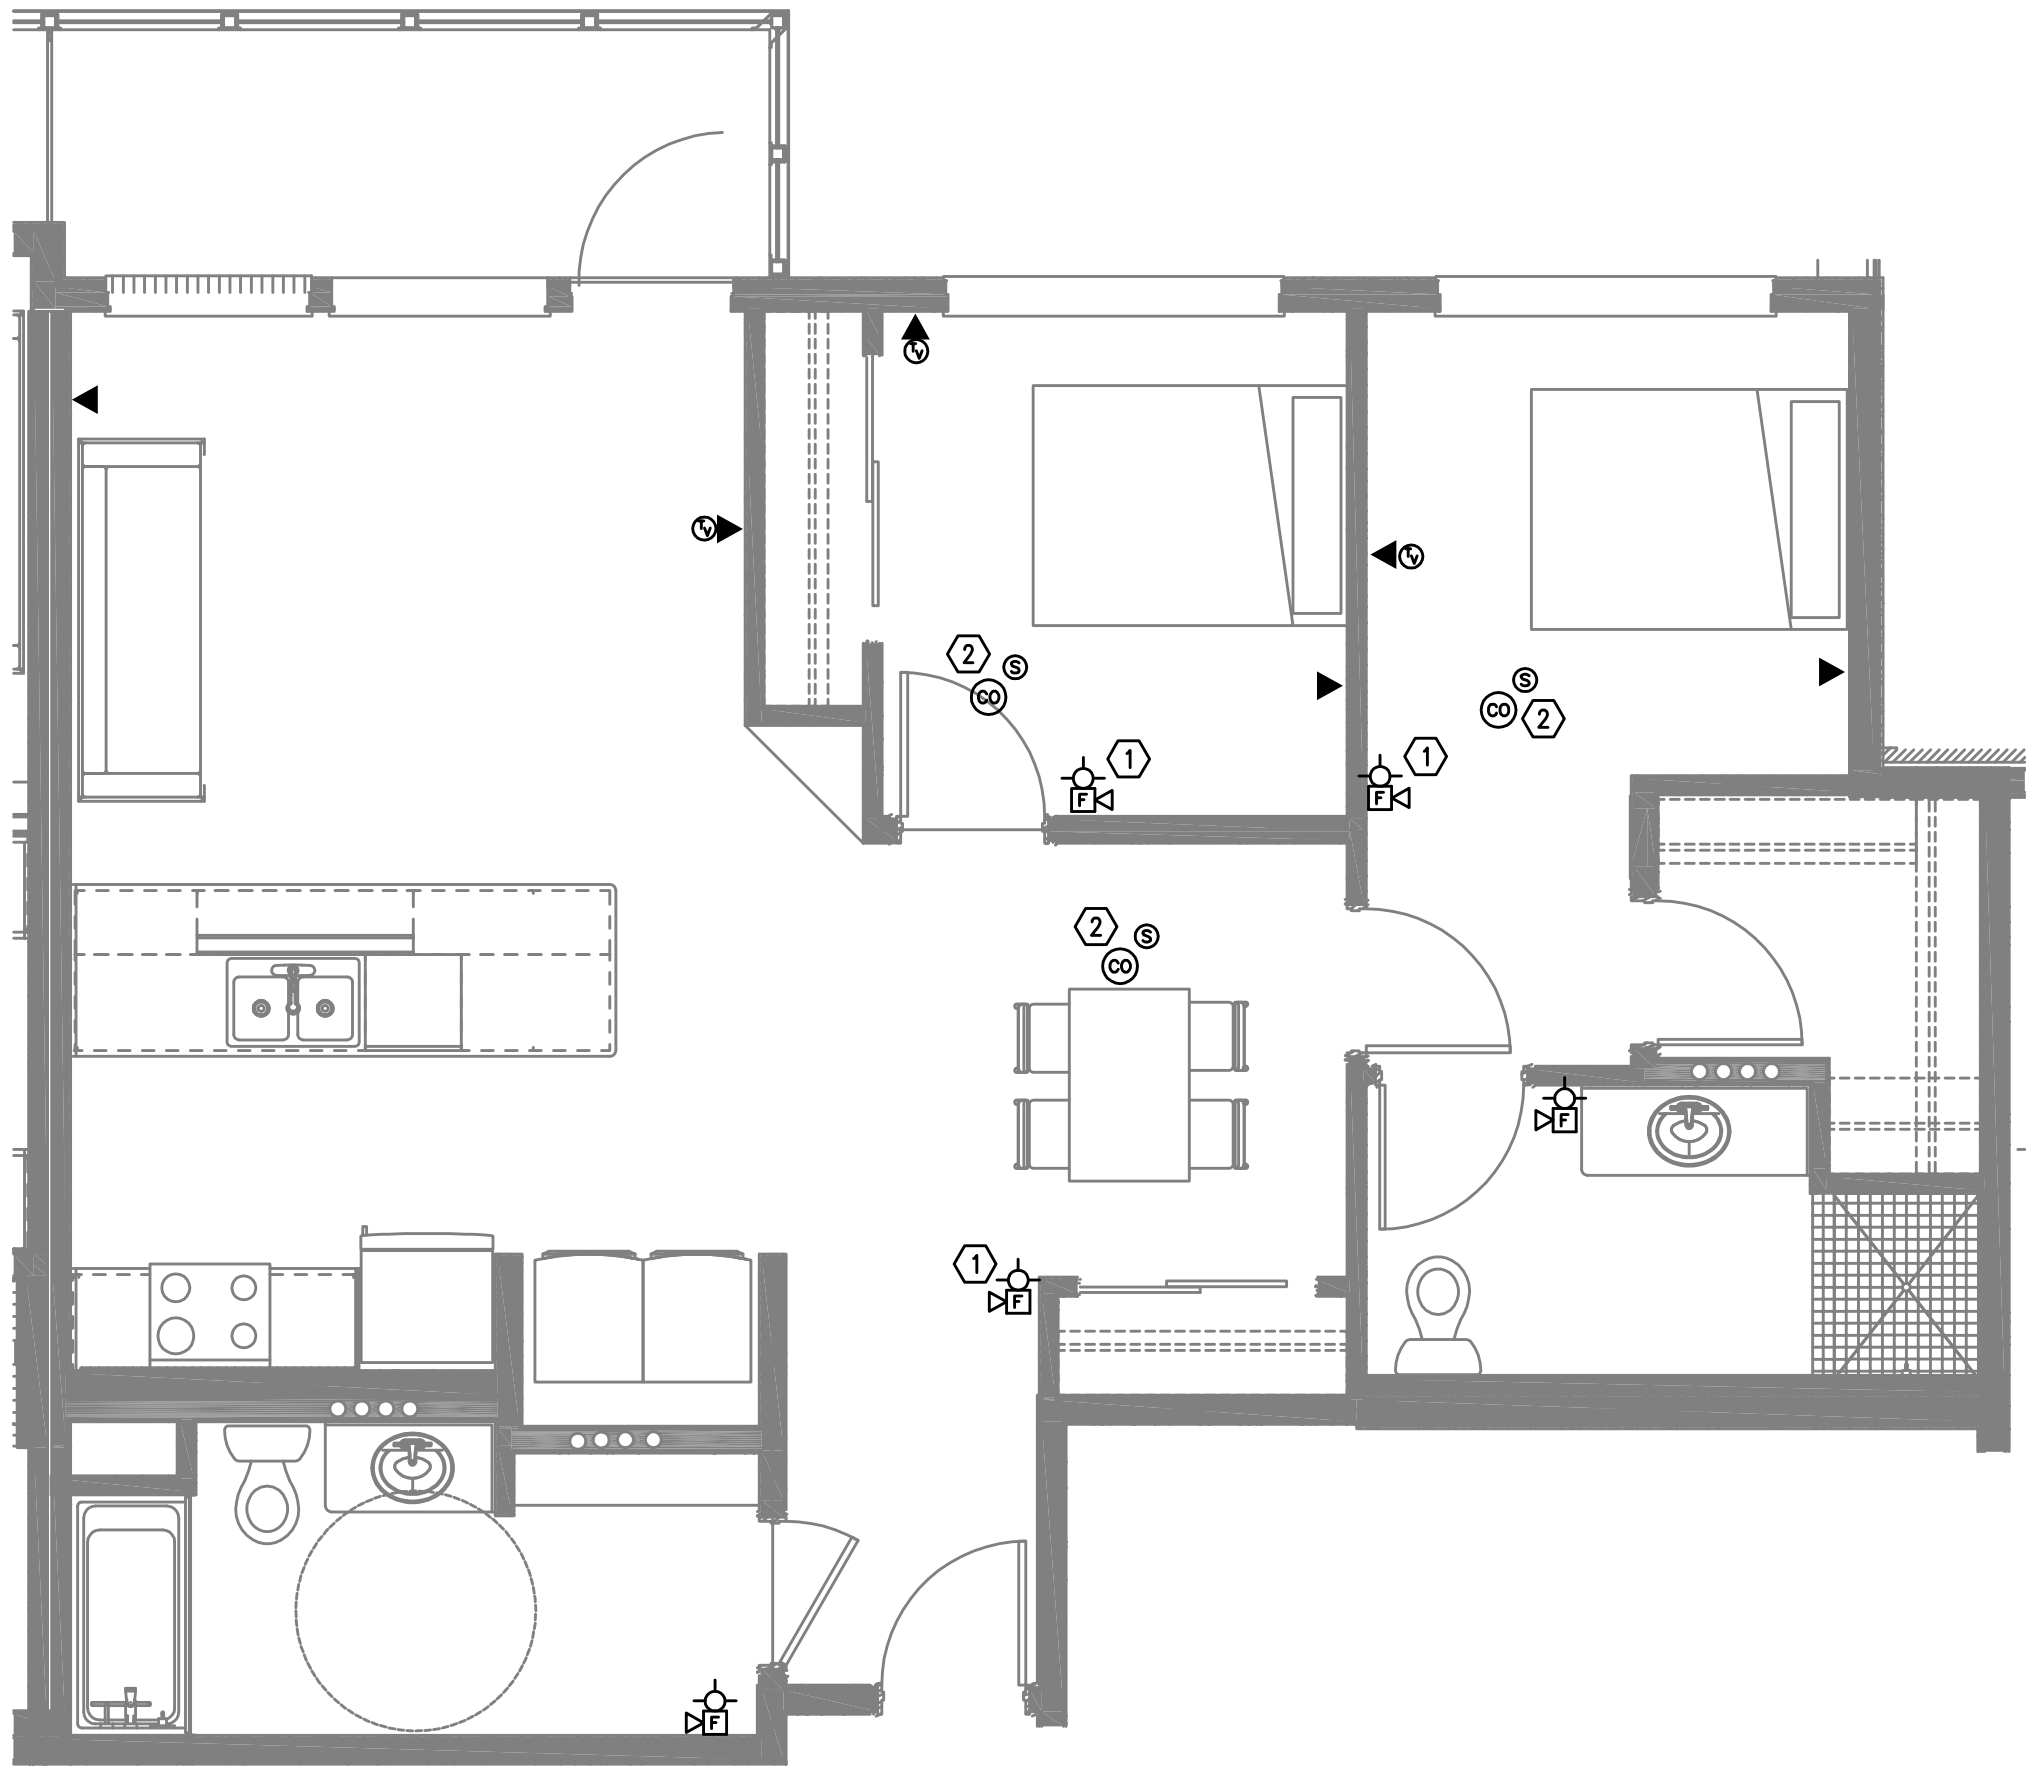

3 UNIT TYPE 'I-ADA' - TELCOM
T4.14 SCALE: 1/4" = 1'-0"

NOTES:

1. DEVICE IS CONNECTED TO BUILDING FIRE ALARM SYSTEM.
2. DEVICES INSTALLED PER RESIDENTIAL DETECTION CODE.

FIRE ALARM AND DETECTION SYSTEM SHOWN ON PLAN(S) ARE FOR DESIGN INTENT ONLY. THIS IS A DEFERRED SUBMITTAL SYSTEM REQUIRING THE CONTRACTOR TO COMPLETE THE PERMIT READY DESIGN AND CALCULATIONS AS REQUIRED PER THE AUTHORITY HAVING JURISDICTION. VERIFY BUILDING OCCUPANCY TYPE AND OCCUPANT LOAD WITH ARCHITECTURAL PLANS.

M
F
E
A
INC. Consulting Engineers
2007 S.E. Ash St.
Portland, OR 97214
PH: (503) 234-0548
FAX: (503) 234-0877
WWW.MFIA-ENG.COM
CONTACT: GARY ADOVNIK

REVISIONS