

IN THE EVENT CONFLICTS ARE DISCOVERED
BETWEEN THE ORIGINAL SIGNED AND SEALED
DOCUMENTS PREPARED BY THE ARCHITECTS
AND/OR THEIR CONSULTANTS, AND ANY COPY OF
THE DOCUMENTS TRANSMITTED BY MAIL, FAX,
ELECTRONICALLY OR OTHERWISE, THE ORIGINAL
SIGNED AND SEALED DOCUMENTS SHALL GOVERN.

PROJECT # 2017-110

DATE: 06/16/2021

PERMIT SET


REVISIONS

GENERAL NOTES:


- ALL PLANS ARE DIAGRAMMATICAL. CONSULT ARCHITECTURAL PLANS FOR EXACT LOCATION OF ALL DEVICES AND FIXTURES.
- REFER TO SHEET E1.14 FOR TYPICAL UNIT LOAD CENTER DIRECTORIES.
- ALL LIGHT SWITCHES SHALL BE DIMMER STYLE, SUCH AS LEVITON DECORA, OR APPROVED EQUAL, UNLESS OTHERWISE NOTED.
- REFER TO ARCHITECTURAL REFLECTED CEILING PLANS FOR EXACT FIXTURE LOCATIONS AND MOUNTING HEIGHTS.

KEYED NOTES:


- REFER TO TYPICAL BATHROOM SWITCHING DETAILS ON SHEET E1.22.
- LOCATE SWITCH FOR SINK LIGHT IN CABINET FALSE FRONT.
- REFER TO ARCHITECTURAL INTERIOR ELEVATIONS FOR LOCATION AND MOUNTING OF UNDER CABINET LIGHTS.
- SWITCHING FOR CEILING FAN SHALL BE MANUFACTURER'S RECOMMENDATION FOR LIGHT AND FAN CONTROL.
- PROVIDE BLOCKING AT CEILING TO SUPPORT 35LB. MINIMUM, FOR CEILING FAN INSTALLATION. REFER TO MANUFACTURER'S INSTALLATION INSTRUCTIONS FOR ADDITIONAL INFORMATION AND REQUIREMENTS.
- TO SWITCHED RECEPTACLE IN LIVING ROOM. REFER TO E4.1 SERIES SHEETS FOR LOCATION.

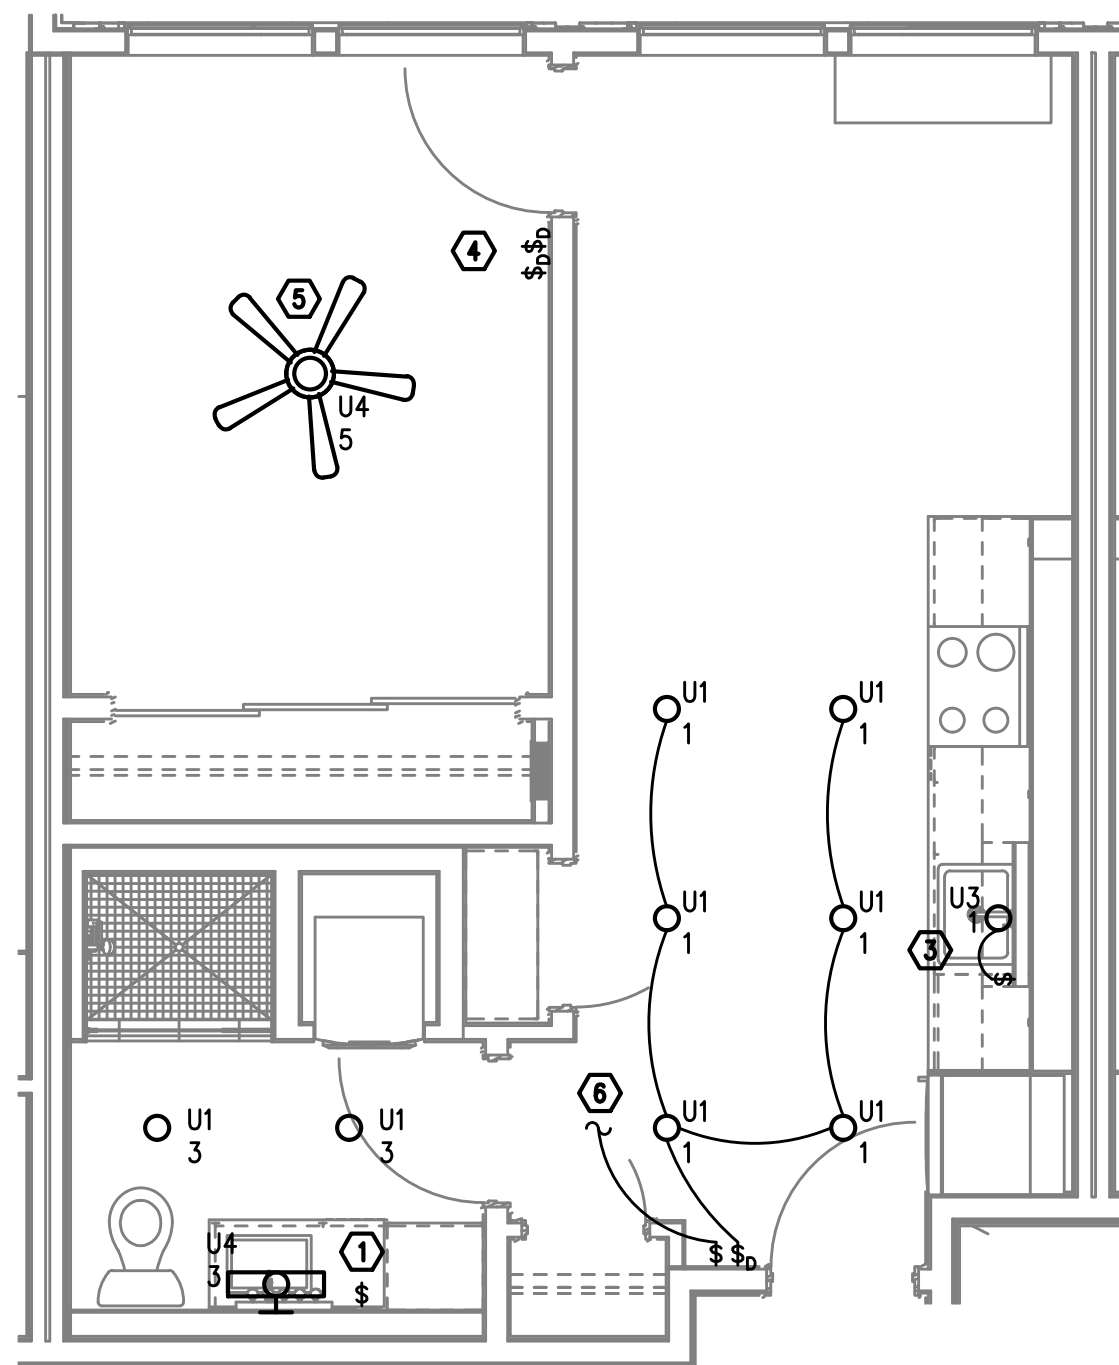


1 UNIT TYPE 'A' - LIGHTING PLAN
E4.01 1/4" = 1'-0"

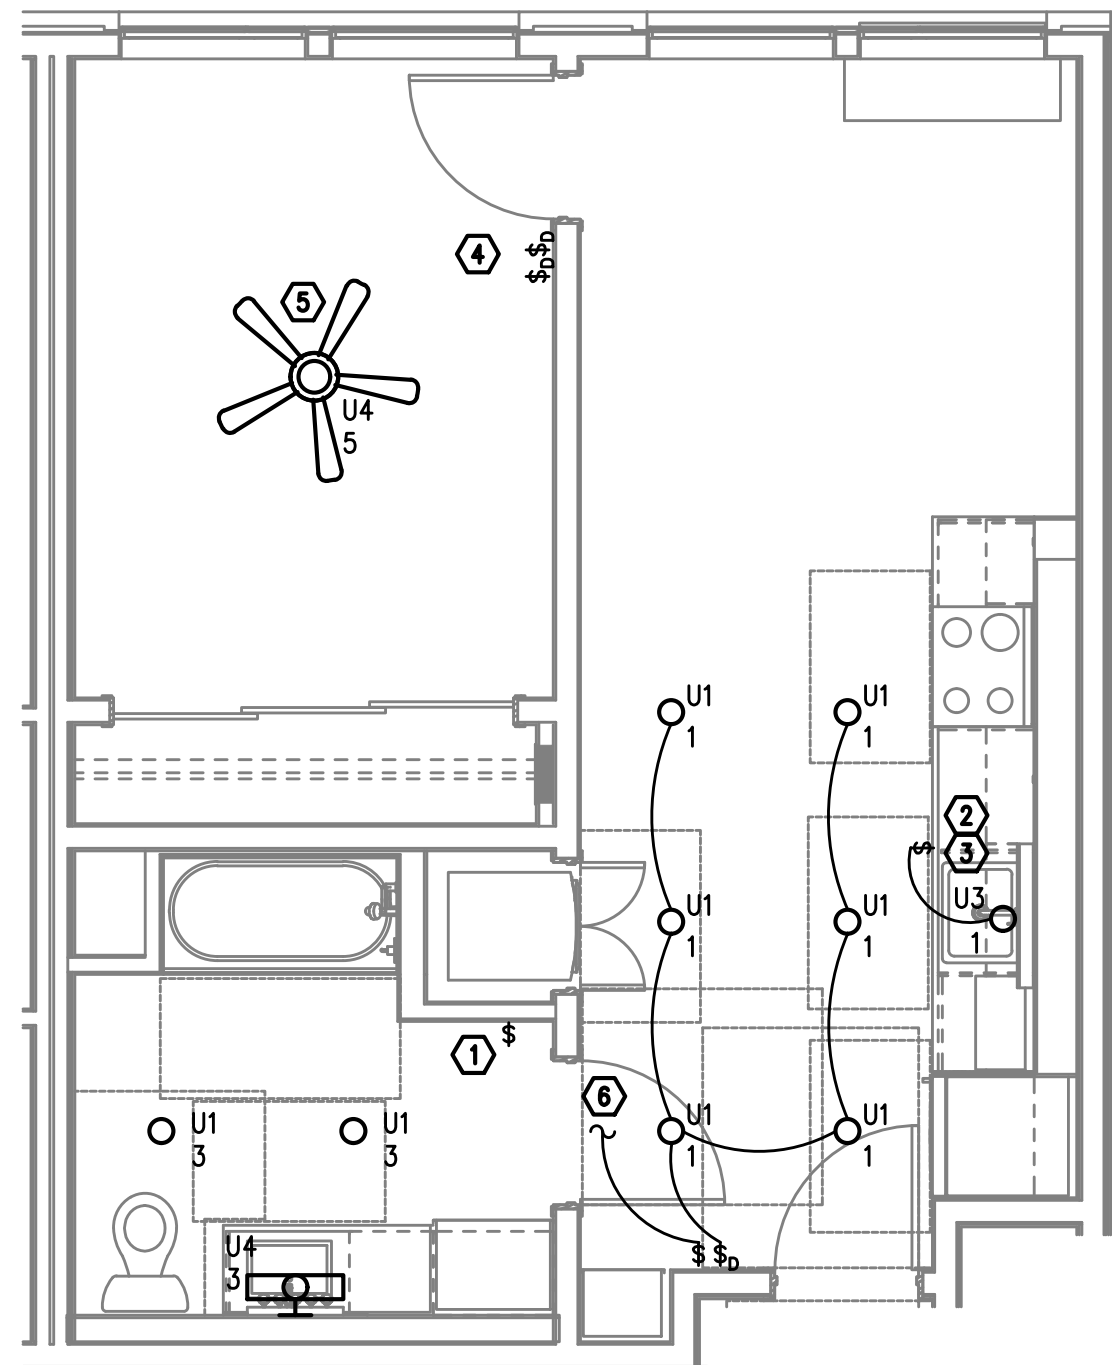


2 ACCESSIBLE
UNIT TYPE 'A' - LIGHTING PLAN
E4.01 1/4" = 1'-0"

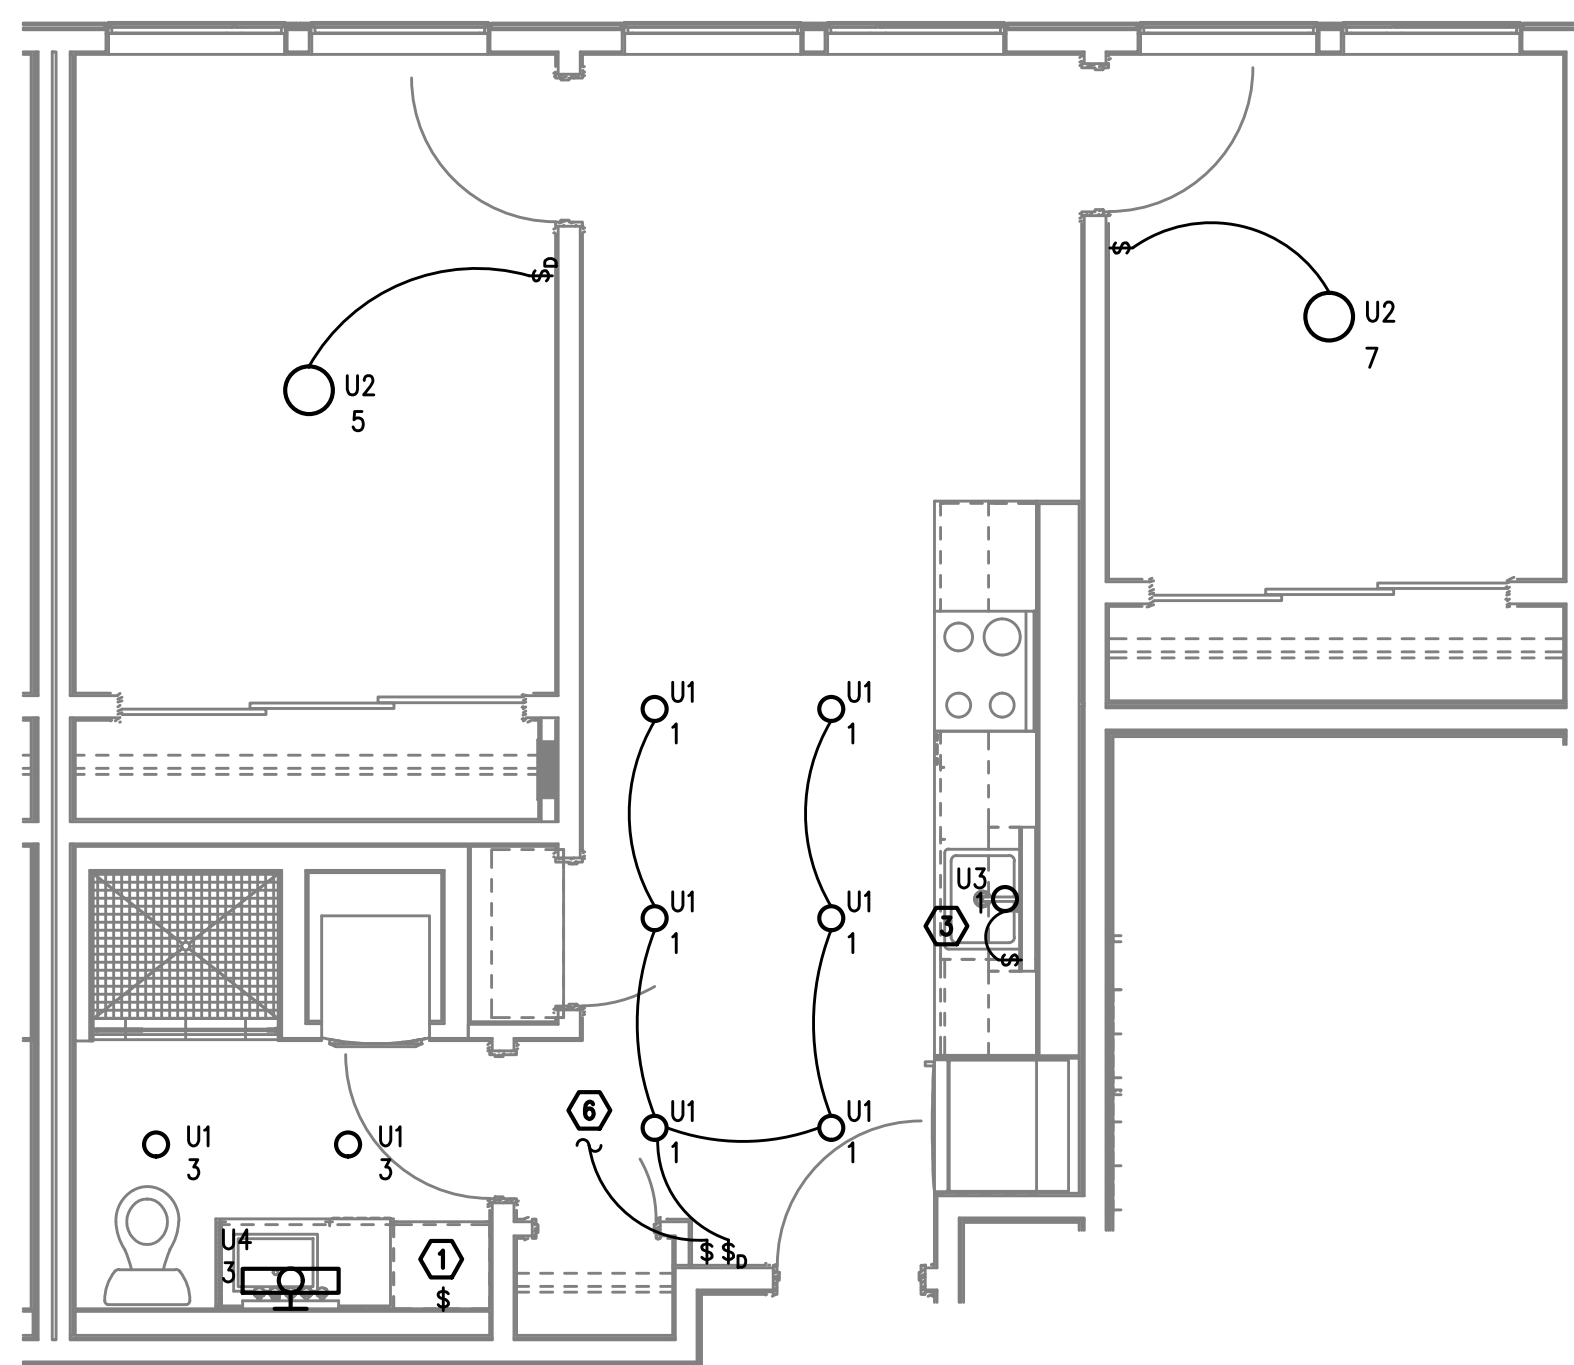

3 UNIT TYPE 'B' - LIGHTING PLAN
E4.01 1/4" = 1'-0"

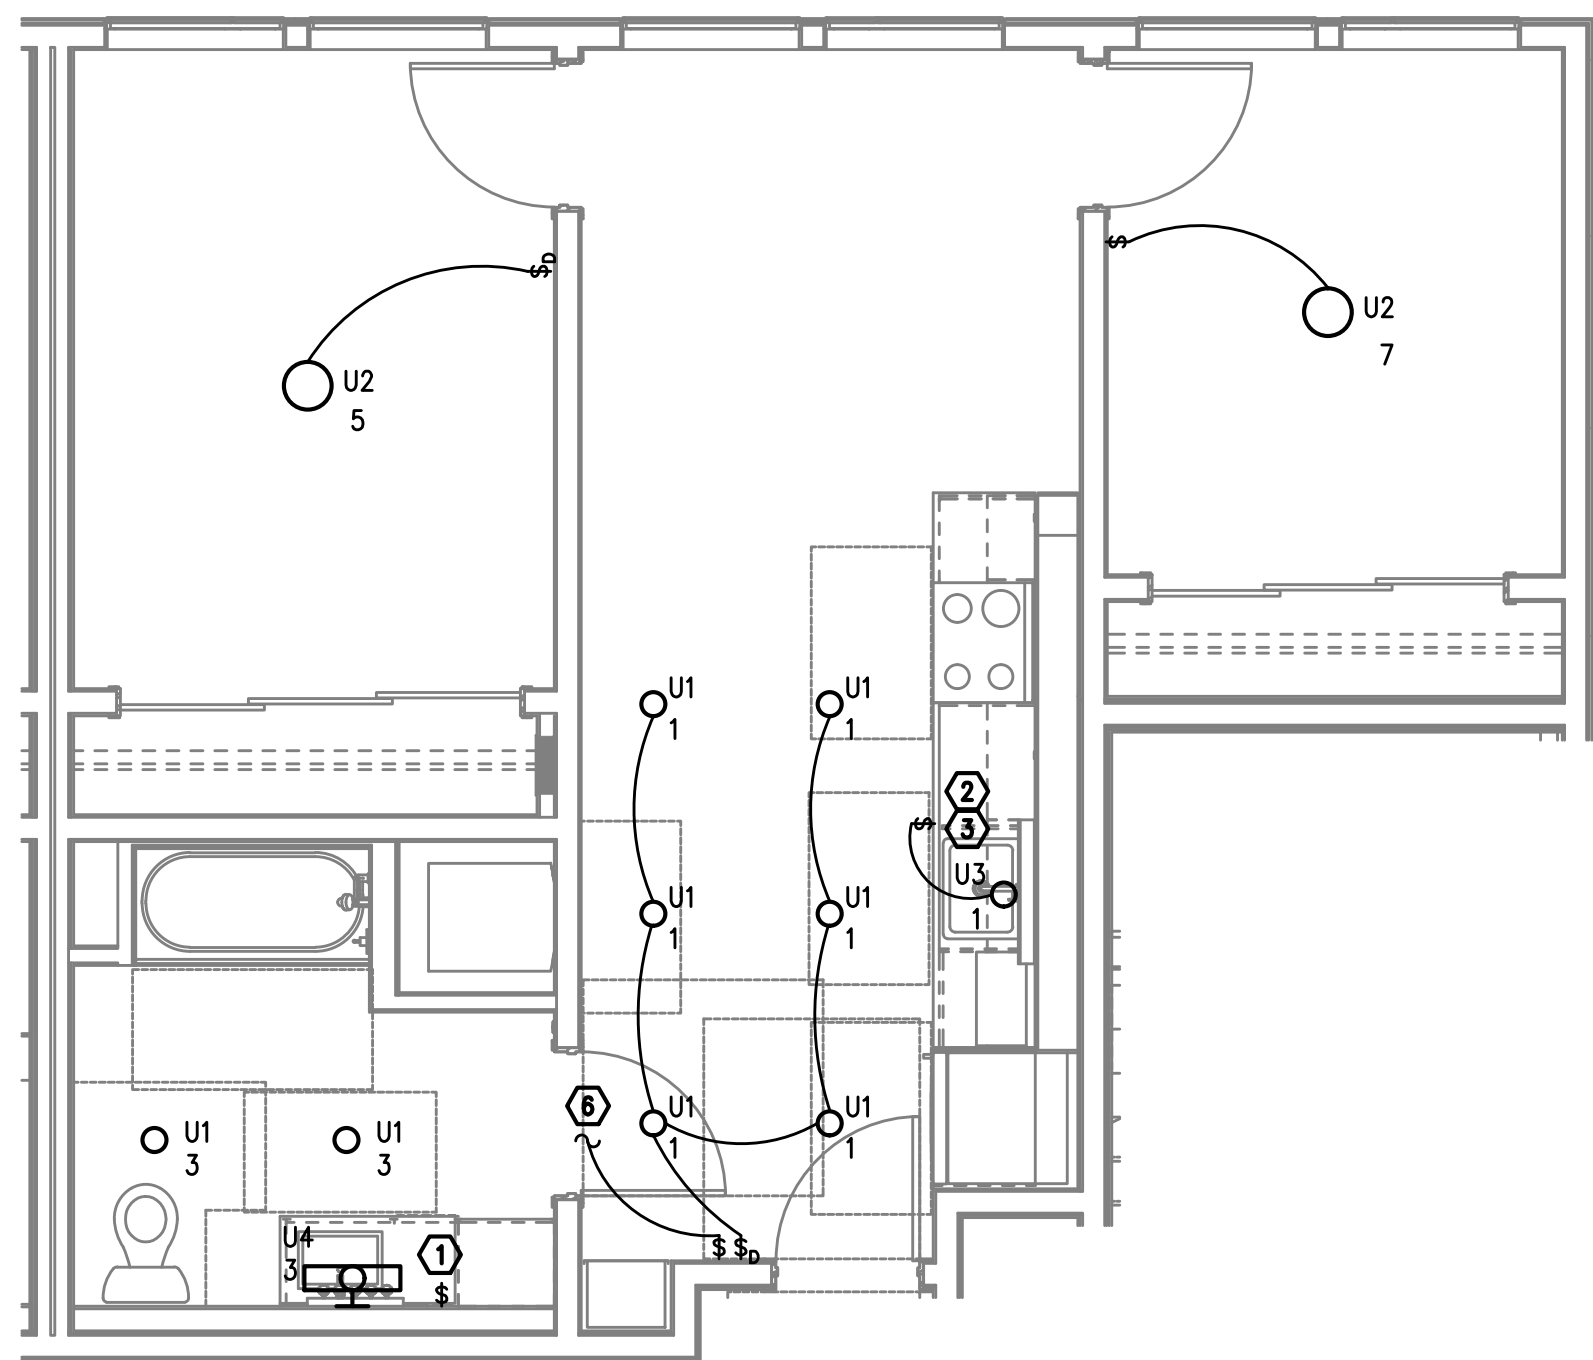

4 ACCESSIBLE
UNIT TYPE 'B' - LIGHTING PLAN
E4.01 1/4" = 1'-0"

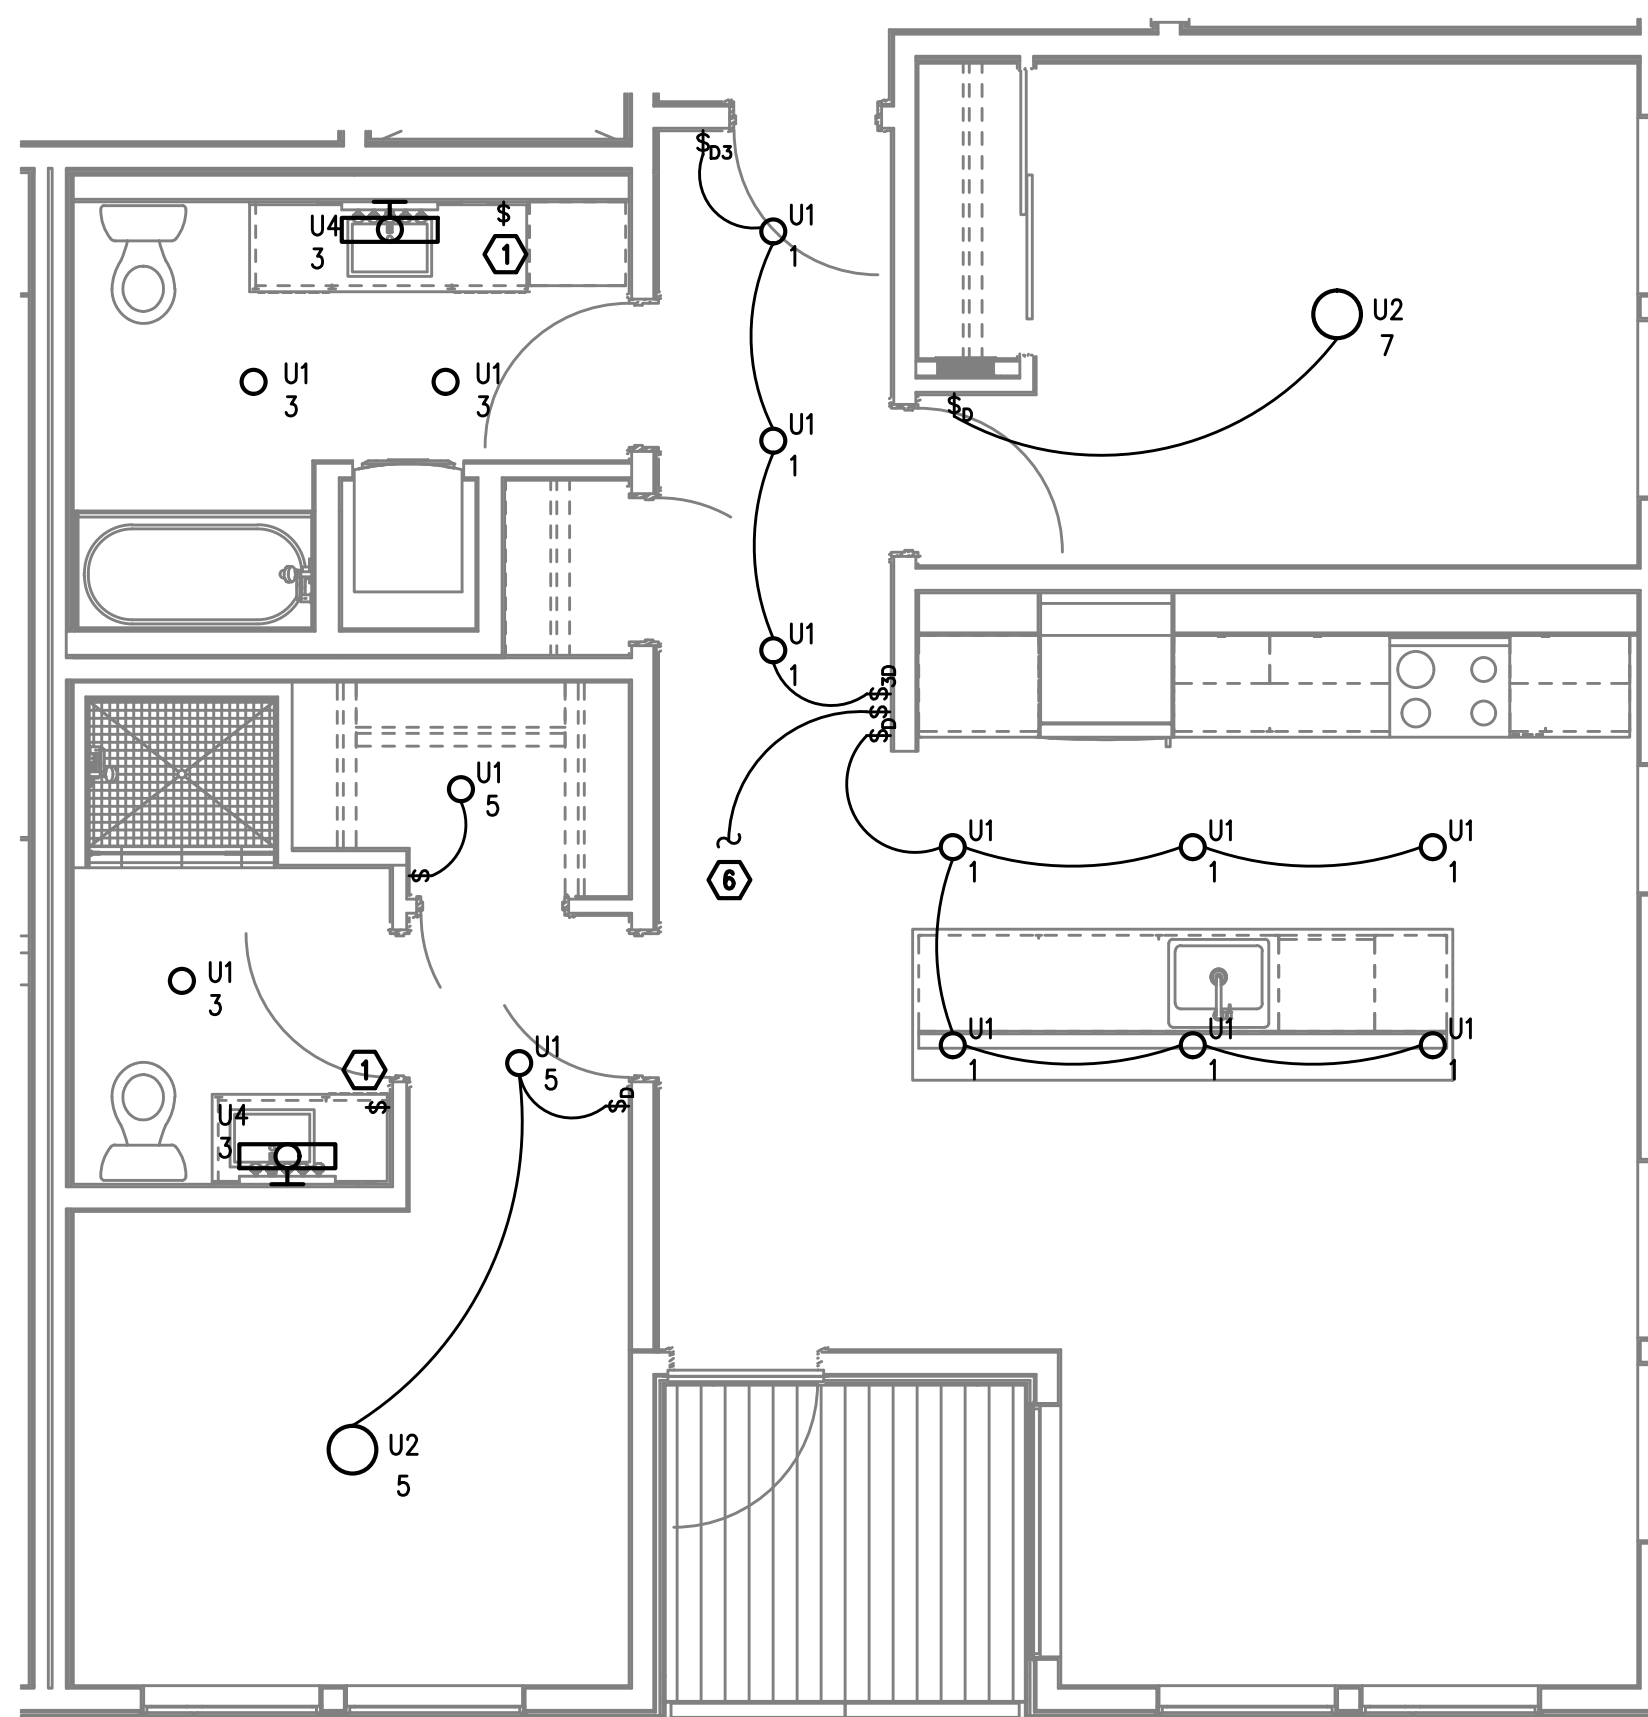

5 UNIT TYPE 'C' - LIGHTING PLAN
E4.01 1/4" = 1'-0"

M
F
A
Consulting Engineers
2007 S.E. Ash St.
Portland, OR 97214
PH: (503) 234-0648
FAX: (503) 234-0677
INC. WWW.MFIA-ENG.COM
CONTACT: DENISE TAYLOR

SHEET:

E4.01

ENLARGED UNIT LIGHTING PLANS