


GENERAL NOTES:


- A. DRAWINGS ARE DIAGRAMMATICAL AND MAY NOT ACCURATELY REFLECT ACTUAL CONSTRUCTION CONDITIONS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING THE INSTALLATION OF ALL EQUIPMENT THEY ARE INSTALLING, WITH ALL TRADES PRIOR TO AND DURING CONSTRUCTION.
- B. FOR VOICE/DATA OUTLETS PROVIDE A SINGLE GANG MUD-RING OUTLET SHALL BE AT THE SAME HEIGHT AS ADJACENT POWER OUTLET AND LESS THAN 18" SEPARATION. COORDINATE WITH ELECTRICAL.
- C. COORDINATE ALL DEVICE LOCATIONS WITH LATEST ARCHITECTURAL INTERIOR ELEVATIONS TO VERIFY DEVICES WILL NOT BE OBSTRUCTED.
- D. PROVIDE PULL STRING IN ALL CONDUITS FOR LATER USE.
- E. ALL PENETRATIONS THROUGH FIREWALLS WILL NEED FIRESTOP OF THE APPROPRIATE RATING.

KEYED NOTES:


1. SMART PANEL FOR UTILITY DEMARCATION WITHIN UNIT. PROVIDE 42" RF TRANSPARENT PANEL.
2. SMOKE AND CO DETECTOR CAN BE A SINGLE UNIT.
3. (1) COAXIAL AND (1) CATEGORY CABLES AND OUTLETS PER FACEPLATE.
4. PROVIDE 3-CONDUCTOR, 20AWG SHIELDED CABLE FROM WATER METER TO THE ELEC OR IDF SPACE ON THE ASSOCIATED FLOOR.
5. PROVIDE 'ADA' COMPLAINT DEVICES FOR SMOKE DETECTORS AND ANNUNCIATORS.

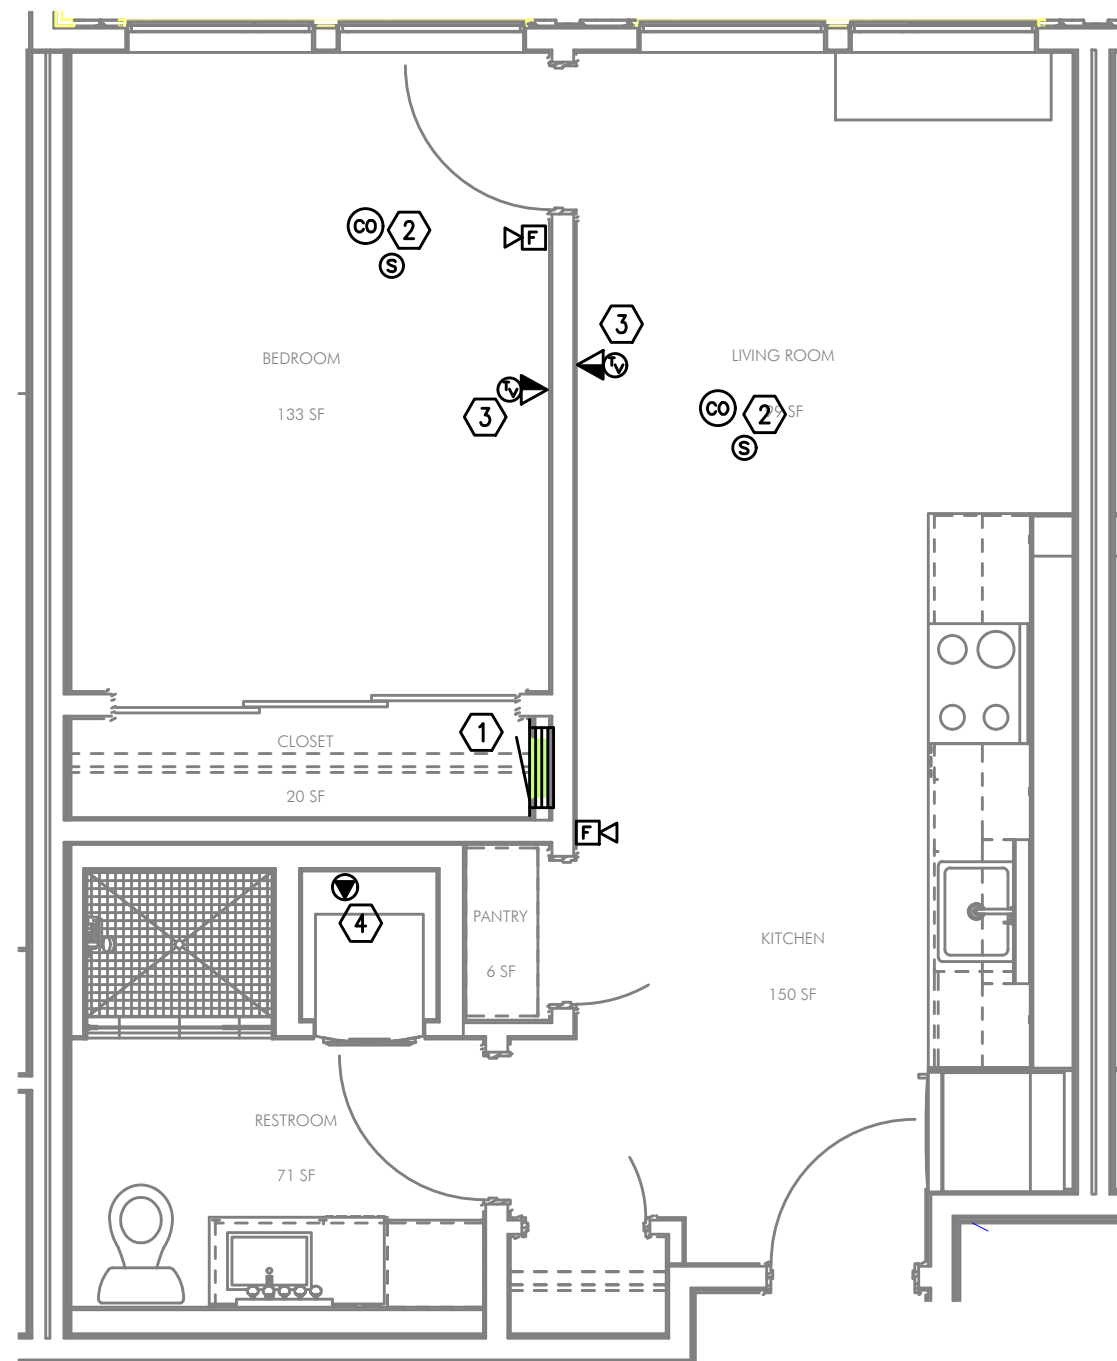


1 UNIT TYPE 'A' - TELCOM PLAN
T4.11 1/4" = 1'-0"

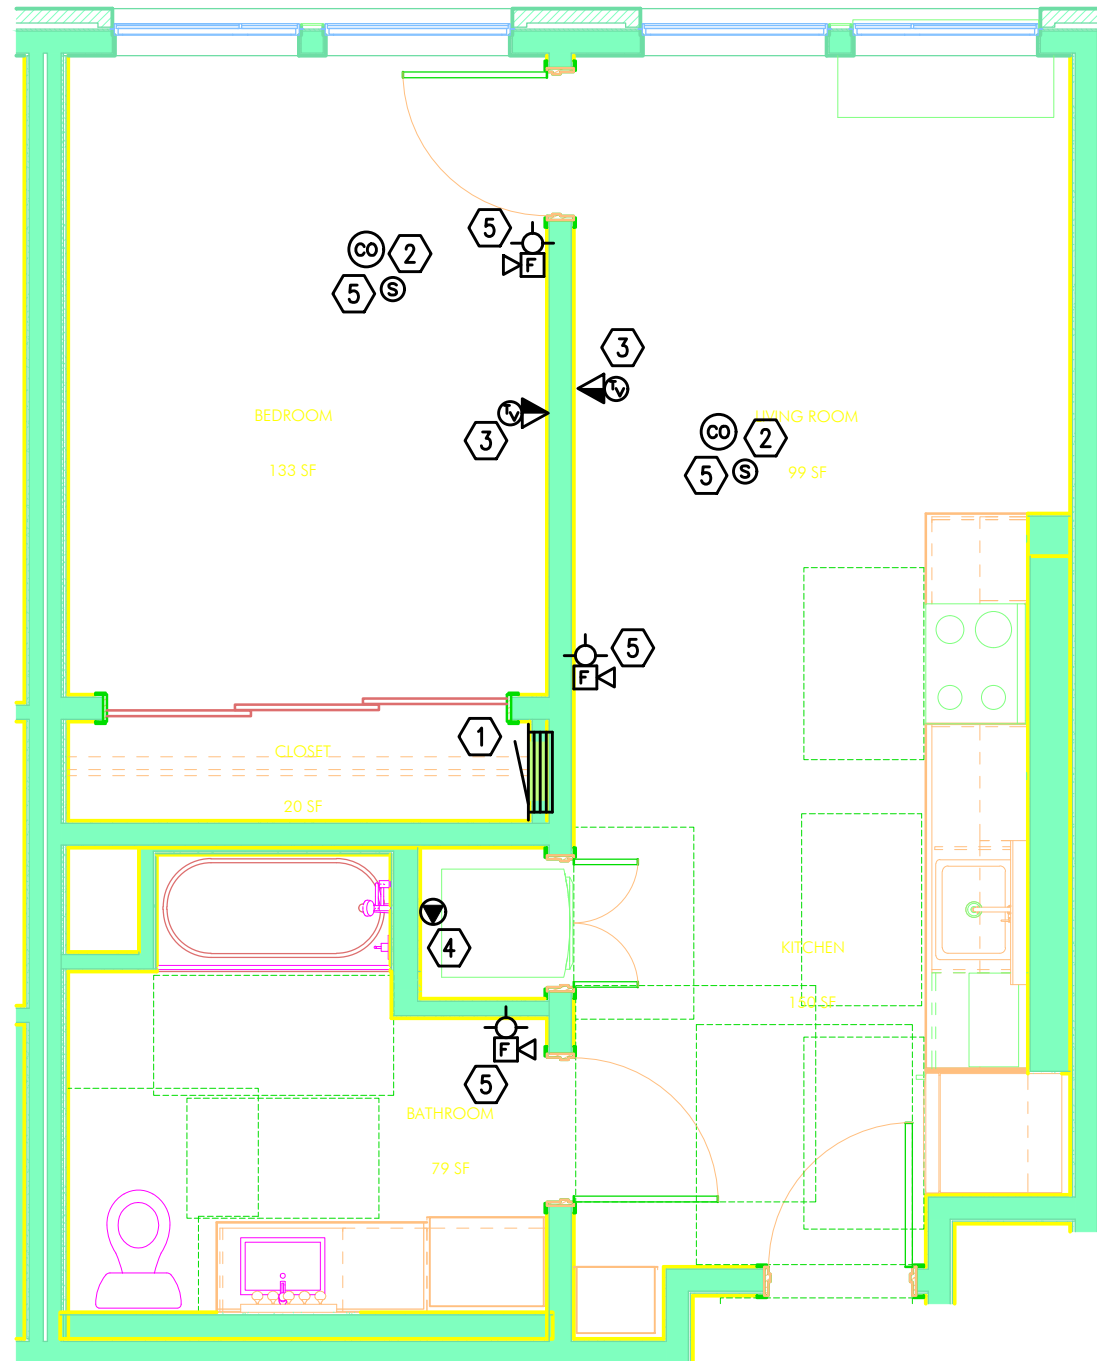

2 UNIT TYPE 'A' ADA - TELCOM PLAN
T4.11 1/4" = 1'-0"

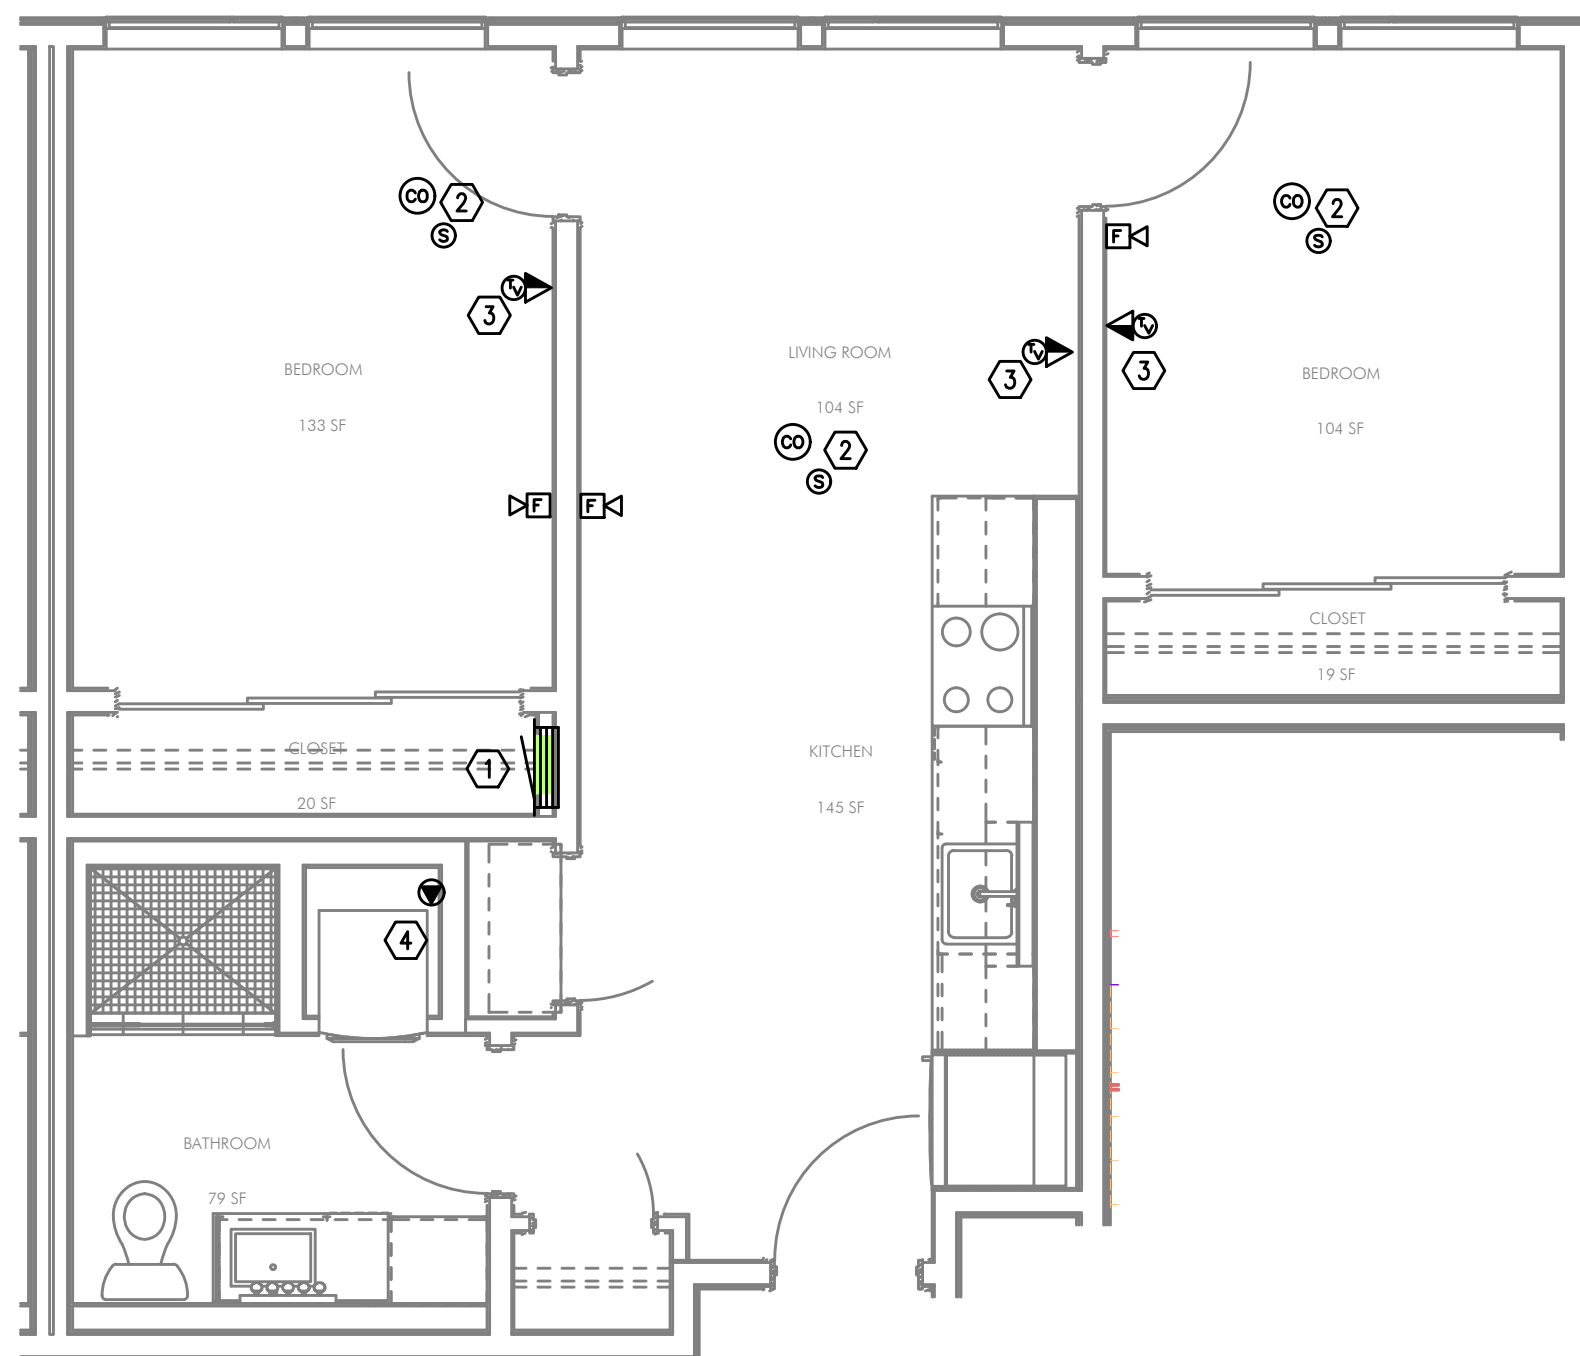

3 UNIT TYPE 'B' - TELCOM PLAN
T4.11 1/4" = 1'-0"

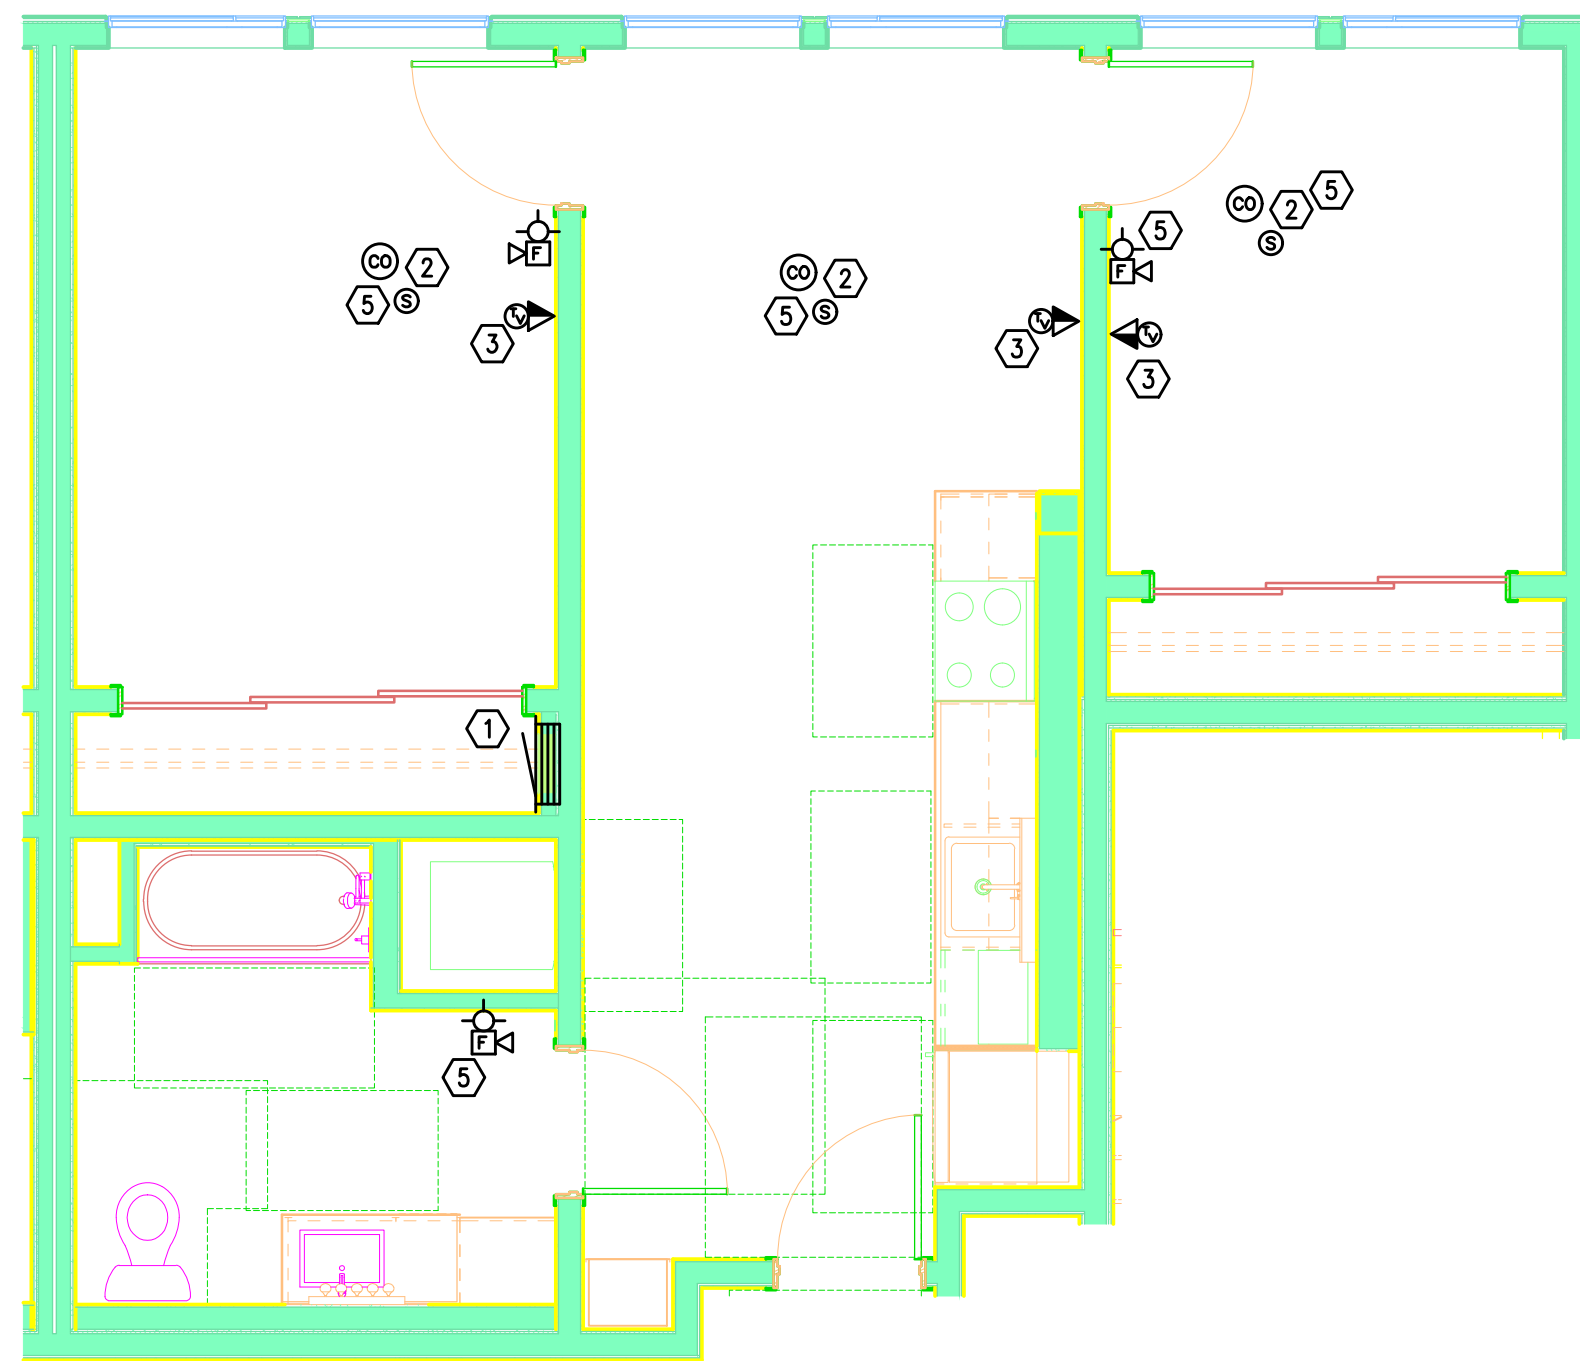

4 UNIT TYPE 'B' ADA - TELCOM PLAN
T4.11 1/4" = 1'-0"