




419 SW 11th Ave
Portland, OR 97205
Ph: 503.273.7571
Fax: 503.273.8891

Consulting Engineers
2007 S.E. Ash St.
Portland, OR 97214
Ph: 503.224.4848
Fax: 503.224-0677
WWW.MTA-ENG.COM
CONTACT: DENISE TAYLOR


FULLER STATION HOUSING
PERMIT SET
DOCUMENTS
9608 SE Fuller Road
Clackamas County, Oregon, 97086

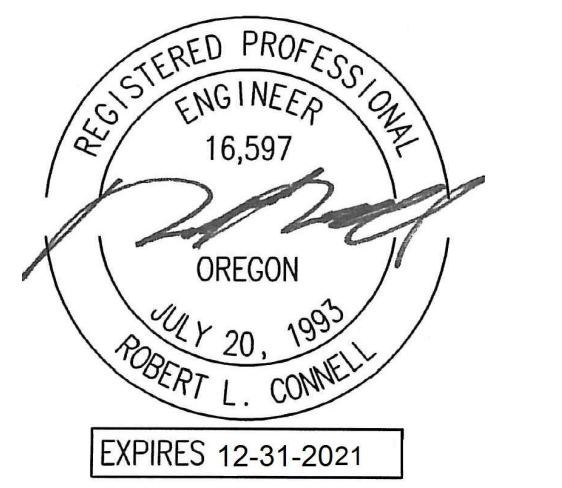

PERMIT SET		
PROJECT #:	1617.00	
SHEET ISSUE DATE:	01/31/2020	
REVISIONS:		
#	DESCRIPTION	DATE
1	COUNTY REVIEW RESPONSES	10.09.2020
2	ADDENDUM #1	10.09.2020
6	ASI #01	03.05.2021
	RFI #2	07.20.2021
	RFI #8	08.10.2021
	RFI #9	09.10.2021
	RFI #42	09.30.2021
15	ASI #10	11.05.2021
	RFI #48	11.18.2021
	RFI #50	11.18.2021
	RFI #54	11.18.2021
	RFI #55	11.18.2021
	RFI #12	12.06.2021
	RFI #13	12.06.2021


ELECTRICAL
DETAILS

E1.22

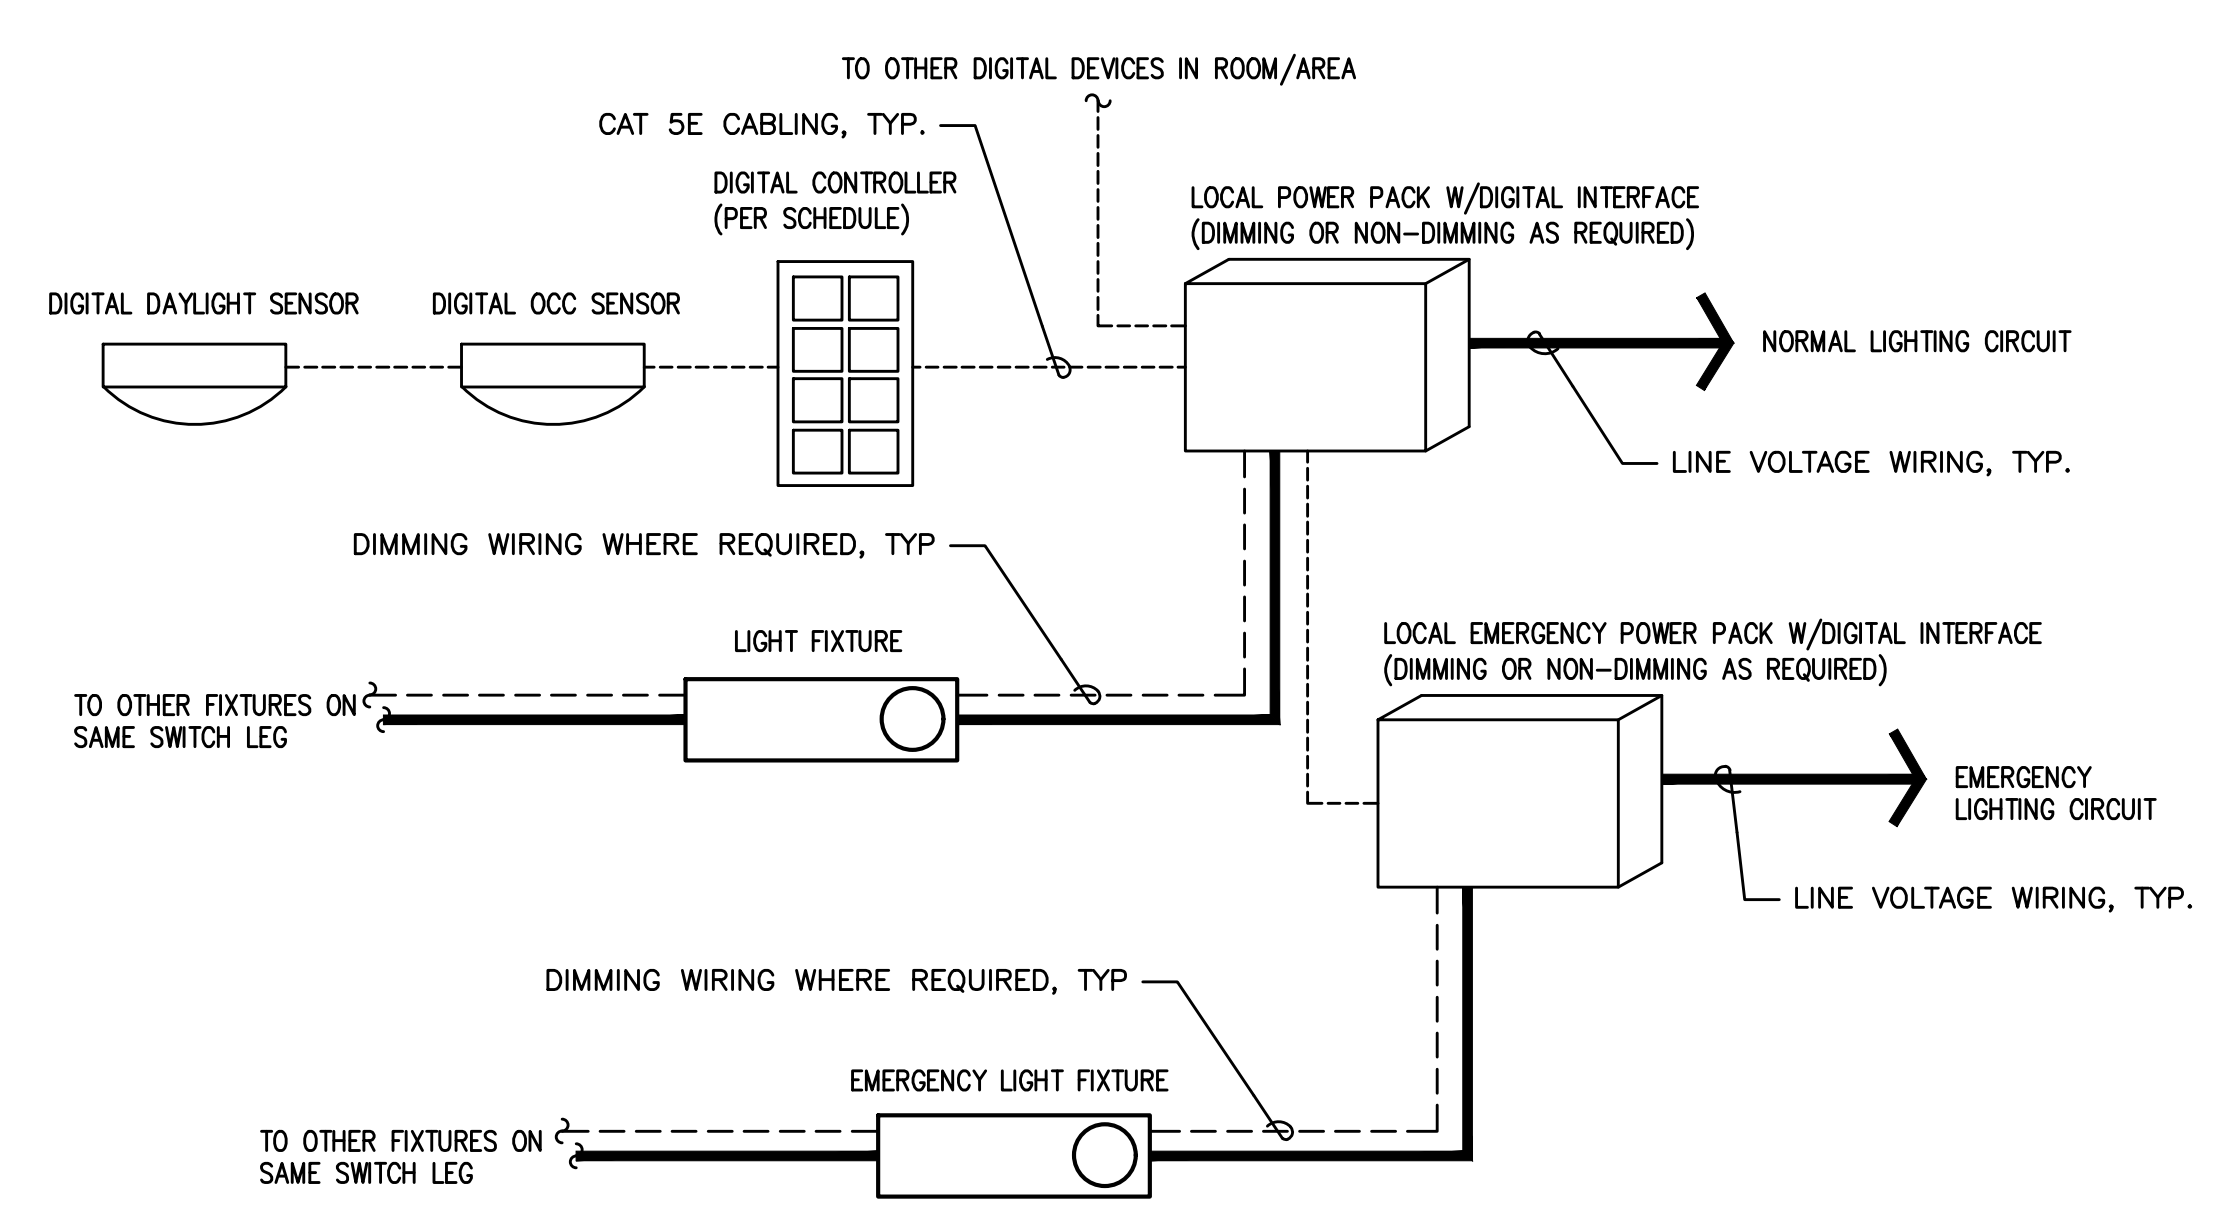


1
E1.22
DIGITAL LIGHTING
CONTROL DIAGRAM (TYPICAL)
NO SCALE


LIGHTING CONTROLS LEGEND	
\$L.V1	DIGITAL CONTROLLER WITH ON/OFF PUSHBUTTONS
\$L.V2	DIGITAL CONTROLLER WITH SINGLE ZONE ON/OFF PUSHBUTTONS AND UP/DOWN DIM BUTTONS
\$L.V3	DIGITAL GRAPHIC CONTROLLER WITH MULTI ZONE ON/OFF PUSHBUTTONS AND UP/DOWN DIM BUTTONS

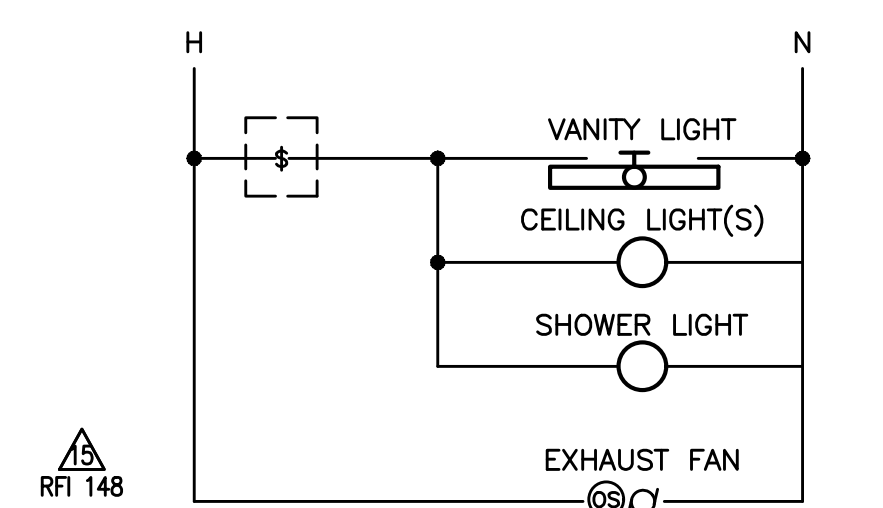


3
E1.22
BATHROOM SWITCHING DIAGRAM — TYPICAL
NO SCALE

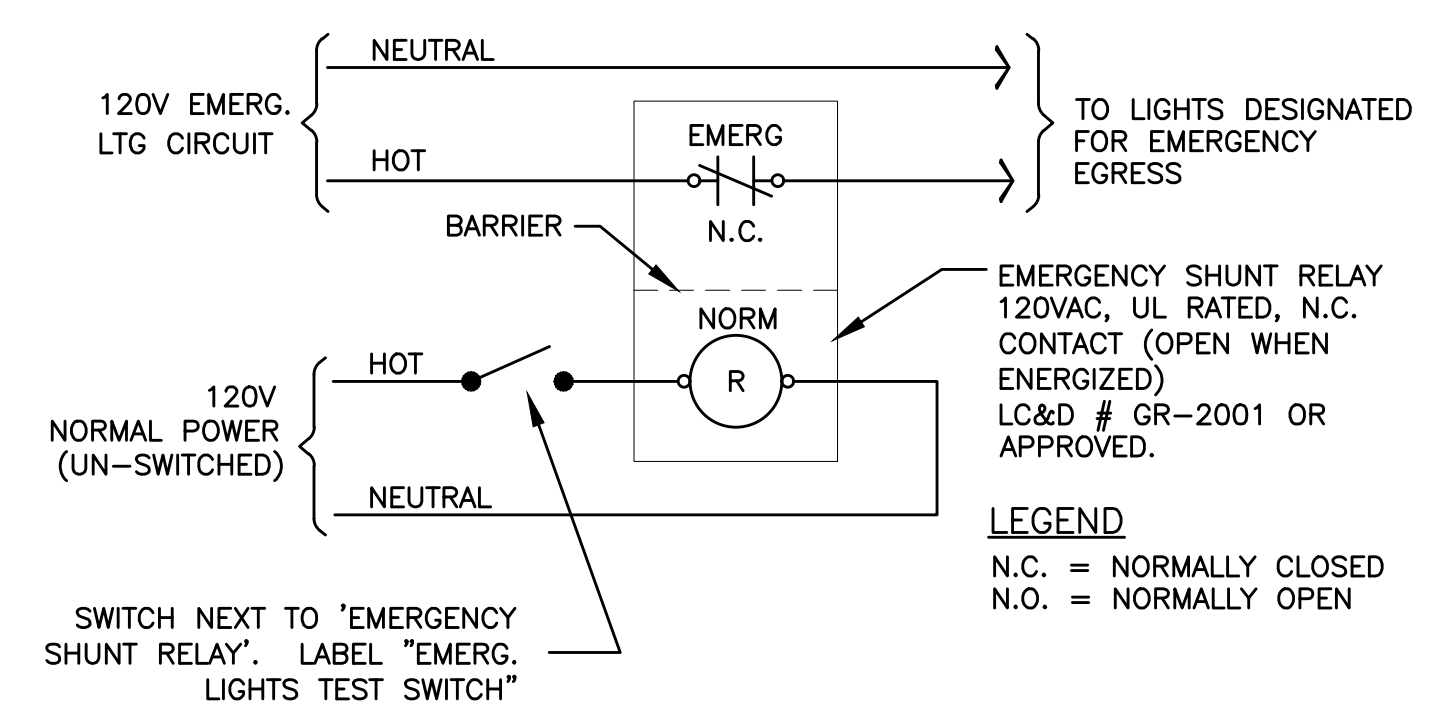

4
E1.22
EMERGENCY EGRESS LIGHTING — UNSWITCHED
NO SCALE

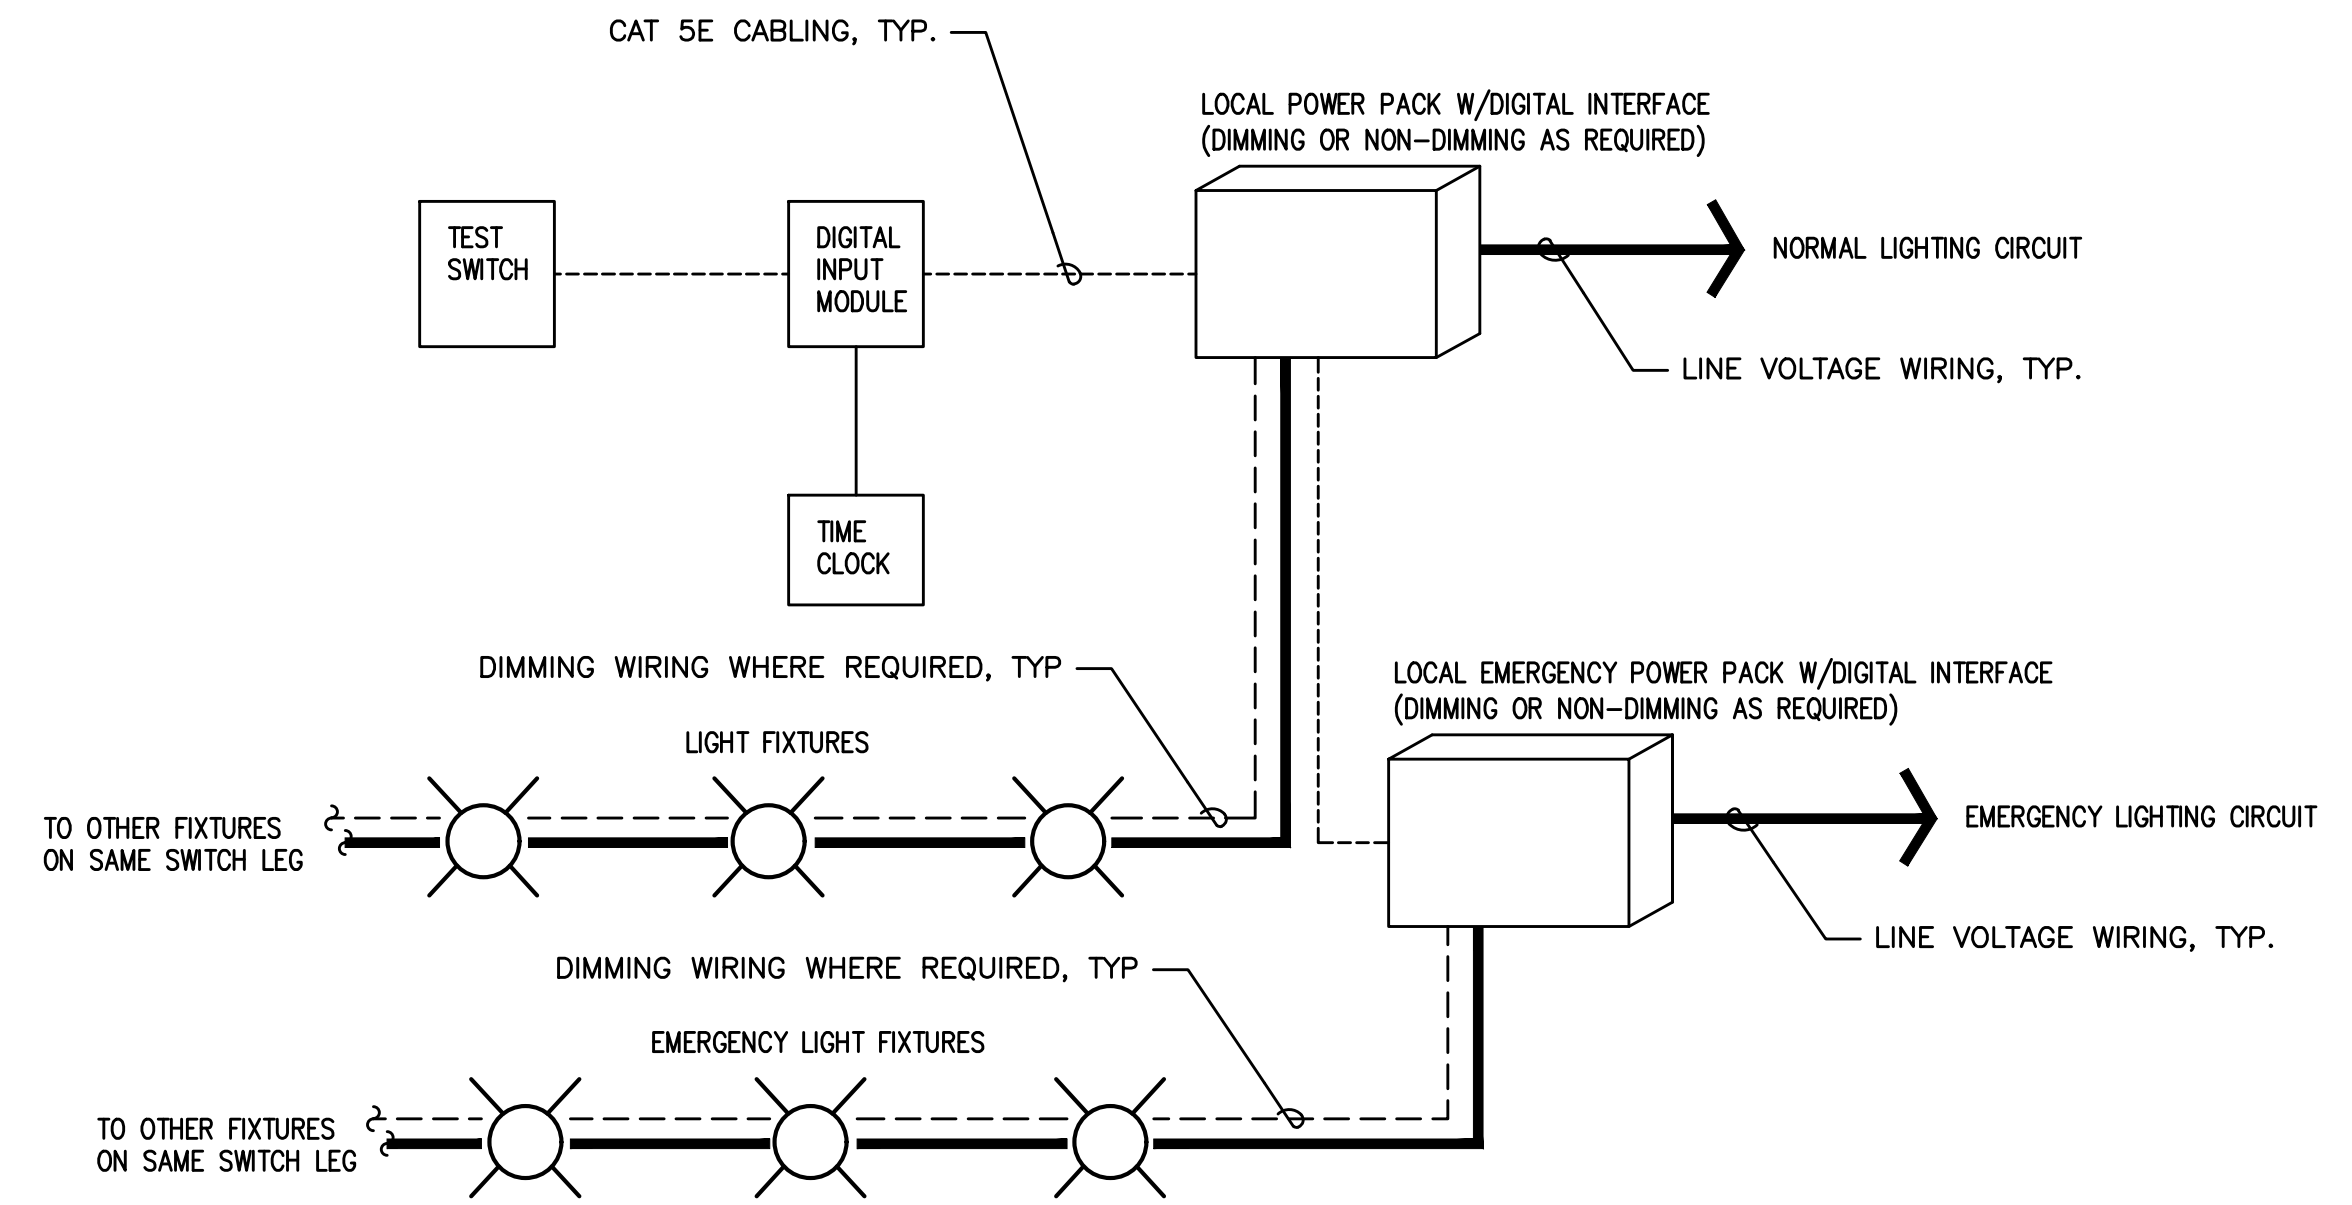

2
E1.22
DIGITAL EXTERIOR LIGHTING
CONTROL DIAGRAM (TYPICAL)
NO SCALE

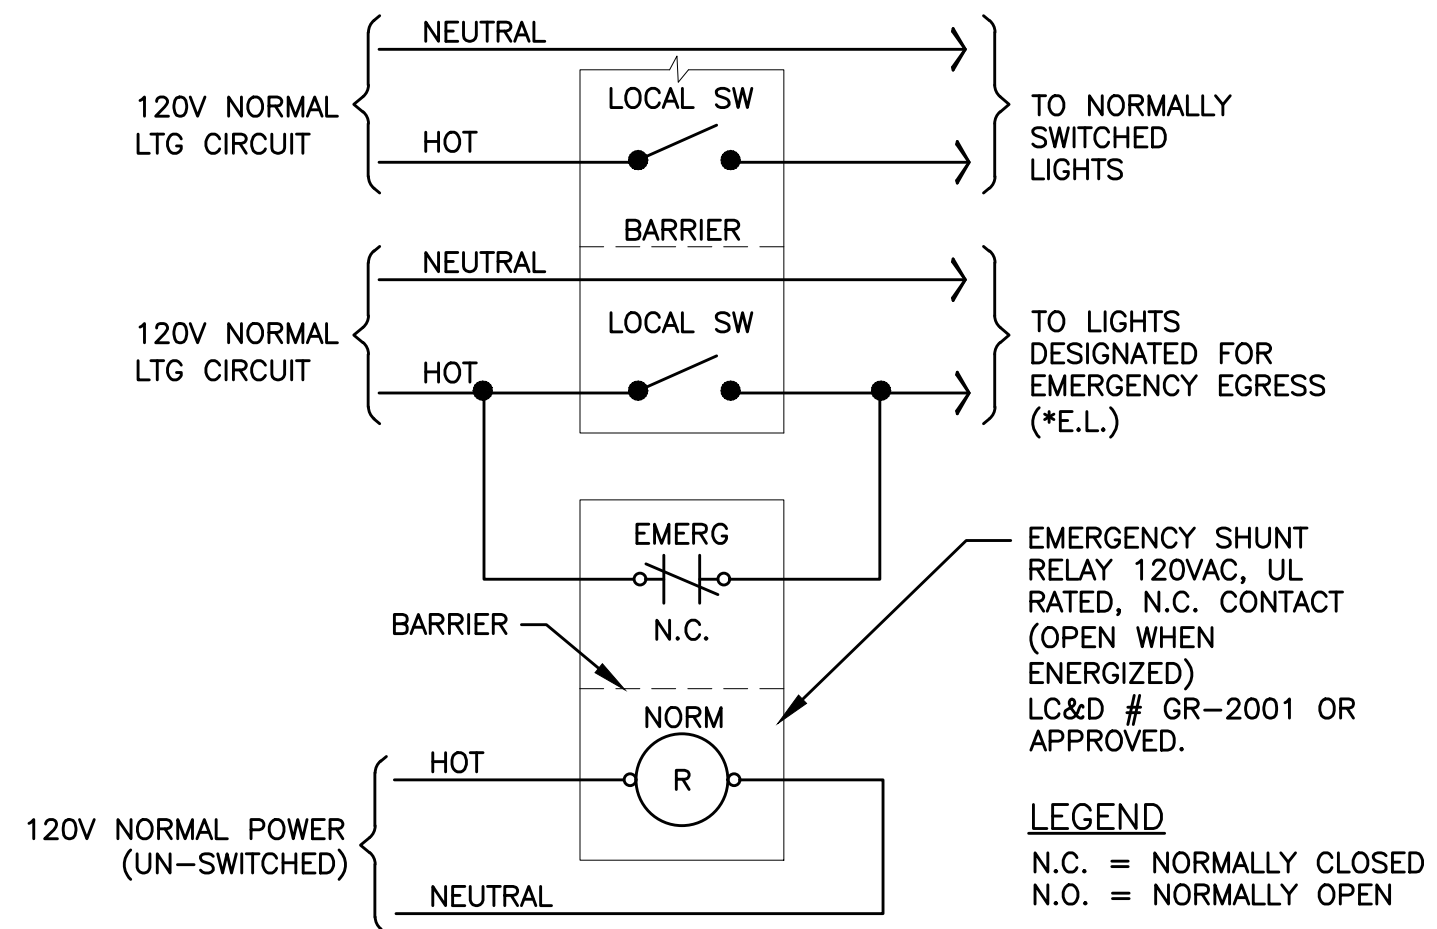

5
E1.22
EMERGENCY EGRESS LIGHTING — SWITCHED
NO SCALE