



architecture, interiors & planning

419 SW 11th Ave  
Portland, OR 97205  
Ph: 503.228.7571  
Fx: 503.273.8891

## FULLER STATION HOUSING

### 90% CONSTRUCTION DOCUMENTS

9608 SE Fuller Road  
Clackamas County, Oregon, 97086


**MEFA** Consulting Engineers  
2007 S.E. Ash St.  
Portland, OR 97214  
PHN: (503) 234-0548  
FAX: (503) 234-0677  
INC. WWW.MEFA-ENG.COM  
CONTACT: GARY ADOVNIK

### 90% CONSTRUCTION DOCUMENTS

PROJECT #: 1617.00  
SHEET ISSUE DATE: 11/11/2019  
REVISIONS:  
# DESCRIPTION DATE

LEVEL 6 -  
TELCOM PLAN

# T3.06

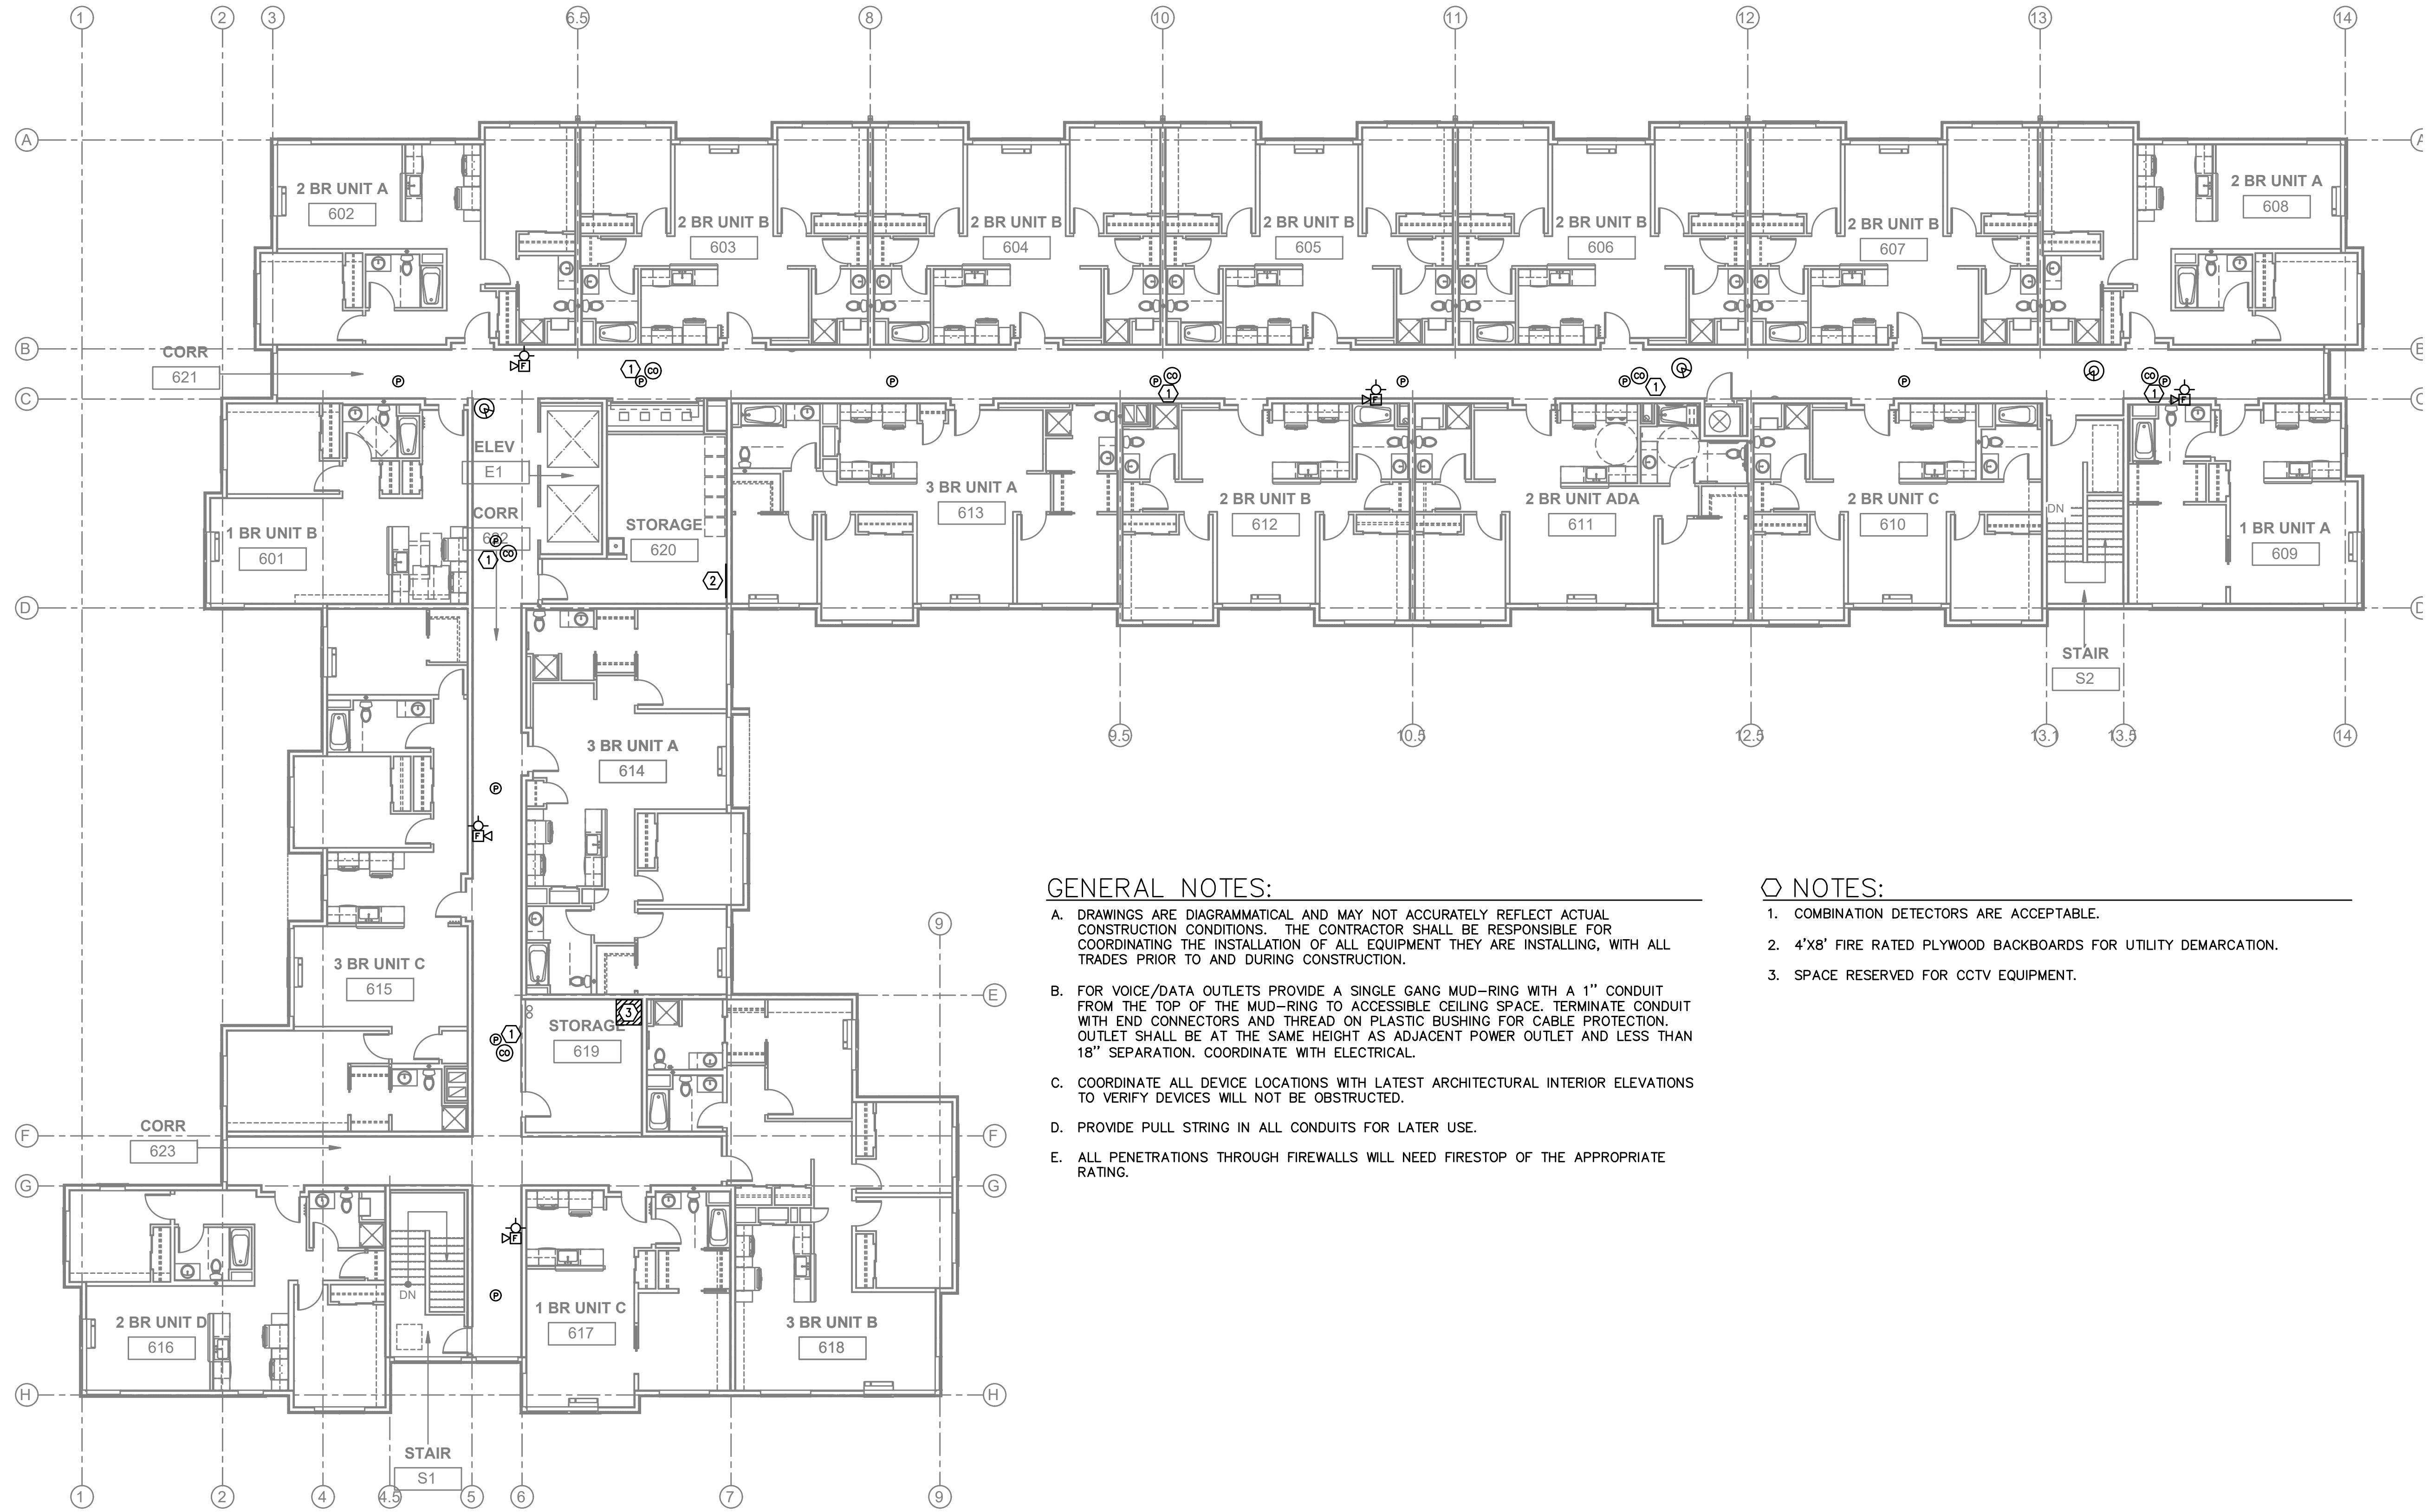


#### GENERAL NOTES:

- DRAWINGS ARE DIAGRAMMATICAL AND MAY NOT ACCURATELY REFLECT ACTUAL CONSTRUCTION CONDITIONS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING THE INSTALLATION OF ALL EQUIPMENT THEY ARE INSTALLING, WITH ALL TRADES PRIOR TO AND DURING CONSTRUCTION.
- FOR VOICE/DATA OUTLETS PROVIDE A SINGLE GANG MUD-RING WITH A 1" CONDUIT FROM THE TOP OF THE MUD-RING TO ACCESSIBLE CEILING SPACE. TERMINATE CONDUIT WITH END CONNECTORS AND THREAD ON PLASTIC BUSHING FOR CABLE PROTECTION. OUTLET SHALL BE AT THE SAME HEIGHT AS ADJACENT POWER OUTLET AND LESS THAN 18" SEPARATION. COORDINATE WITH ELECTRICAL.
- COORDINATE ALL DEVICE LOCATIONS WITH LATEST ARCHITECTURAL INTERIOR ELEVATIONS TO VERIFY DEVICES WILL NOT BE OBSTRUCTED.
- PROVIDE PULL STRING IN ALL CONDUITS FOR LATER USE.
- ALL PENETRATIONS THROUGH FIREWALLS WILL NEED FIRESTOP OF THE APPROPRIATE RATING.

#### NOTES:

- COMBINATION DETECTORS ARE ACCEPTABLE.
- 4'x8' FIRE RATED PLYWOOD BACKBOARDS FOR UTILITY DEMARCATION.
- SPACE RESERVED FOR CCTV EQUIPMENT.



1 LEVEL 6 - POWER PLAN  
E3.06 SCALE: 3/32" = 1'-0"