



architecture, interiors & planning

419 SW 11th Ave
Portland, OR 97205
Ph: 503.228.7571
Fx: 503.273.8891

FULLER STATION HOUSING

90% CONSTRUCTION DOCUMENTS

9608 SE Fuller Road
Clackamas County, Oregon, 97086


MFA Consulting Engineers
2007 S.E. Ash St.
Portland, OR 97214
PHN: (503) 234-0548
FAX: (503) 234-0677
CONTACT: GARY ADOVNIK

90% CONSTRUCTION DOCUMENTS

PROJECT #: 1617.00
SHEET ISSUE DATE: 11/11/2019
REVISIONS:
DESCRIPTION DATE

LEVEL 1 -
TELCOM PLAN

T3.01

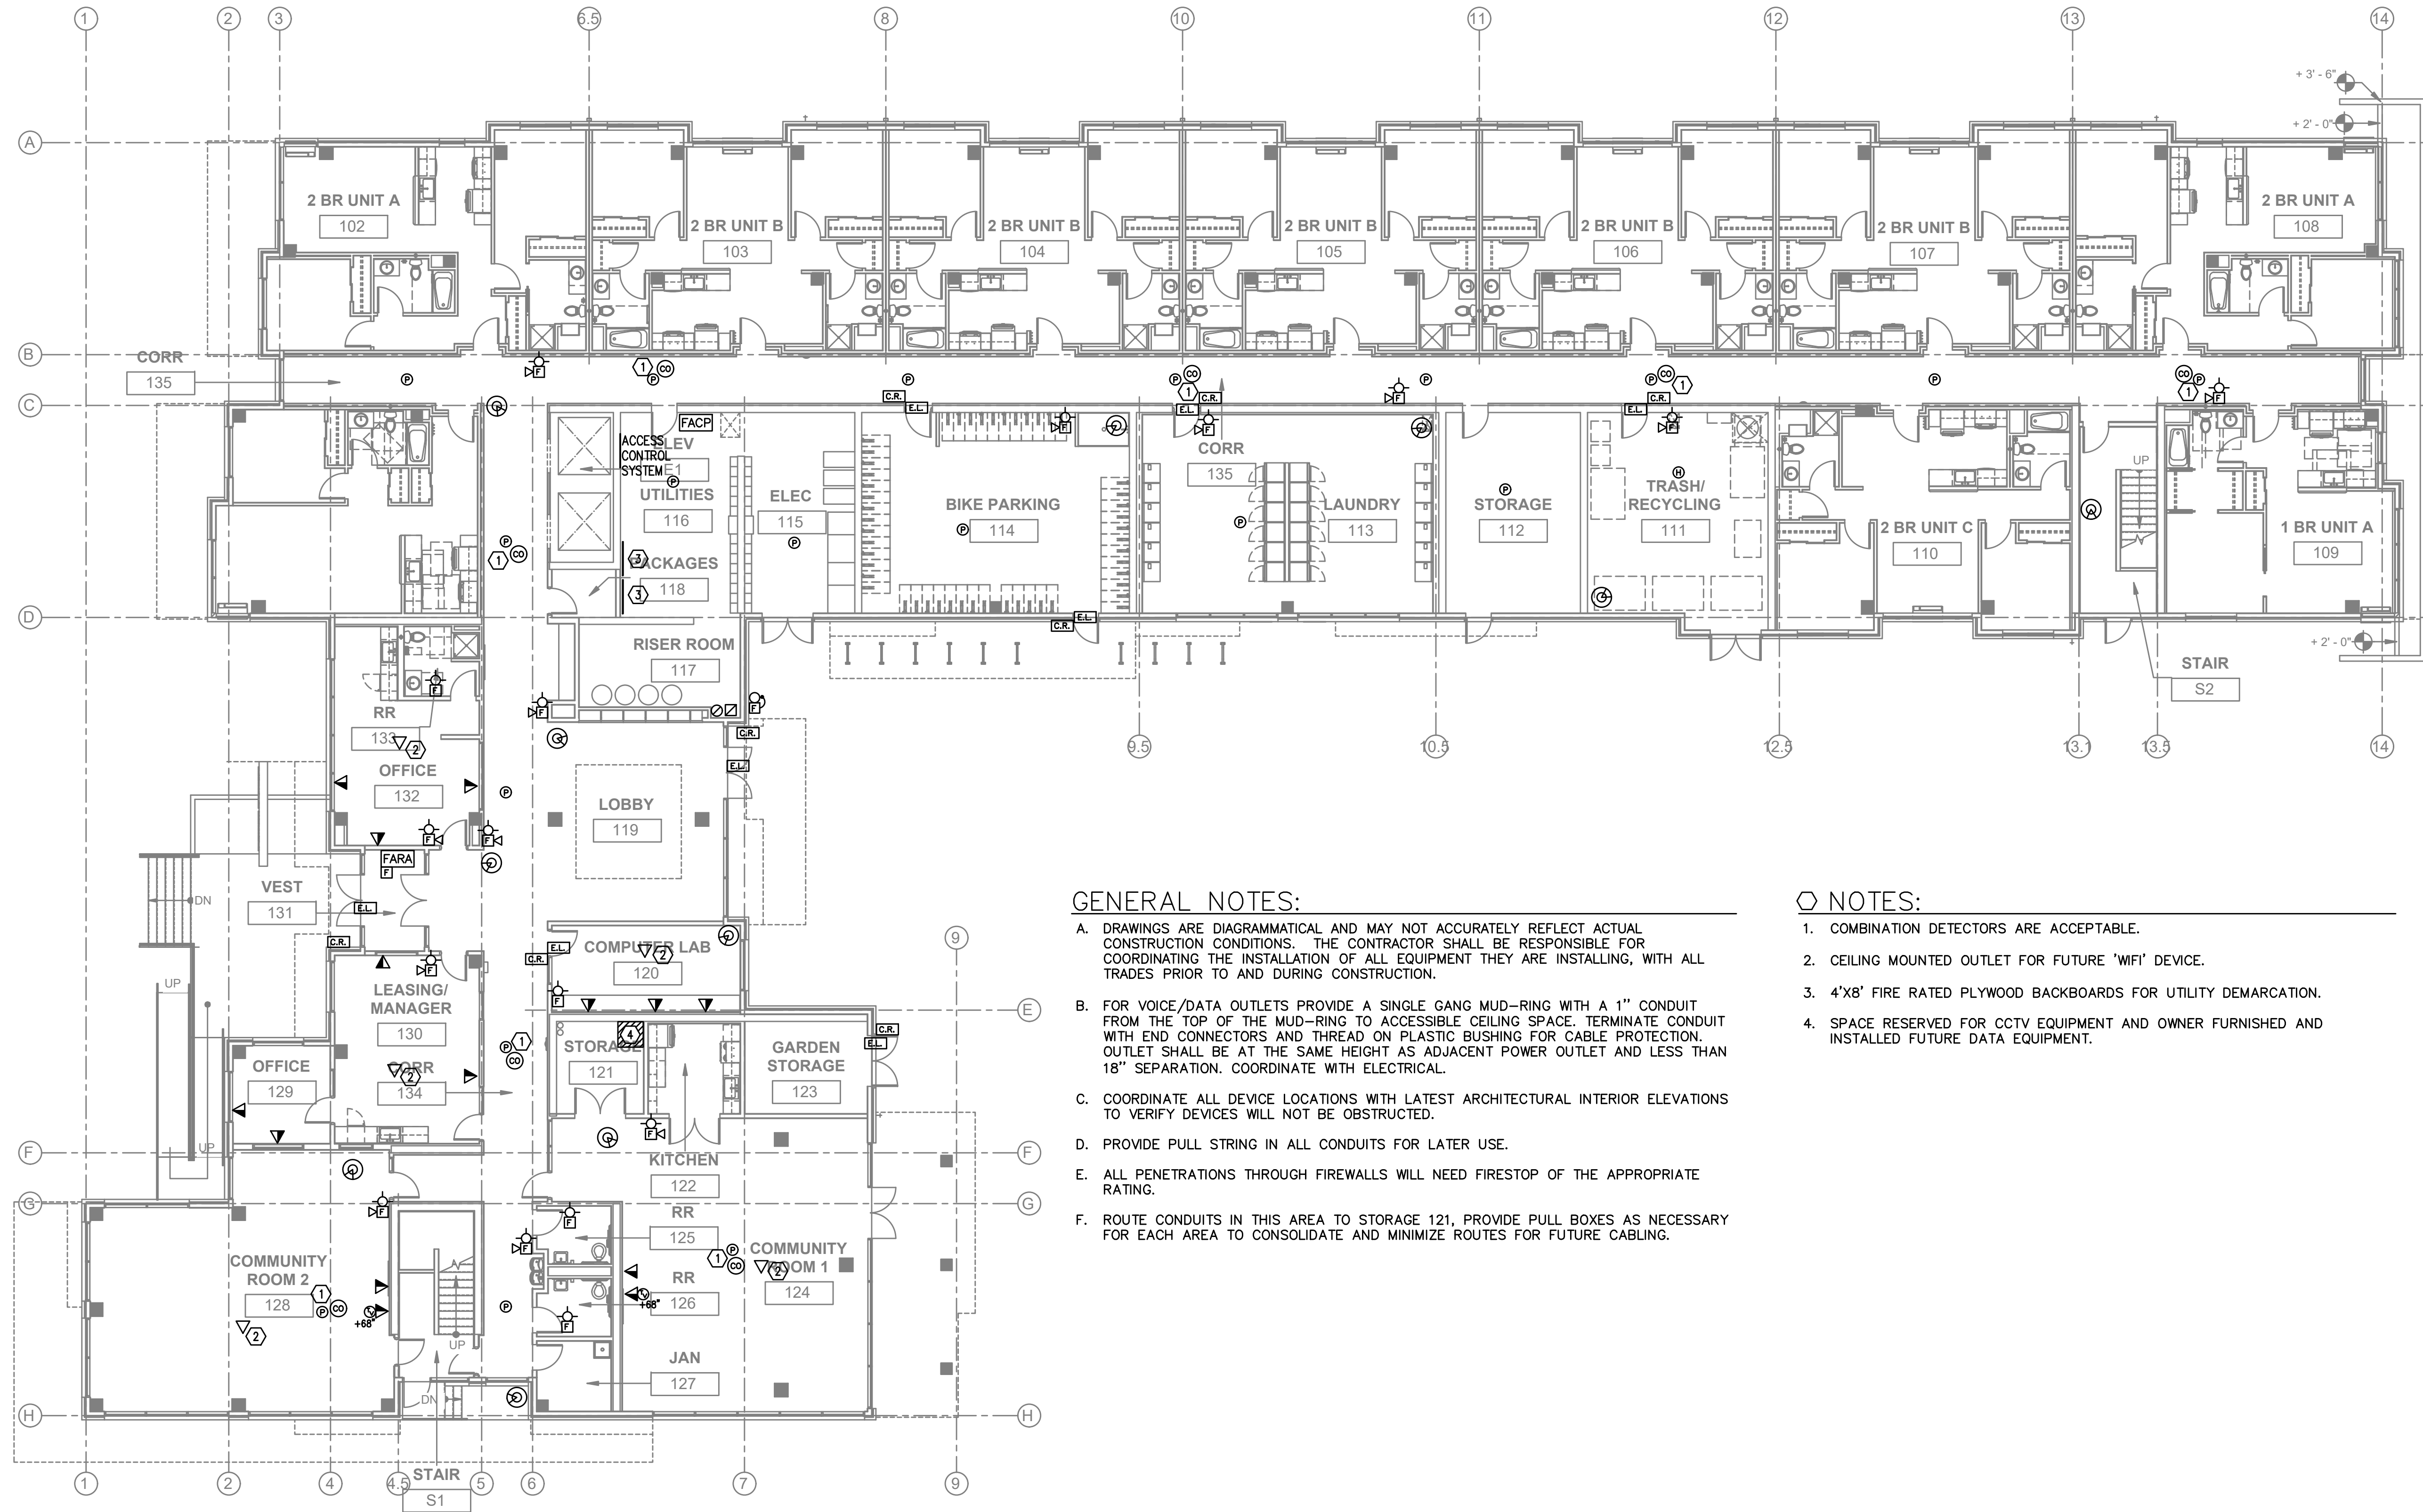


GENERAL NOTES:

- DRAWINGS ARE DIAGRAMMATICAL AND MAY NOT ACCURATELY REFLECT ACTUAL CONSTRUCTION CONDITIONS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING THE INSTALLATION OF ALL EQUIPMENT THEY ARE INSTALLING, WITH ALL TRADES PRIOR TO AND DURING CONSTRUCTION.
- FOR VOICE/DATA OUTLETS PROVIDE A SINGLE GANG MUD-RING WITH A 1" CONDUIT FROM THE TOP OF THE MUD-RING TO ACCESSIBLE CEILING SPACE. TERMINATE CONDUIT WITH END CONNECTORS AND THREAD ON PLASTIC BUSHING FOR CABLE PROTECTION. OUTLET SHALL BE AT THE SAME HEIGHT AS ADJACENT POWER OUTLET AND LESS THAN 18" SEPARATION. COORDINATE WITH ELECTRICAL.
- COORDINATE ALL DEVICE LOCATIONS WITH LATEST ARCHITECTURAL INTERIOR ELEVATIONS TO VERIFY DEVICES WILL NOT BE OBSTRUCTED.
- PROVIDE PULL STRING IN ALL CONDUITS FOR LATER USE.
- ALL PENETRATIONS THROUGH FIREWALLS WILL NEED FIRESTOP OF THE APPROPRIATE RATING.
- ROUTE CONDUITS IN THIS AREA TO STORAGE 121, PROVIDE PULL BOXES AS NECESSARY FOR EACH AREA TO CONSOLIDATE AND MINIMIZE ROUTES FOR FUTURE CABLING.

NOTES:

- COMBINATION DETECTORS ARE ACCEPTABLE.
- CEILING MOUNTED OUTLET FOR FUTURE 'WIFI' DEVICE.
- 4'X8' FIRE RATED PLYWOOD BACKBOARDS FOR UTILITY DEMARCATION.
- SPACE RESERVED FOR CCTV EQUIPMENT AND OWNER FURNISHED AND INSTALLED FUTURE DATA EQUIPMENT.



1
T3.01
LEVEL 1 - TELCOM PLAN
SCALE: 3/32" = 1'-0"